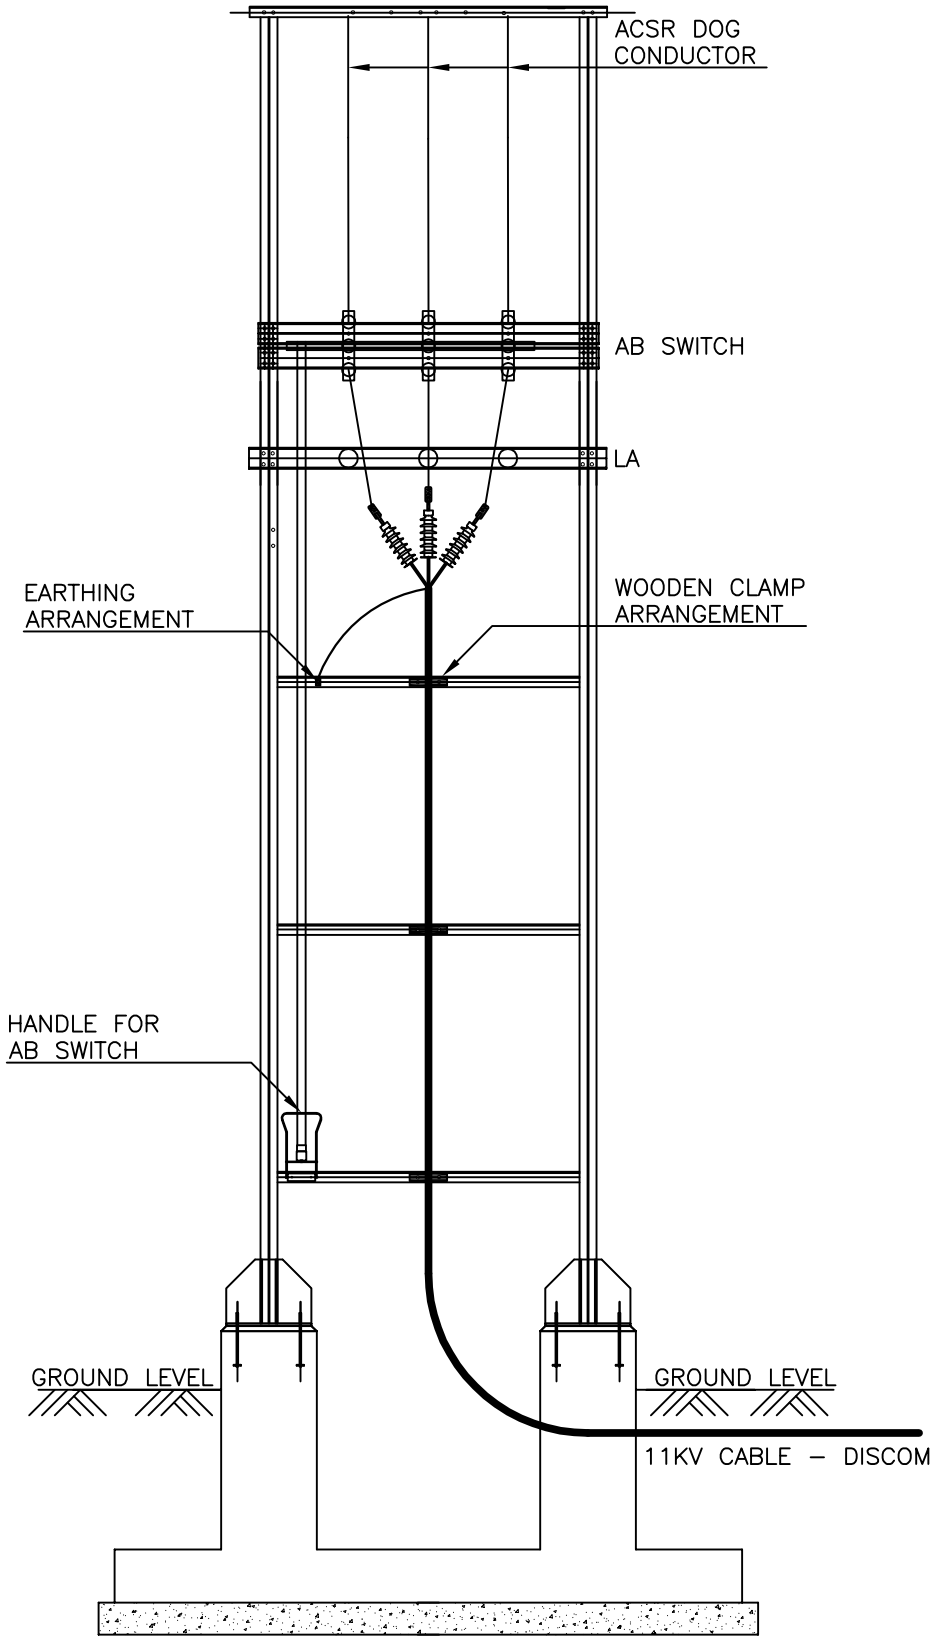

11KV CROSS BOUNDARY PROTECTION DP STRUCTURE– A4 (DISCOM)

(APPLICABLE ONLY INCASE OF 11KV DISCOM CABLE FEEDER)

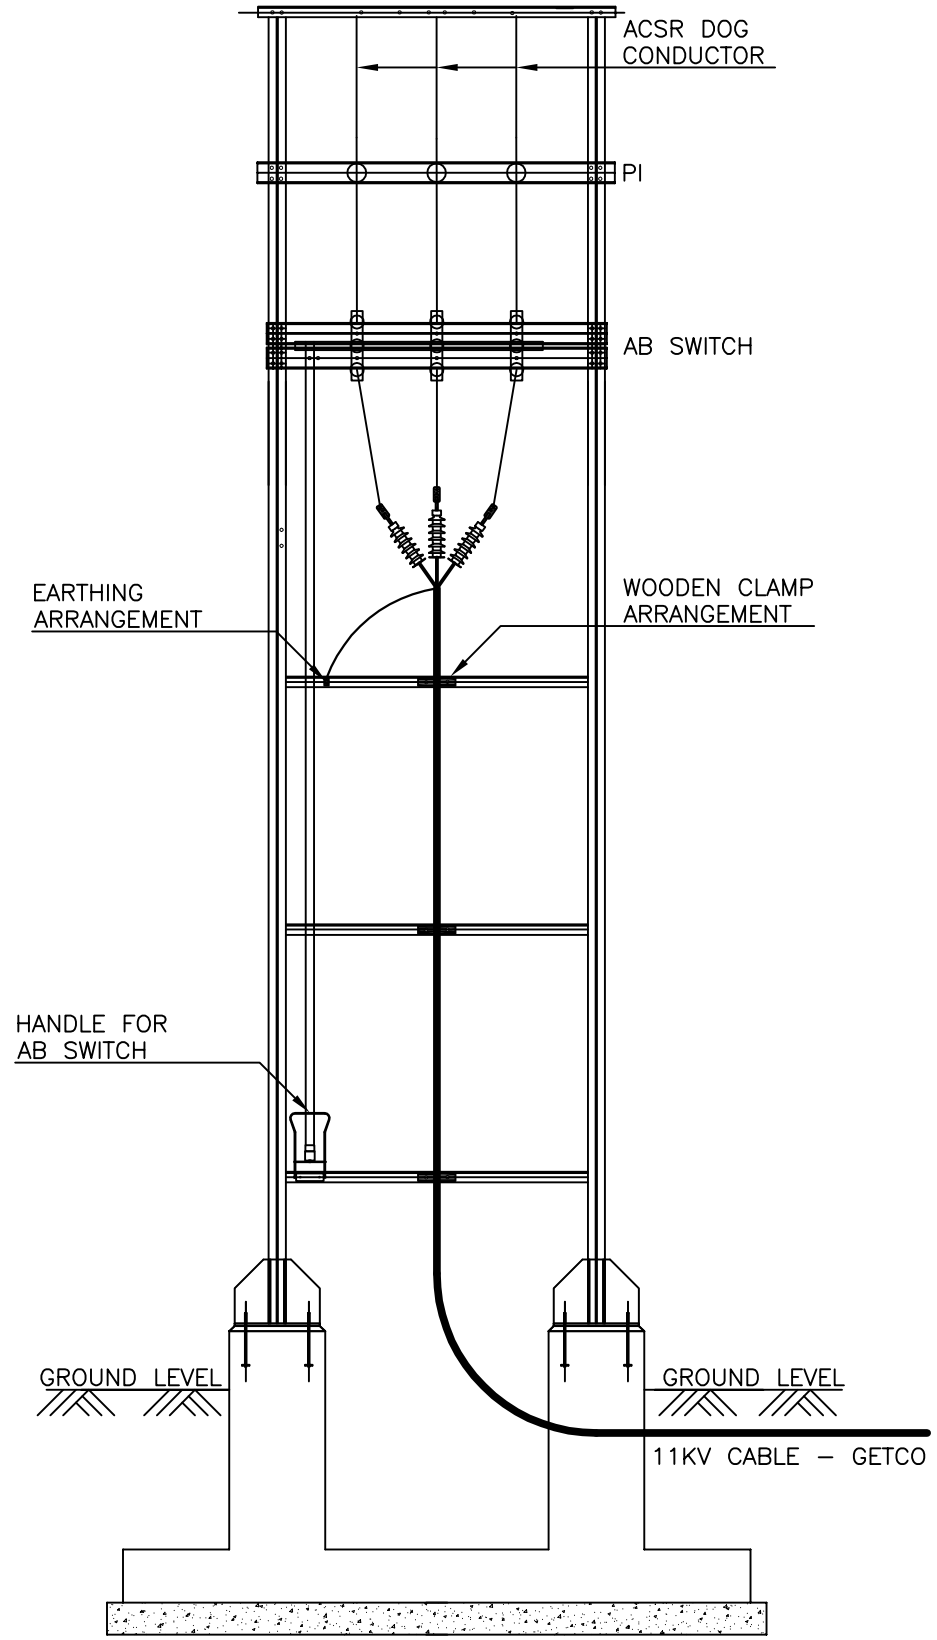

11KV OUT GOING FEEDER DP STRUCTURE– A1 (GETCO)

SR NO.	REFERENCE	REV:	DESCRIPTION
		R1	G.I. STRUCTURES STANDARDIZED AS PER FIELD REQUIREMENT.
		R0	FIRST PREPARATION

EXECUTION PURPOSE

GUJARAT ENERGY TRANSMISSION CORPN.LTD.
S.P.VIDYUT BHAVAN, RACE COURSE,
VADODARA - 390 007

ARRANGEMENT OF INTERCONNECTION BETWEEN 11KV O/G FEEDER DP STRUCTURE (GETCO) & CROSS BOUNDARY PROTECTION DP STRUCTURE (DISCOM)

DRAWN:	CHECKED:	APPD:	SIZE:
JE (ENGG.)	DE (ENGG.) DE (CIVIL)	EE (ENGG.) CE (ENGG.)	A3

SCALE:	DATE:	DRG. NO:	SHEET:	REV:
N.T.S	03.07.2015	GETCO / E / 06S-STD / SPL-015	02 OF 02	R1