


1 2 3 4 5 6 7 8

A  
B  
C  
D  
E  
F

A  
B  
C  
D  
E  
F

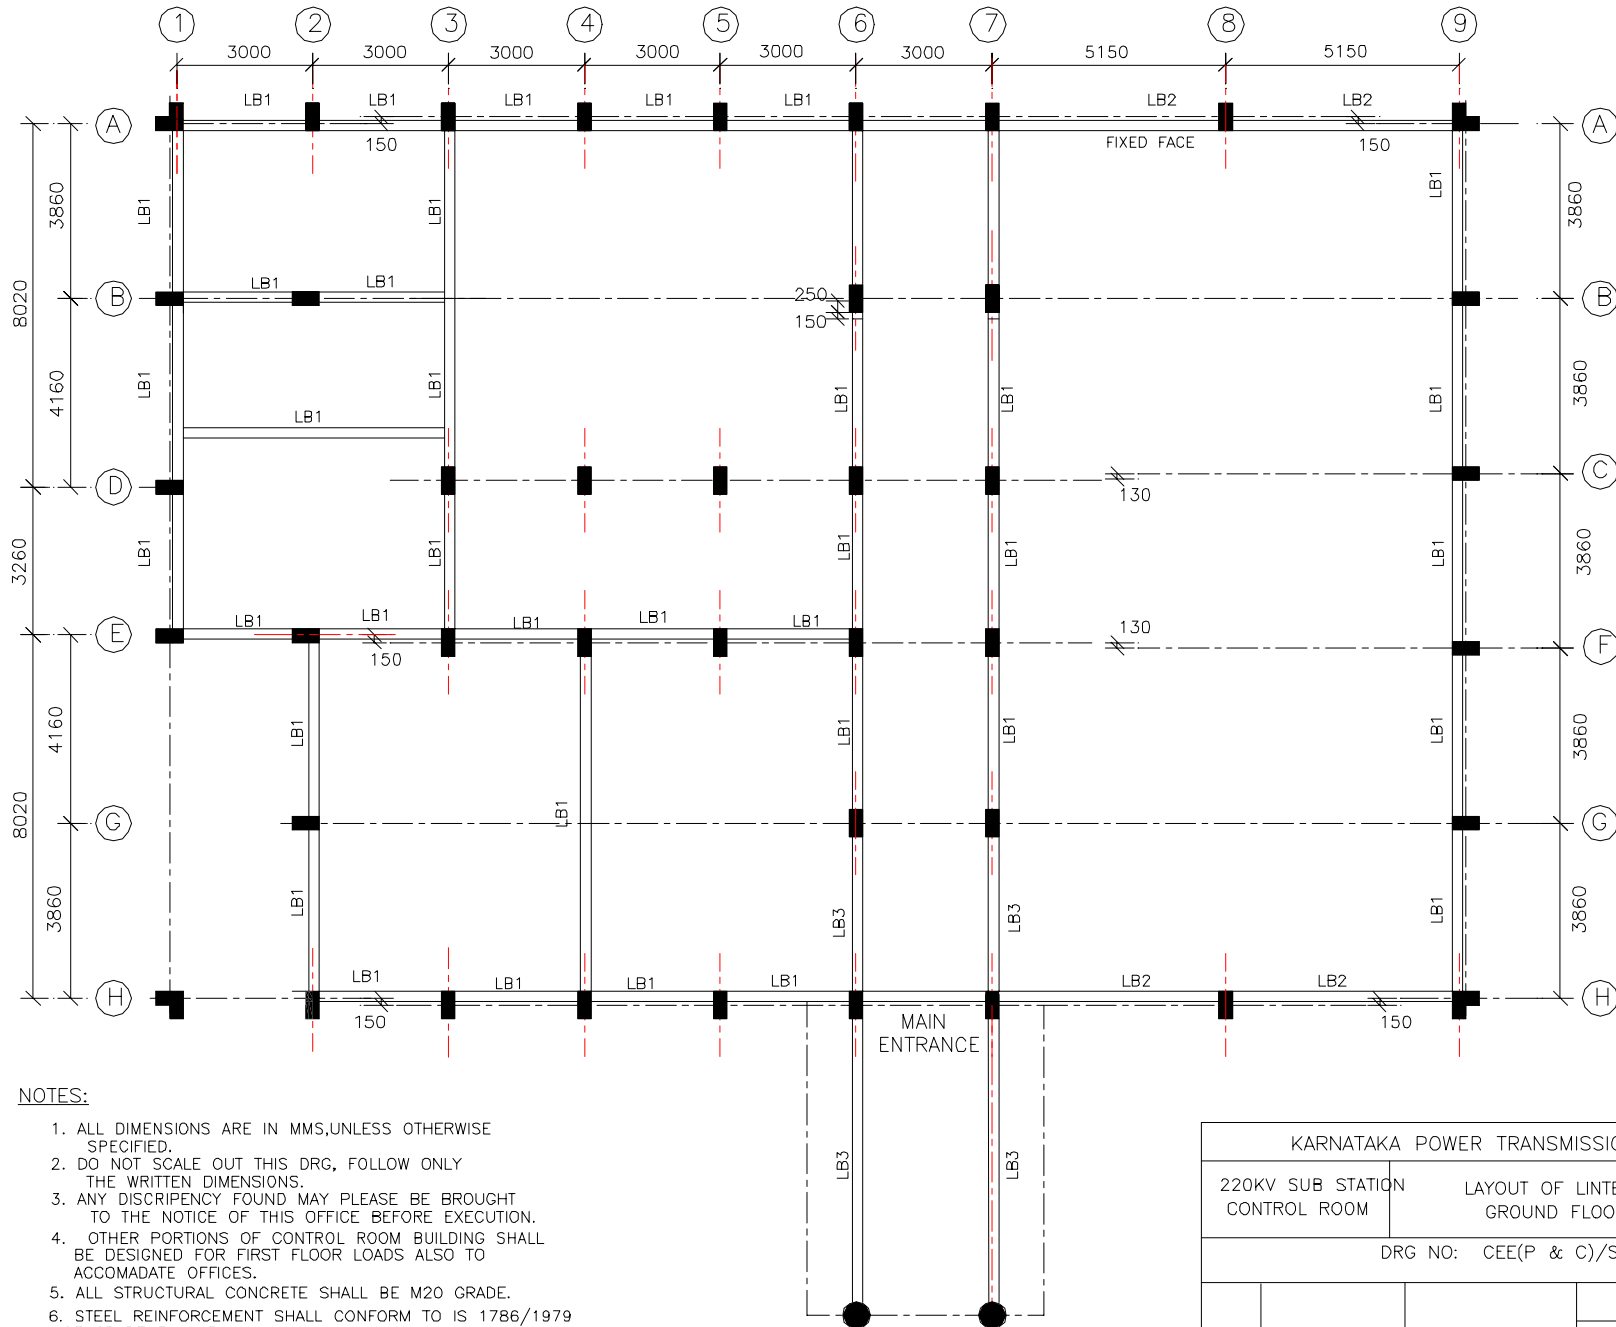

NOTES:

1. ALL DIMENSIONS ARE IN MMS,UNLESS OTHERWISE SPECIFIED.
2. DO NOT SCALE OUT THIS DRG, FOLLOW ONLY THE WRITTEN DIMENSIONS.
3. ANY DISCRIPENCY FOUND MAY PLEASE BE BROUGHT TO THE NOTICE OF THIS OFFICE BEFORE EXECUTION.
4. OTHER PORTIONS OF CONTROL ROOM BUILDING SHALL BE DESIGNED FOR FIRST FLOOR LOADS ALSO TO ACCOMADATE OFFICES.
5. ALL STRUCTURAL CONCRETE SHALL BE M20 GRADE.
6. STEEL REINFORCEMENT SHALL CONFORM TO IS 1786/1979 OF GRADE Fe 415

KARNATAKA POWER TRANSMISSION CORORATION LTD						
220KV SUB STATION CONTROL ROOM			LAYOUT OF LINTELS OF GROUND FLOOR			SHEET 1 OF 2
DRG NO: CEE(P & C)/SE(C)/06-07/220/005						
						PLANING AND CO ORDINATION
				CHIEF ENGINEER ELE		
HDM	AEE(C)		SE(CIVIL)		PLANING & CO ORDINATION	
DRN	DGN	CHD	REC		APPROVED	

1 2 3 4 5 6 7 8