


# Sketch showing the various layers of trench reinstating work for Residential & Collector roads.

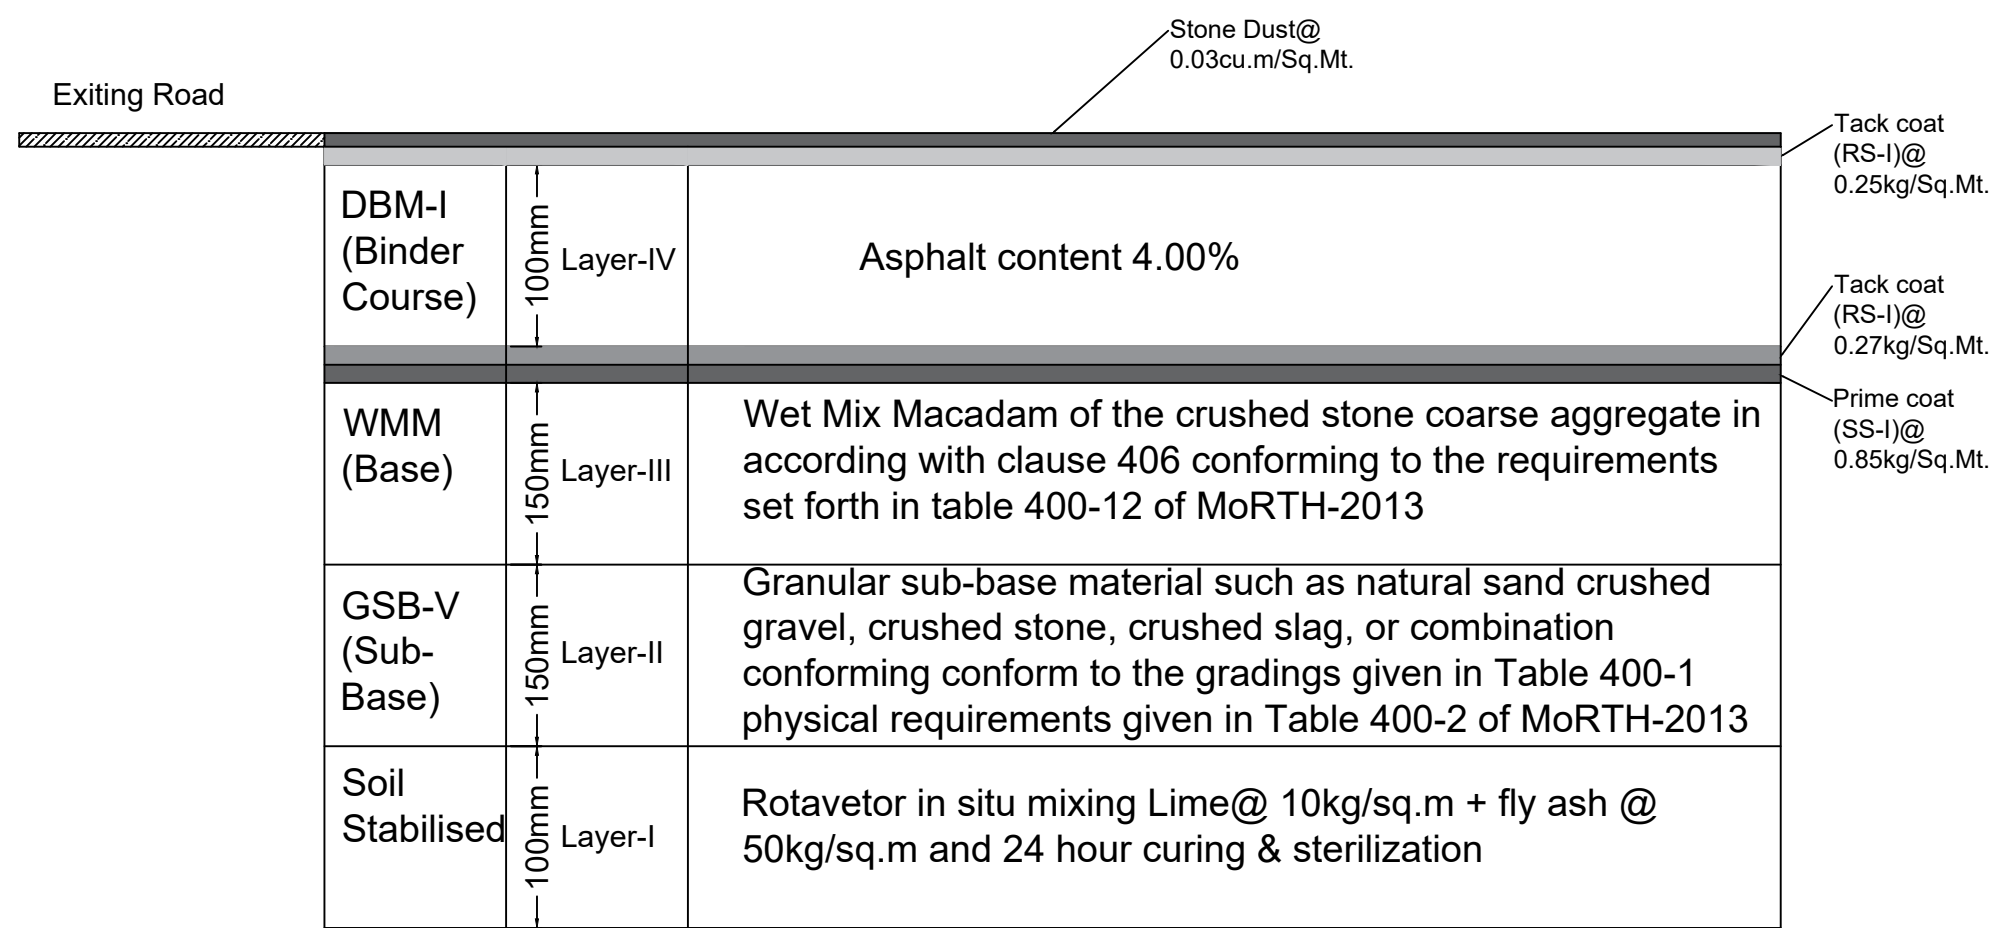

- Note:-
1. Necessary certificate shall be obtain by concern Agencies/Department about proper watering compaction (F.D.D.) Test before execution of trench line reinstating work.
  2. All the above thicknesses are compacted thickness.
  3. no watering is to be done in layer II, layer III.
  4. Prime Coat used shall be cationic bitumen emulsion ss- I grade conforming to IS:8887.
  5. Tack coat used shall be cationic bitumen emulsion RS-I grading conforming to IS:8887.
  6. Density of DBM=2300kg/m<sup>3</sup>.
  7. Density of BC=2400kg/m<sup>3</sup>.