



ELEVATION


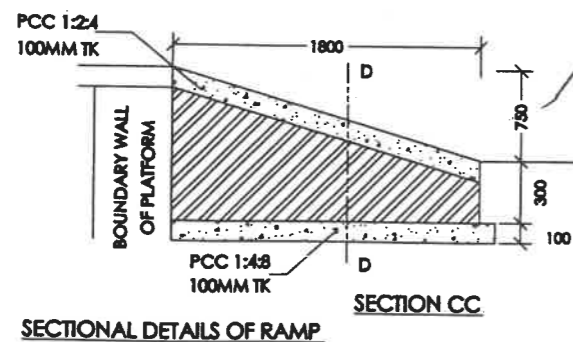


SECTIONAL DETAILS OF RAMP

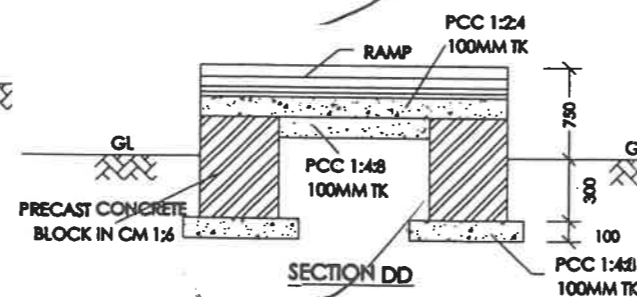

SECTION DD

Alround angj 750 600mm wide shall be provided

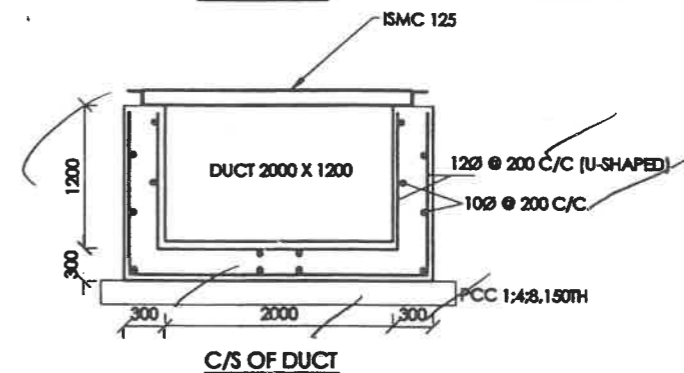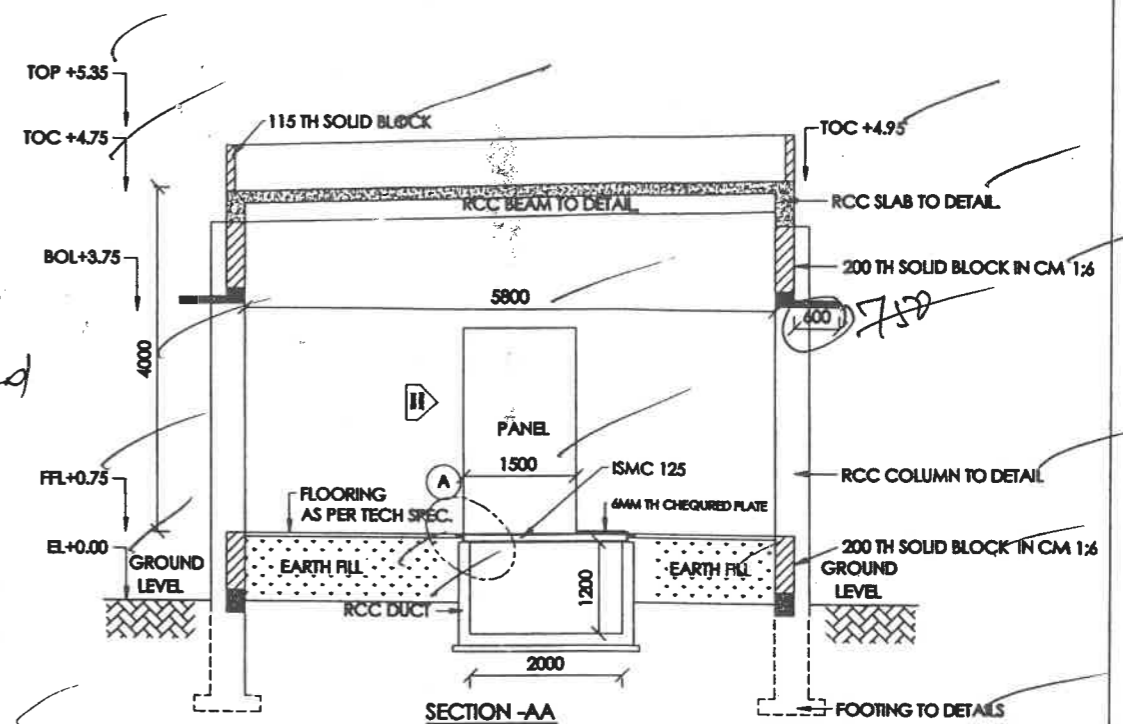

C/S OF DUCT

NOTES:

1. ALL DIMENSIONS ARE IN MMS, UNLESS OTHERWISE SPECIFIED.
2. DO NOT SCALE OUT THIS DRG. FOLLOW ONLY THE WRITTEN DIMENSIONS.
3. ANY DISCREPANCY FOUND MAY PLEASE BE BROUGHT TO THE NOTICE OF THIS OFFICE BEFORE EXECUTION.
4. 230/150MM DIA RCC HUME PIPES SHALL BE PROVIDED FOR ENTRY AND EXIT OF CABLES. NOS & POSITION OF THE PIPES SHALL BE DECIDED AT SITE.
5. GRADE OF CONCRETE M-20 AND STEEL Fe-500.

OWNER	KARNATAKA POWER TRANSMISSION CORPORATION LTD.,					
TITLE	11KV SWITCH GEAR FOUNDATION AND SHELTER					
	DESIGN	PRELIMINARY	APPROVAL	CONSTRUCTION	RECORD	CAD NAME