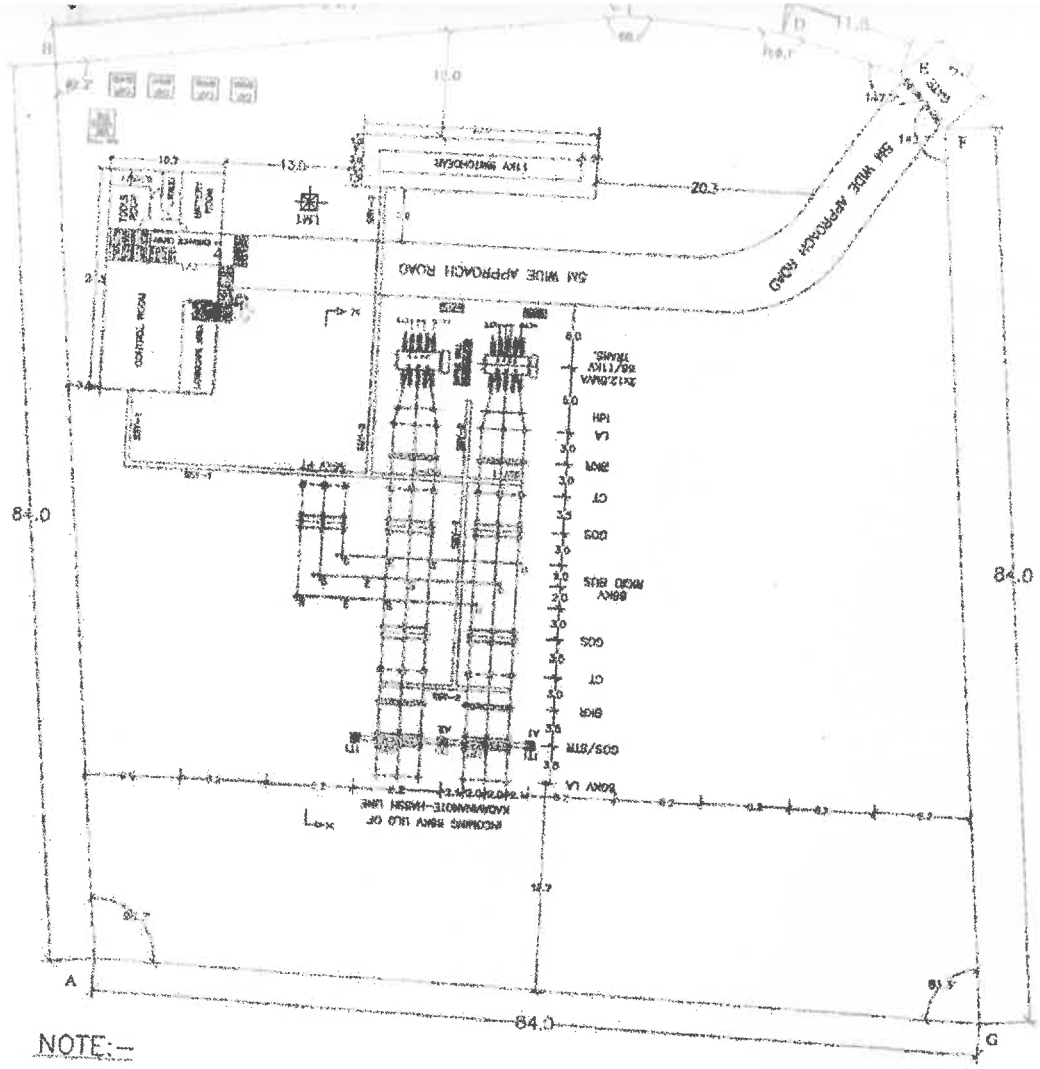

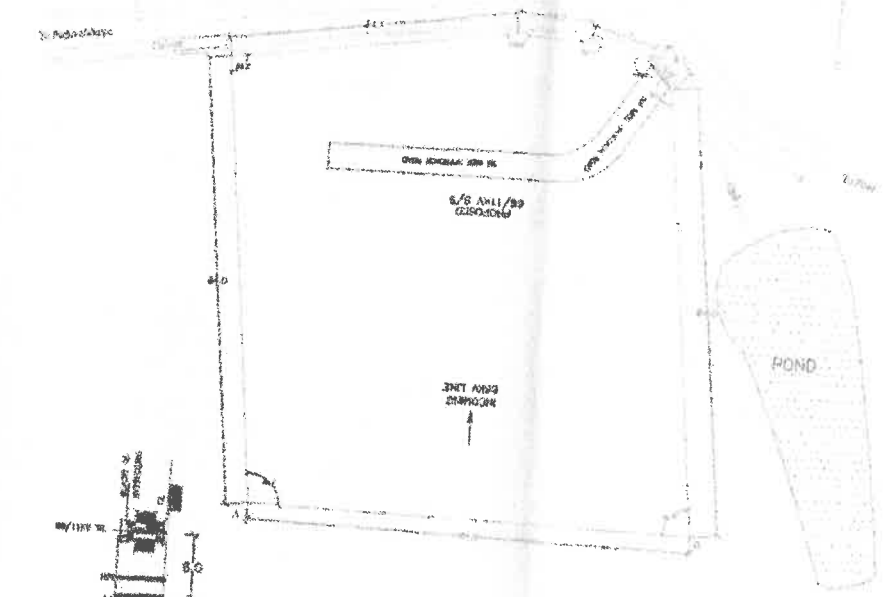

SITE PLAN

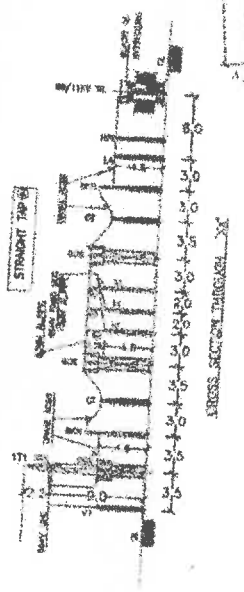

NOTE:—

1. ALL DIMENSIONS ARE IN METERS.
2. THE 66KV SWITCHYARD WITH BOUNDARY 'ABCDEFGA' SHALL BE FIXED WITH RESPECT TO THE EXISTING ROAD LEVEL. THE CUTTING AND FILLING QUANTITIES SHALL BE FINALISED BASED ON RL FIXED.
3. LOCATION OF CAPACITOR BANK, LM AND AUX. TRANSFORMERS ARE INDICATIVE ONLY. HOWEVER EXACT LOCATION OF LM MAY BE FINALISED AT THE TIME OF ENGINEERING DRG APPROVAL.
4. RETAINING WALL MAY BE PROVIDED WHERE EVER NECESSARY ALONG THE BOUNDARY LINE.
5. SINCE THE PROPOSED SUB STATION LAND IS ADJACENT TO POND, PRECAUTIONARY MEASURES TO BE TAKEN FOR CONSTRUCTION OF SUB STATION BY ENSURING THE WATER SHALL NOT ENTER IN TO THE SUB STATION.

ಕರ್ನಾಟಕ ವಿದ್ಯುತ್ ಪ್ರಸರಣ ನಿಗಮ ನಿಯಮಿತ
KARNATAKA POWER TRANSMISSION CORPORATION LIMITED

LAY OUT DIAGRAM FOR THE PROPOSED 2X12.5MVA 66/11KV S/S AT PADUVALHIPPE IN HOLENARASIPURA TALUK, HASSAN DISTRICT

DRG NO.KPTCL/TECH/SS-66/1191-A DATE: 04.02.2026 SCALE: NTS SHEET NO: 1

A.E	A.E.E	E.E	S.E(TECH)	CEE (P&C)
DRN	CHD	SUB	REC	APPROVED

ಇ. ಸವಿವರ ಲೇಔಟ್ ಪ್ಲಾನ್ ಡ್ರಾಯಿಂಗ್ ಸಂಖ್ಯೆ: KPTCL/Tech/SS-66/1191-A, DATE-03.02.2026.