

# GENERAL TECHNICAL SPECIFICATIONS

## FOR ROAD /BRIDGE WORKS

Name of Work-

કામનું નામ

Construction of Kagvad Bypass Road (NP) Km.0/000 to 1/900 Ta.Jetpur, Dist.;  
Rajkot

## GENERAL TECHNICAL SPECIFICATIONS

### 1.0 General :

All Measurements shall be made in metric system. Different items of work shall be measured in accordance with the procedures set forth in relevant sections read in conjunction with General Conditions of contract. The same shall not however apply in the case of lump-sum items. All measurements and computations ; unless other wise indicated, shall be carried nearest to be following limits :

- (i) Length and breadth.....10mm
- (ii) Height, depth or thickness of earthwork,  
Sub-base, bases surfacing, and structural members.....5mm
- (iii) areas..... 0.01 Sq.Metre.
- (iii) Cubic contents.....0.01 Cubic Metre.

In recording dimensions of work the sequence of length, width and height or depth or thickness shall be followed.

### 2.0. Measurement of lead for Materials :

Where lead is specified in the contract for construction materials, the same shall be measured as described hereunder.

Lead shall be measured over the shortest practicable route and not the one actually taken and the decision of the Engineer-in-charge in this regards shall be taken as final. Distance up to and including 100 Metres shall be measured in units of 50 Metres, exceeding 100 metres but exceeding 1 Km. in units of 100 Metres, and exceeding 1 Km. in units of 500 Metres. The half and greater than half of the units shall be reckoned as one and less than half of the units ignored. In this regard, the source of the materials shall be divided into suitable blocks and for each block the distance from the centre of the block to the centre of placing pertaining to that block shall be taken as the lead distance.

### 3.0 Surface Regularity of sub grade and Pavement courses :

The surface regularity of completed sub-base courses and wearing surface in the longitudinal and transverse direction shall be within the tolerances indicated in Table below. The longitudinal profile shall be checked with a 3 Metre long straight edge, at the middle of each traffic lane along a line parallel to the centre line of the road. The transverse profile shall be checked with a set for three camber boards at intervals of 10 Metres.

PERMITTED TOLERANCES OF SUB REGULARITY FOR PAVEMENT COURSE.

Sr.	Type of construction	Longitudinal Profile with 3 Metre straight edge.					Cross Profile
		Maximum permissible undulation in mm	Maximum number of undulation permitted in any 300 m. length exceeding in				Maximum permissible variation from specified profile camber themplate mm
1	2	3	4	5	6	7	8
1	Earth sub grade	36	30	-	-	-	15
2	Granular/lime Cement stabilized sub base.	23	-	30	-	-	12
3	Water Bound Macadam with nominal size metal (20-50)mm	18	-	-	30	-	8
4	Semi Dense carpet @ @	15	-	-	-	20	6

**Notes:**

1. These are for machine laid surfaces. If laid manually, due to unavoidable reason, tolerance up to 50 percent above these values in the columns may be permitted. However, this relaxation does not apply to the values of maximum undulation for longitudinal and cross profiles mentioned in columns 3 and 8 in the table.

2. Surface evenness requirements in respect of both the longitudinal and profiles should be simultaneously satisfied.

3. **Rectification** : Where the surface irregularity of sub grade and the various pavement courses fall out side the specified tolerances, the contractor shall be liable to rectify these in the manner described below and to the satisfaction of the Engineer- in-Charge at this own cost.

(I) **Sub grade**; Where the surface in high, it shall be trimmed and suitably compacted. Where the same in low, the deficiency shall be corrected by adding frees material. The degree of compaction and the type of material to be used shall confirm to the specified requirements.

(ii) **Granular/Sub Base**: Same as at (i) above except that the degree of compaction and the type of material to be used shall conform to the specified requirements.

(iii) **Lime/Cement stabilized soil sub-Base**: For lime/ cement treated materials where the surface is high, the same shall be suitably trimmed while taking care that the material below is not disturbed due to this operation. However where the surface is low, the same shall be corrected as described here in below.

For cement treated material, when the time elapsed between detection of irregularity and the time of mixing of the material, is less than 2 hours, the surface shall be scarified to a depth of 50mm, supplemented with freshly mixed material as necessary and recomposed to the relevant specification. When this time is more than 2 hour, the full depth of the layer shall be removed from the pavement and replaced with fresh material, to specification. In either case, the area treated shall not be less than 5 Metres wide. This also applies to lime treated material except that the time criterion shall be 3 hours instead of 2 hours.

(iv) **Water Bound Macadam Base** : Where the surface is high or low, that top 75mm shall be scarified, reshaped with added material as necessary and re compacted. The area treated at a place shall not be less than 5 Metres long and 2 Metres wide.

(v) **Bituminous Construction** : For bituminous construction other than wearing course, where the surface is low, the deficiency shall be corrected by adding fresh material and re compaction to specifications, Where this surface is high, the full depth of the layer shall be removed and replaced with fresh material and compacted to specifications. For wearing course, where the surface is high or low, the full depth of the layer shall be removed and replaced with fresh material and compacted to specifications in all cases where the removal and replacement of a bituminous layer is involved, the area treated shall not be less than 5 Metre long and not less than 1 lane wide.

#### **4.0 Quality Control Test during Construction. :**

The materials supplied and the works carried out by the Contractor shall conform to the enclosed relevant specifications. For ensuring the requisite quality of construction, the materials and works shall be subjected to quality control test as described hereinafter, by the Engineer-in-charge. The testing frequencies set forth are the desirable minimum and the Engineer-in-charge shall have the full authority to carry out test as frequently as he may deem necessary to satisfy that the materials at work comply with the appropriated specification. Test procedures for the various quality control tests are indicated in the respective sections of the specification or for certain tests within this section. Where no specific testing procedure in mentioned, the test shall be carried out as per prevalent accepted engineering practice to the directions of the Engineer-in-charge.

#### **5.0 Tests of Earthwork foe Embankment Construction :**

##### **5.1 Borrow Materials:**

- (a) Sand content (IS: 2720 Part IV)  
Two test per 8000 Cubic Metres of soil.
- (b) Plasticity Test (IS: 2720 Part-V)  
Each type to be tested. Two tests per 8000 Cubic Metres of soil.
- (c) Density test (IS: 2720 part-VII)  
Each soil type to be tested. Two test per 8000 Cubic Metres of Soil.
- (d) Moisture Content Test (IS: 2720 Part-II)  
One test for every 250 Cubic Metres of soil.

## 5.2 Compaction Control :

Control shall be exercised by taking at least one measurement of density for each 1000 square Metres of compacted area, or closer as required to yield the maximum number of test results for evaluating day's work on statistical basis. The determination of density shall be accordance with IS: 2720 (Part XXVIII). Test locations shall be chosen only through random sampling techniques. Control shall be not being based on the result of any one test but on the mean value of set of 5-10 density determinations. The number of tests in one set of measurements shall be 5 as long as it is felt that sufficient control over borrow material and the method of compaction is being exercised. If considerable variations are observed between individual density results, the minimum number of tests in one set of measurement shall be increase to 10. The acceptance of work shall be subject to the condition that the mean dry density equals or exceeds the specified density and the standard deviation for any set of result is below 0.08 gm/cc. However for earthwork in shoulders and in top 500 mm portion of the embankment below the sub grade, at least one density measurement shall be taken for every 500 square Metres of the compacted area provided further that the number of the test in each set of measurement shall be at least 10. In other respects, the control shall be similar to that described earlier.

## 6. Following materials shall conform to the Indian Standards shown against them;

- |     |                                   |          |
|-----|-----------------------------------|----------|
| (1) | Cement                            | IS: 269  |
| (2) | Sand for masonry                  | IS: 2116 |
| (3) | Sand for concrete                 | IS: 383  |
| (4) | Course aggregate.                 | IS: 383  |
| (5) | Mild Steel.                       | IS: 432  |
| (6) | High yield strength deformed bars |          |
|     | (a) Hot Rolled.                   | IS: 1139 |
|     | (b) Cold Twisted.                 | IS: 1786 |

## 7. Barrel thickness of pipes of different class shall be under:

Sir No	Internal DiaMetre of pipes in MM	Barrel thickness (in mm)		
		NP1	NP2	NP3
1	80	25	25	-
2	100	25	25	-
3	150	25	25	-
4	250	25	25	-
5	300	30	30	-
6	350	32	32	75
7	400	32	32	75
8	450	35	35	75
9	500	-	35	75
10	600	-	40	80
11	700	-	40	80
12	800	-	45	90
13	900	-	50	100
14	1000	-	55	100
15	1100	-	60	115
16	1200	-	65	115

### **Special conditions for Bituminous surface work with use of Drum mix plant, paver finisher.**

1. The hot mix plant and accessories to be used for the work shall be in conformity with the specification prescribed vide Govt of India. Ministry of Transport Circular No. RQ/RMP/ 1613784 Dt. 1-1-87 The plant shall be equipped with all units and accessories as per latest IS 3066 / 1965, as amended from time to time. The contractor will have to modify their plants suitably within a period of six months from the date of issue of latest I.S. Specification of codes.
  2. The work of laying aggregate mixed with bitumen shall start on site of work only after 8.00 hours in the morning and continue up to 17.00 hours in winter season and up to 18.30 hours in summer No work shall be done except during the period mentioned above and also on Sundays and National holidays viz. 26th January, 15th August & 2nd October.
  3. Quantity of bituminous aggregate mix to be laid shall be restricted to 250 tones per day for 30/40 capacity plant and may be more or less depending upon the rated capacity of the plant.
  4. The work of laying asphalt mix shall start latest within 60 days from the date of issue for work order except when work is closed for few days due to breakdown of machinery and during such period the contractor has not shifted paver plant to any other paver work not carried out by the same plant and will be completed as per time limit. Reasons for delay in starting of work after 60 days shall result into sufficient cause for laying compensation for disproportionate progress. However, the period from 15th June to 15th October monsoon shall not be counted for the purpose of disproportionate progress and consequent cause for levy of compensation. The contractors shall commence the work of laying payment on or before the last date of the period. The contractors shall commence the work of laying pavement on or before the last date of the period mentioned above falling which he shall pay for every day that he shall delay the commencement of the work as above in accordance with clause 2 of the contract.
- કોન્ટ્રાક્ટર ૬૦ દિવસની અંદર કામ શરૂ કર્યા પછી ગોડુક કામ કરીને નીચે દર્શાવેલ સંજાગા. સિવાય કામ અર્ધરા મેકશે તો જે દિવસથી કામ અધુરું મુકે તે દિવસથી કામ શરૂ કરે ત્યાં સુધી રૂ. ૫૦૦/- લેખે વળતર વસુલ કરવામા આવશે.
- (૧) મશીનરી બ્રેકડાઉન થયેલ હોય અને તેટલા જ જુજ સમય પુરતુ કામ બંધ રહેલ હોય.
- (૨) મશીનરી બ્રેકડાઉન સમય દરમ્યાન પેવર પ્લાન્ટ પણ ત્યાથી ખસેડવામા આવેલ ન હોય અથવા ત. જ પ્લાન્ટ પ.વર થી અન્ય જગ્યાએ કામગીરી કરવામા આવી ન હોય.
5. The contractor shall invariably get the job mix formula for the mix approved by the Engineer in charge before starting the work.
  6. These special conditions shall be applicable to the specifications of all the items included in this contract where work is to be carried out with Hot mix plant and paver finisher.

### **SCHEDULE OF WORK TO BE EXECUTED SHALL BE AS UNDER**

#### **Time Limit:**

#### **Sr No Period**

#### **Description of items to be executed**

- |                                   |   |
|-----------------------------------|---|
| 1. Month..... Month               | 1. Collection of Materials on site  |
| 2. From month 2 to 4 month        | 2.Erection of Plant machinery as required   |
| 3. From Month..... to ..... month | 3.Laying of asphaltting work carpet & seal coat & flushing of sand over surface, side with filling with earth as required and directed. |

**ANNEXURE - 1**  
**TECHNICAL REQUIREMENTS OF HOT MIX PLANT**

Composition of plant : The hot mix plant shall conform generally to IS Specification No. IS 3066 / 1965 as amended from time to time and shall be equipped with the following arrangements :

- 1. Cold Aggregate Feeder :** The cold aggregate feeder shall have minimum three independent bins or compartment, each provided with accurate mechanical pre determined rate to the cold elevator or to some intermediate conveyor or directly into the dryer. The feeder shall provide for the adjustment of total and proportional feed and shall be capable of being locked in any setting.
- 2. Dryer :** The dryer shall be capable of continuously agitating the aggregates while heating to the desired temperature. At the discharge end of the dryer or any other suitable location, means shall be provided for ascertaining the temperature of the heated aggregate.
- 3. Screening Unit and Gradation Control :** The dried aggregate shall be screened into not less than three size. The plant shall include means for accurately proportioning each bin size of aggregate either by weight or volumetric measurement. When the gradation control is by volume, the unit shall include a feeder mounted under the compartment bins. Each bin shall have an accurately controlled, individual gate to form an orifice for proportioning the material drawn from each respective bin compartment. The orifice shall have mechanical adjustment and provided with a lock indicators shall be provided on each gate to show the opening in centiMetres.
- 4. Mixer Unit :** The plant shall include a mixer of an approved twin shaft pug mill type capable of producing a uniform mix. If not enclosed, the mixer box shall be equipped with a dust hood to prevent loss of fines.
- 5. Mineral filler supply Unit :** There shall be a independent arrangement to feed mineral filler directly into the pugmill. The hopper to bin for mineral filler shall provide for the adjustment to proportion the feed with the aggregate and bitumen feed and shall be capable of being locked in any setting.
- 6. Bitumen Heating:** A heating system for bitumen always with effective and positive control of temperature shall be provided, to maintain proper temperature and for allowing continuous circulation between storage tanks and proportioning units during the entire opening period. Suitable arrangements shall be provided for recording the temperature at the tank and in the circulation system.
- 7. Synchronization:** For synchronization of Aggregate. Bitumen and filler feeds satisfactory means shall be provided to afford positive inter- locking control between the flow of aggregates from the bins or compartment, flow of bitumen from the tank and flow the tank and flow of mineral filer.

# VISCOSITY GRADE BITUMEN

## **Brief Back Ground :**

Bitumen is a thermoplastic material and its stiffness is dependent on temperature. The temperature versus stiffness relationship of Bitumen is dependent on source of Crude and method of refining. Bureau of Indian Standards (BIS) first time introduced paving grade Bitumen specifications IS:79-1950 in the year 1950 based on penetration. Based on this classification, the Bitumen were classified into five grades : S35, S435, S65, S90 & S-200.

BIS first revised the IS : 73-1950 specifications in the year 1962 based on penetration. In IS : 73-1961 specifications only eight parameters were considered for specifications.

BIS revised IS : 73-1961 specification in year 1992 for waxy and non waxy crude based on penetration. In this revision, BIS introduced four additional qualification tests like penetration ratio, paraffin wax content, viscosity at 60 & 135 Degree C and retained penetration after thin film oven test. In case of non-waxy crude an additional grade S55 (50/60 penetration) was also introduced. However, in case of non-waxy crude only four grades A35, A55, A65 & A90 were specified.

To improve the quality of the Bitumen, BIS revised IS : 73-1992 specifications based on Viscosity grading (Viscosity at 60 Degree C) in July 2006. As per this specifications there are four grades VG-10, VG-20, VG-30 & VG-40. Few qualification tests like specific gravity, water content, ductility, loss on heating & Farass breaking point were removed from IS : 73-1992 specifications as these tests do not have any relationship either with the quality or performance of the Bitumen.

## **Introduction of Viscosity Grade Bitumen :**

India has embarked upon massive and unprecedented road construction & improvement programme involving huge investments. It has also to maintain a vast road network of over 33 lakh KM. The durability of the road surfaces depends largely on the type and quality of Bitumen used and quality control exercised in the production, transportation, mixing, laying and compaction.

Traditionally, we have been using Penetration Grade Bitumen in Bituminous mixes. The Bituminous surfacing was showing rutting at higher temperatures, cracking at lower temperatures and raveling due to fatigue. The life of Bituminous surfacing on National Highways varied from 3-4 years requiring frequent repairs and renewals. To achieve durable pavements, use of Modified Bitumen was introduced in late nineties. The cost of Modified Bitumen is about 30 to 40 per cent higher than the cost of Bitumen as well as the construction of pavement with Modified Bitumen requires higher level of care & quality control during the entire process right from production of Modified Bitumen to laying and compaction. The latest instruction is "**Viscosity Grade Paving Bitumen**" which is designed to take care of lowest temperature (responsible for cracking) and maximum temperature (responsible for rutting). The BIS has issued IS 73 specification for this type of Bitumen in July 2006. In view of the importance of Bitumen in road construction and maintenance, it is necessary that appropriate grade of Bitumen most suited for our environment are used and adequate quality control is exercised at each stage.

## **Viscosity Grading of Bitumen :**

Paving grade Bitumen's are categorized according to Viscosity (degree of fluidity) grading. The higher the grade, the stiffer the Bitumen. In Viscosity Grade, Viscosity tests are conducted at 60 degree C and 135 degree C, which represent the temperature of road surface during summer (hot climate, similar to northern parts of India) and mixing temperature respectively. The Penetration at 25 degree C, which is annual average pavement temperature, is also retained.

### **VG-10 BITUMEN :**

VG-10 is widely used in spraying applications such as surface dressing and paving in very cold climate in lieu of old 80/100 Penetration grade. It is also used to manufacture Bitumen Emulsion and Modified Bitumen products.

### **VG-20 BITUMEN :**

VG-20 is used for paving in cold climate & high altitude regions, for eg. Northern regions.

### **VG-30 BITUMEN :**

VG-30 is primarily used to construct extra heavy duty Bitumen pavements that need to endure substantial traffic loads. It can be used in lieu of 60/70 Penetration grade.

### **VG-40 BITUMEN :**

VG-40 is used in highly stressed areas such as intersections, near toll booths and truck parking lots in lieu of old 30/40 Penetration grade. Due to its higher Viscosity, stiffer Bitumen mixes can be produced to improve resistance to having and other problems associated with higher temperature and heavy traffic loads.

**TABLE : VISCOSITY GRADE (VG) BITUMEN SPECIFICATION AS PER IS 73:2006**

Characteristics	VG-10	VG-20	VG-30	VG-40
Absolute Viscosity, 60 degree C, poises, min	800	1600	2400	3200
Kinematics, Viscosity, 135 degree C, CST, min	250	300	350	400
Flash, point, C, min	220	220	220	220
Solubility in trichloroethylene, %, min	99.0	99.0	99.0	99.0
Penetration at 25 degree C	80-100	60-80	50-70	40-60
Softening point, C, min	40	45	47	50
<b>Tests on residue from thin film over test / RTFOT :</b>				
I. Viscosity ratio at 60 degree C , max	4.0	4.0	4.0	4.0
II. Ductility at 25 degree C, cm, min, after thin film over test	75	50	40	25

#### FREQUENTLY ASKED QUESTIONS

##### 1. What is the difference between Penetration & Viscosity Grade ?

Penetration Grade classifications based on the Penetration value (degree of hardness) (Test conditions : 25 degree C, 100 gm, 5 sec) while VG system is based on absolute Viscosity (degree of Flow Resistance) of the Bitumen samples measured in Poise (Test conditions : @ 60 degree C, 300 mm Hg vacuum). It also includes Kinematics Viscosity measured in cst @ 135 degree C.

##### 2. Benefits / advantages of VG Bitumen over Penetration Grade – explain.

- ◆ VG system is based on fundamental engineering paraMetre ( not empirical)
- ◆ Viscosity is measured at 60 degree C and 135 degree C, which takes care of both low and high temperature susceptibility of the binder, which is not possible with Penetration value @ 25 degree C. Hence, pavement engineers, contractors / consultants can have better understanding about the binder's performance in the field.
- ◆ Any two same Viscosity Grade Bitumen would give similar rutting performance in hot summer unlike Penetration Grade.
- ◆ Grater ease of handling to customers as Viscosity Value at two different temperatures (@ 60 degree C and @ 135 degree C) is available, which would enable users to measure accurate mixing and compaction temperatures.
- ◆ Minimum specified Kinematics Viscosity value @ 135 degree C helps to minimize the potential of tender mixes during construction.
- ◆ Viscosity Graded Bitumen's are suitable for a wide range of temperature; 25 degree C for raveling / fatigue cracking, 60 degree C for rutting and 135 degree C for construction (mixing and compaction).
- ◆ IS 73-2006 has only 7 tests to evaluate a sample compared to 14 tests in Penetration Grade system. This reduces time and cost of testing without sacrificing its quality.

##### 3. What are the limitations of Penetration Grade ?

- ◆ This gradation is based on an empirical test and not a fundamental test; it doesn't provide any relevance with field performance of the sample.
- ◆ Two samples having same Penetration value may show different behavior at high and low temperatures.
- ◆ No Bitumen Viscosity is available near Bitumen mixing and compaction temperatures for the guidance of end users.
- ◆ Penetration grading doesn't control the temperature susceptibility of Bitumen. Highly thermal susceptible Bitumen's are not desirable because they are soft at high service temperature and very stiff at low service temperature.
- ◆ It cannot be used effectively for Polymer modified Bitumen.

**4. Is VG Bitumen is the demand / requirement of users or the statutory bodies ? Why there is a need to shift from Penetration to Viscosity Grade Paving Bitumen ?**

Penetration test was developed in an era of significantly lower pavement loading. In the past, truck weights were less than 30 tons with tyre pressure at 75 PSI. Today truck weights yields a 40% increase in the stresses applied to the pavement and is further aggravated by heavy traffic and change in weather conditions. Therefore, to cope up with the change in conditions, there is a need to shift from Penetration to Viscosity Grade Paving Bitumen. Both user agencies and statutory bodies are enforcing suppliers to supply VG Bitumen.

**5. Pavement made of VG Bitumen has longer durability than Penetration Grade Bitumen and why ?**

The pavement made from VG Bitumen will have better performance, because Viscosity value measured at 60 degree C correlated well with rutting behavior and Viscosity value at 135 degree C gives sufficient idea about the mixing and compaction temperature and as a result pavement life is improved.

**6. Can we use VG 30 Bitumen in high temperature zones where the critical highway temperature is > 60 degree C ?**

Yes, VG 30 can be used in high temperature zones as it has good thermal susceptibility.

**7. Why there is a delay in introducing Viscosity Grade Bitumen in India despite declaring the spec by BIS in 2006.**

- ◆ For decades, Indian customers have been using Penetration Grade Bitumen, customers are yet to be educated fully about the new specification and its benefits. In India, Bitumen market is driven by customers to a large extent like any other market.
- ◆ Additionally, there are other typical issues like user agencies demand for Penetration Grade Bitumen to complete the existing contracts, simultaneous, production of two grades at refineries and associated technical, logistical, administrative issues, etc.

In view of above, there is a delay in introducing Viscosity Grade Bitumen in the market.

**8. Is VG Bitumen the ultimate solution for pavement failures ?**

VG Bitumen is not the ultimate solution; it is an initial step to understand the binder performance in the field. Inline with international trend (AASHTO M320-05 specification-Super pave performance grading is being followed by USA, Europe etc.), we need to move towards performance grading system to understand the pavement failure due to binders. It is obvious that pavement design also needs due consideration.

**9. Why minimum limit to absolute Viscosity @ 60 Deg C prescribed ? Is it ok to keep Min limit ?**

The Temperature of 60 degree C is the near maximum Bituminous pavement temperature on a hot summer day, when rutting is likely to occur. It is useful to determine the stiffness (in terms of absolute Viscosity) of Bitumen at 60 degree C so that we can specify its minimum stiffness to ensure adequate resistance to rutting during hot summer. Pavement rutting is the most prevalent problem in India.

**10. What is the relevance of Ductility Test @ 25 Deg C on residue of TFOT ?**

Thin film Oven Test (TFOT) is nothing but the simulation of aging condition during mixing and compaction. If material shows good ductile characteristics after TFOT, it implies that binder can be laid nicely on the road and will not age (deteriorate) much during mixing and compaction.

**11. Number of tests for VG Bitumen is less than Penetration Grade, how this would assure / control quality of Bitumen.**

Some of the tests given in old Penetration Grade specification are the repetition of checking one parameter by different methods and some are redundant. For e.g. ductility measurement before and after TFOT. Ductility measurement after TFOT itself ensures the ductile property; there is no need to check it before TFOT. Penetration ratio, paraffin wax content and fraass breaking point tests are redundant as these properties have been taken care in new Viscosity Grade specifications.

**12. Do we have ready-made chart to use various Bitumen Grades as per the temperature zones ?**

Ideally, selection of Bitumen Grade should be based on high and low pavement. temperatures (climatic conditions). For practical consideration, selections need to be based on air temperatures, Weather data can be obtained from IMO (Indian Meteorological Organization) for the purpose of understanding region wise requirement of binder grades. Selection criteria for VG paving Bitumen based on climatic conditions is tabulated below :

S.No.	Lowest Daily Mean Air Temperature, C	< 25 Deg. C	20 to 30 Deg. C	> 30 Deg. C
1.	More than -10 Deg. C	VG-10	VG-20	VG-30
2.	- 10 Deg. C or lower	VG-10	VG-10	VG-20

**13. What is the effect of using VG-10 Bitumen in hot climate areas ? What is the right grade to be used in this area ?**

Due to high temperature in hot climatic areas, use of VG-10 would not provide good rutting resistance. Based on the highest daily mean air temperature which good rutting resistance. Based on the highest daily mean air temperature which generally ranges from 30 to 44 Deg. C, VG-30 Bitumen can be used in this area.

**14. Is there any difference in process for manufacturing VG Bitumen over Penetration Grade ?**

Yes, process parameters needs to be modified to produce VG Bitumen. It is produced by blowing Bitumen with air.

**15. How to measure Viscosity at 60 Deg. C ? What type of equipments and which manufactures do you recommend ?**

A vacuum capillary tube viscometre is used to perform the Viscosity test at 60 Deg. C. Viscosity test equipment consists of i.e Calibrated cannon-Manning Viscosity tube, ii. Oil bath maintained at 60 Deg. C, iii. Vacuum pump and iv. Vacuum gauge, controller, thermometer, stop watch. Viscosity tube to be imported through Indian distributor and remaining items are easily available in India. Generally Cannon Manning vacuum capillary viscometre, Cannon fenske viscometre and brook field viscometre are used to measure the Viscosity.

Ref :

- (1) Ministry of Shipping, Road Transport & Highway, Govt. of India letter No. RW/NH-33041/3/2001 S & R (R) Vol. III Dt.4/8/08.
- (2) Ministry of Shipping, Road Transport & Highway, Govt. of India letter No. RW/NH-33041/3/2001 S & R (R) Vol. III Dt.4/2/09.
- (3) Indian Oil Corporation Ltd. letter dated 27/7/09.

## **Item No. 1**

**Clearing and grubbing of road land incl. uprooting rank vegetation, grass, bushes, shrubs, saplings and trees girth upto 300mm removal of stumps of trees cut earlier and disposal of unserviceable materials © By mechanical means in area of Light jungle.**

### **201. CLEARING AND GRUBBING**

#### **201.1. Scope**

Clearing and grubbing shall be performed less than one month in advance of earthwork operations and shall consist of cutting, trimming, removing and disposing of all materials such as trees, tree branches, bushes, shrubs, stumps roots, grass, weeds, anthills, jungle top organic soil not exceeding 150 mm in thickness, rubbish, loose stones, boulders, etc. which are undesirable and unsuitable for use in the works, from the designated area of road land, embankment slopes, drains, cross-drainage structures and such other areas as specified on the drawings or from areas as directed by the Engineer. It shall include grubbing, necessary excavation, backfilling of pits resulting from uprooting of trees and stumps to required compaction, handling, salvaging, removal and disposal of cleared materials in accordance with the requirements of these Specifications.

Reclearing of the site of any vegetation, grass shrubs before commencement of work shall be carried out as directed by the Engineer and shall be incidental to the work of clearing and grubbing.

#### **201.2. Preservation of Property / Amenities**

Roadside trees, shrubs, any other plants, pole lines, fences, signs, monuments, buildings, pipelines, sewers and all highway facilities within or adjacent to the road which are not to be disturbed shall be protected from injury or damage by providing and installing suitable safeguards as shown in the drawing or as approved by the Engineer.

During clearing and grubbing the Contractor shall take all adequate precautions for preservation of all vegetation adjacent to road land against soil erosion, water pollution, etc. and where required, shall undertake additional works to that effect. Before start of operations, the Contractor shall submit to the Engineer for approval, his work plan including the procedure to be followed for disposal of waste materials, etc. and the schedule for carrying out additional work where required.

#### **201.3. Conservation of Top-soil**

The top-soil removed during clearing and grubbing of site, if suitable for re-use shall be transported, conserved and stacked as directed by the Engineer. This shall be incidental to the work.

#### **201.4. Methods, Tools and Equipments**

Only such methods, tools and equipment as are approved by the Engineer shall be adopted for the work. If the area has thick vegetation/roots/trees, a crawler or dozer shall be used for clearance purposes. All trees, stumps, etc. falling within excavation and fill line shall be cut to such depth below ground level that in no case these fall within 500 mm of the sub grade. Also, all vegetation such as roots, under-growth, grass and other deleterious matter unsuitable for re-use in the embankment/sub grade shall be removed between fill lines to the satisfaction of the Engineer. On areas beyond these clearing limits trees and stumps required to be removed shall be cut down to 500 mm below ground level so that these do not present an unsightly appearance.

All branches of trees extending above the roadway shall be cut or trimmed so as to provide a clear height of 5 m above the road surface and shoulders.

All excavations below the general ground level arising out of the removal of trees, stumps etc. shall be filled with material conforming to prescribed requirements and compacted to specified density, given by the Engineer.

#### **201.5. Removal of Ant-hills**

Ant-hills both above and below the ground, as are liable to collapse and obstruct free subsoil water flow shall be removed by excavating to a suitable depth as directed by the Engineer. The excavated ant-hills material shall be carted away from the site. Cavities in the ground due to removal of ant-hills shall be filled with approved material and compacted to specified densities, as directed by the Engineer.

#### **201.6 Disposal of Materials**

All materials including trees, stumps, etc. arising from clearing and grubbing operations shall be the property of Government and shall be disposed off by the Contractor as here-in-after provided or as directed by the Engineer.

Trunks, branches and stumps of trees shall be cleaned of limbs and roots and stacked. Also boulders, stones and other materials usable in road construction shall be neatly stacked as directed by the Engineer. Stacking of stumps, boulders, stones etc. shall be done at specified spots with all lifts and upto a lead of 1000 m.

All products of clearing and grubbing which cannot be used or auctioned shall be cleared away from the roadside in a manner as directed by the Engineer. Care shall be taken to see that unsuitable waste materials are disposed off in such a manner that there is no likelihood of these getting mixed up with the materials meant for embankment, sub grade and road construction or cause undesirable environmental conditions.

#### **201.7. Measurements for Payment**

Clearing and grubbing for road embankment, drains and cross-drainage structures shall be measured on area basis in terms of hectares. Clearing and grubbing of borrow areas shall be incidental to embankment construction and the rates quoted for the embankment construction shall be inclusive of it.

Cutting of trees upto 300 mm in girth including removal of stumps and roots, and cutting/trimming of branches of trees extending above the roadway shall be considered incidental to the clearing and grubbing operations. Removal of stumps of trees upto 300 mm girth left over after trees have been cut by any other agency of the Contractor or Government shall also be considered incidental to the clearing and grubbing operations.

Cutting, including removal of stumps and roots of trees of girth above 300 mm and backfilling to required compaction and removal of stems and roots of trees of girth above 300 mm diaMetre left over after trees have been cut by any other agency or the government shall be measured in terms of number according to the sizes given below:

- (i) Above 300 mm to 600 mm

- (ii) Above 600 mm to 900 mm
- (iii) Above 900 mm to 1800 mm
- (iv) Above 1800 mm to 2700 mm
- (v) Above 2700 mm to 4500 mm
- (vi) Above 4500 mm

For this purpose, the girth shall be measured at a height of 1 m above ground or at the top of the stump, if the height of the stump is less than 1 m from the ground.

Where the proposed work site passes through dense forest area, clearing and grubbing including cutting of trees of all girths and removal of their roots and stumps, etc. for construction of road embankment, drains and cross-drainage structures shall be measured on area basis.

### **201.8 Acceptance**

Acceptance of clearing and grubbing shall be based on visual inspection of the work for compliance with the above specifications to the satisfaction of the Engineer.

### **201.9 Rate**

**201.9.1.** The Contract unit rates for the various items of clearing and grubbing shall be paid/payable in full for carrying out the required operations including full compensation for all labour, materials, tools, equipment and incidentals necessary to complete the work. These will also include removal of stumps and roots of trees less than 300 mm in girth as well as stumps left over after cutting of trees carried out by another agency of the Contractor or Government, excavation and backfilling to required density, where necessary, and handling, salvaging, piling and disposing of the cleared materials with all lifts and upto a lead of 1000 m.

**201.9.2.** The Contract unit rate for cutting (including removal of stumps and roots) of trees of girth above 300 mm and removal of stems and roots of trees of girth above 300 mm left over after trees have been cut by any other agency or the government shall include excavation and backfilling to required compaction, handling, salvaging, piling and disposing of the cleared materials with all lifts and upto a lead of 1000 m as directed by the Engineer.

**201.9.3.** Where a Contract does not include separate items of clearing and grubbing, the same shall be considered incidental to the earthwork items and the Contract unit prices for the same shall be considered as including clearing and grubbing operations.

## **Item No.2**

**Earthwork for embankment including breaking clods, dressing with all lead and lift (Excluding watering and consolidation) (A) Selected soil should be From borrow area with all lead and lift and should have CBR not less than 6.00 %.**

1. The land width on which the earth work is to be done shall be cleared of all trees having a girth of 30cm and loss, loose stones, vegetation, bushes, stumps and all other objectionable materials. All the materials cleared will be the property of Government. Useful material shall be arranged in convenient stack the road boundary or as directed at places within 50 Metres lead, and handed over to the department in convenient section. Unsuitable material shall be burnt or otherwise disposed off by the contractor at own cost without causing any nuisance inconvenience or damage to the works property or people in the neighborhood. In all cases the materials shall be disposed off in a neat manner.

2. After cleaning the site, the alignment of the road shall be properly set out true to line, curves, slopes grade and sections as shown on then plan or directed by the Engineer-in-charge. The contractor shall provide all labors and materials such as lime, string, pegs, nails, bamboos, stones, mortar, concrete etc. Required for setting out, establishing. Bench Marks and giving profiles. The contractor shall be responsible for maintaining the B.M.S. profiles alignment and other marks long they are required for the work in the opinion of the Engineer-in-charge. If the contractor defaults in this respect they may be restored by the department at the cost of the contractor.

3. When an existing embankment is to be widened, continuous, horizontal benches, each at least 0.3 Metre wide shall be cut into the existing slope for ensuring adequate bond with the fresh embankment materials to be added. The material obtained from the cutting of benches can be utilized in the widening of the embankment. The dumping of material from trucks for widening operation shall be avoided except in difficult circumstances when the extra width is too narrow to permit the movement of any other type of hauling equipment.

4. The soil to be used for embankment shall be free from trees, stumps, root, rubbish or any other objectionable materials. Only materials considered suitable by the Engineer-in-charge shall be used for the construction and that considered unsuitable shall be disposed off as directed by him. The selection of materials to be used in the construction of embankment shall be made after soil survey and investigations are carried out by the Department. The embankment shall consist of earth available from road-side borrow pits on either side with all lead and lifts. And within land width in the manner specified in Para 11. Below. The road, if any required for the purpose of haulage of earth by men, animals or vehicles will be constructed. (If not existing) and maintained by the contractor at his own cost.

5. Department is extended all necessary co-operations in helping contractor to get borrow from near by Government or Panchayat land, if available. However department is not responsible if not such area is made available to the contractor and in the case, contractor will have to make his own arrangement to get borrow area for borrowing earth of the quantity even by making temporary arrangement with the private land owners.

6. The Embankment shall be constructed in uniform layer not exceeding 250mm in loose thickness. The soil shall be spread uniformly over the entire width of the embankment unless otherwise directed by the Engineer-in-charge. All clods of hard lumps of earth shall be broken to have maximum size of 15 cm. When being placed in the embankment a maximum of size 5 cm when being placed in the top 45 cm. of embankment. The work of next layer shall be allowed only after the first layer has been thoroughly compacted.

7. Where an embankment is to be placed on sloping ground shall be balanced in the step of trenches of broken up in such a manner that the new material shall have perfect bond with the existing surface. Where the embankment is to be placed over an existing road surface, the surface shall be scarified to minimum depth of a 5 cm. so as to provide ample bond between the old and new material. However when the embankment is to be placed over and old concrete pavement and lies within 1 Metre of new sub grade level, the pavement shall be broken up in pieces not to exceed 0.1 m and may be Metre of new sub grade left under

the new embankment. If the existing road surface is of granular or bituminous type and lies within 1 mt. of the new sub grade level, the same shall be scarified to a depth of minimum 50mm. so as to provide ample bond between the old and the new material.

8. To avoid interference with contraction of abutment, wing walls or return walls of culvert/bridge structures, the contractor shall at point to be determined by the Engineer-in-charge, suspend work on embankment forming approaches to such structures, until such time as the construction of the latter is sufficiently advanced to permit the completion of approaches without the risk of interference of damage to the bridge work, unless directed otherwise the filling around culverts, bridge and other structures upto a distance of twice the height of the embankment from the back of the embankment shall be carried out independent of the work on the main embankment. The fill material shall not be placed against any abutment or wing wall unless permission has been given by the Engineer-in-charge but in any case not until the concrete or masonry has been in position for 14 days, the embankment shall be brought up simultaneously in equal layer on each side of the structure to avoid displacement and unequal pressure. The sequence of work in this regard shall be got approved from the Engineer-in-charge. Where the provision of any filter medium is specified behind the abutment, the same shall be laid in layers with the laying of fill material. The material used for the filter shall conform to the requirements for filter medium and will be paid extra in the relevant item.

9. The embankment shall be finished in conformity with the alignment, level, cross section and dimensions shown on the plans or as directed by the Engineer-in-charge. Where the alignment of the road is in a curve, the top of the embankment shall be formed with the super elevation and the increased width shown on the drawing or as the Engineer-in-charge may direct. Finishing operation shall include the work of shaping and dressing the shoulder, road bed and the slopes to conform to the cross section.

10. The earthwork measurement shall be paid on cross sectional measurements and computing the volumes of earth work in cubic metres by average area method. The contractor shall sign day to day leveling work and also original cross sections, longitudinal section etc. in token of his acceptance. The working section both longitudinal and cross of the ground shall be taken by the Engineer-in-charge before the actual work has started. The contractor or his authorized representative shall attend day to day leveling work and sign with date the field book daily, in token of his acceptance, if there is any disagreement, the contractor shall inform of it in writing to the officer concerned with specific reference to the sections before starting further work. Once the work is started, no cognizance of any complaint will be taken merely not signing to level book shall not be deemed as disagreement. The Executive Engineer shall also verify leveling work to the extent of 5% before commencement of earth work and on finalization. The contractor shall maintain the embankment by filling in ruts, rain cuts, depression due to shrinkage etc. to proper formation and grade till this item is finally measured and accepted by the Department. The measurements shall be on compacted earth work. Deduction of 15% for shrinkage shall be made from gross measured quantity if measured before first monsoon and 10% if measured after one or more monsoon have been passed over the earth embankment. However the contractor shall have to bear loss of deformation etc. If any due to all settlements as well as other type of deformation etc. if any, that might have taken place at the time of taking measured of the item.

11. If usable approved material is available within the land width of road, the same shall be permitted for used in the road embankment subject to the following conditions:-

- (i) The borrow pits will be so excavated as to form a road side longitudinal gutter to drain the water, interrupted by such gutter.
- (ii) The width of the drain shall be restricted to 1.5mts. only the depth will be restricted to such grade so as to drain the water efficiently. All balance quantity of earth shall be brought from distant borrow areas only.
- (iii) If there is top layer of black cotton or other objectionable soils, the same shall be removed and disposed off elsewhere and usable material found at the lower level will only be used in the earthen embankment, if the contractor choose to utilize this material.

- (iv) the drain should be aligned along the boundry of the land width of the road. Not pit, other than this drain shall be dug within 5 metres of the toe to the final section of the road embankment.
- (v) No borrow pits shall be allowed in the length in which earth obtained for cutting from cutting is specified to be used in embankment.

12 The rate of earthwork includes cleaning jungles, dog belling fixing profiles, erecting necessary pillars or stones for bench mark for leveling purpose, excavating earth from borrow pits, bracking clods, conveying and spreading earth in layers with all lead and lift, finishing the entire embankment and incidentals necessary to complete the work to the specifications. The cutting stuff of cutting in ordinary soil, soft murrum, soft rock, hard murrum and hard rock shall utilised in embankment costruction under this item within the lead specified in the particulars item. No Payment shall be made under this item for the cutting stuff used in embankment but labour for cutting will be paid as per specifications in the particulars item, and only balance quantity of earthwork from borrow areas will be pain in this item.

### **Item No.3**

**Earthwork in cutting in all sorts of soil and soft Murrum including conveying and spreading the suff embankment as and where directed within 200 meters from the end of the cutting with all required lead and lift.**

1. The land width required for the roadway gutter side slopes and catch water gutters shall be cleared of all trees having a girth of 30 cms. and less loose stones. vegetation bushes stumps and all other objectionable materials. The roots of trees and stumps shall be removed to a depth of 30 cms below the grade information and slopes and excavation filled up with excavated materials and compacted. All the materials cleared will be the property of Government. Useful materials shall be arranged in convenient stuacks along the road boundary or a directed as places within 50 mts. lead, and handed over to the department in convenient sections. Unsuitable material shall be burnt or otherwise disposed off by the contractor at his own cost without causing any nuisance, inconvenience or damage to the work, property or people in the neighborhood. If the contractor and royalty etc. If any paid by him without claiming compensations. In all cases, the materials shall be disposed of in a neat manner.

2. After cearing the site, the alignment of the road shall be properly set out true to lines, curves slope, grades and section as shown on the plans or directed by the Engineer in charge. The contractor shall provide all labour and establishing bench marks and giving profiles. The contractor shall beresponsible for maintaning the B.Ms profiles alignments and other stakes and marks as long as then are required for the work in the opinion of the Engineer, If the contractor defaults in this respet even after the direction by the Engineer within the specified time, they may be resored by the Engineer at the levels etc. If there is any disagreement the contractor shall inform of it in writing to the Officer concerned with the specific reference to the sections before starting futher work. Once the work has started, no cognizance of any complaint shall be taken Merely not signing of the book shall not be deemed as disagreement.

3. Profiles of the section including the road side gutters to be excavated shall be laid at suitable intervals of 10m to 50 m or other intervals as directed by Engineer to conform to the curved or straight alignment, sections grades and used shall be set up with the toe line marked on each side. The road way section shall first be excavated with vertical side for each lift and the sides slopes for that lift shall be excavated in steps. These steps shall be smoothened to the required slope when the excavation reaches the road formation. The contractor shall on no account excavate beyond the slopes or below the specified grade unless so directed by the Engineer in writing. If excavation is done below the specified level or out side the section, it shall not be paid for and the contractor shall be required to fill up at his won cost such extra excavation in the road portion, with approved materials of the embankment grade in layers, watered and fully compacted to attain maximum density laid down for the embankment in its relevant item. The Engineer may require measurement ridges and dead man to be left at specified intervals or places and kept intact till order to be removed for the purpose to check measurements. The excavation shall be finished neatly smoothly and evenly to the correct lines, curves, grades. If loose shall be scarified, watered and compacted to the same density as the embankment, The section side slopes and catch water gutter shall be maintained by the contractor at his own cost in such a way that the formation and gutters will be drained by providing for necessary idversions etc. and not darnaged due to obstruction of any drainage, Necessary passages shall

be provided for leading away seepage, spring, surface flow or rainwater safely without damaging the work. If any damage occurs due to default of the contractor in this respect he shall make good the damage at his own cost. If it is necessary in the execution of the work to interrupt existing surface drainage, irrigation channels, sewers or under drainage, temporary arrangements shall be provided till such time as is necessary. The contractor at his own cost shall make the existing work or work in hand caused as a result of his operations or negligence shall be made good by the contractor at his own cost. Road side gutters shall be excavated to the specified sections and shall be measured along with the main cutting in cubic Metres.

4. If slides occur in the cutting they shall be removed as ordered by the Engineer. If finished slopes slide into the roadways before the final acceptance of the work. Such slides shall be removed by the contractor and shall be paid for at the contract rate for the class of excavation involved provided the slides are not due to any negligence of the contractor. The classification of the material in slides shall conform to its conditions at the time of removal and payment made accordingly regardless of its prior condition. Care shall be taken to see that excavation is arranged in a safe way so that there will be no risk to the workmen by falling materials, boulders and collapsing sides etc.

5. If there is traffic nearby or if there are towns and villages in the neighborhood, barricades and or traffic, signals shall be provided day and night for the duration of the work in such a way as to prevent accidents. Warning signals shall be displayed at 7mt. from the danger point on both sides giving sufficient warning. If necessary, signalers shall be stationed at each end to regulate traffic where it is heavy. Measures shall be taken to see that the excavation does not affect or damage adjoining structures or property. If there is damage to property, injury to workers, the members of the public, animals etc., due to the negligence of the contractor, he will be responsible and liable to all the consequences including compensation.

6. All the excavated materials shall be property of Govt. When the useful excavated material is to be used in embankment within a lead of 200 metre and all lift, it shall be directly deposited at the required location in specified layers. No handling or conveyance charges shall be paid if the material is temporarily deposited elsewhere and the drainage in any way. If no Govt. land is available but the excavated useful stuff is to be stacked temporarily before use under the same agreement, the contractor shall make his own arrangements for the stacking of this material not required for use on embankment or unsuitable materials may be used on his own to uniformly widen embankment to flatten slopes and to fill low places in the road land, if so permitted by the Engineer. Material not required for any use whatsoever may be disposed of by the contractor at his own cost in manner approved by the Engineer. The excavated material shall not be deposited within 3 m. from the top edge of slope or toe of the bank. The lead shall be measured from the junction point of cutting and embankment up to 200 mt. on either side.

7. If the contractor does not wish to utilise the quantity of cutting within the specified lead for any reason, then he may do the embankment work with the earth from other sources (except borrow pits in the length of the road where cutting stuff is to be utilized) but in that case the full or part quantity of acceptable quality stuff for which payment is made or to be made will be deducted from the net quantity of the earth work in the embankment arrived at, within the chainage measured as above.

8. The contract rate shall be a unit of one cubic metre for the work mentioned in the wording of the item of excavation acceptably completed. limited to the dimensions shown on the plans or as directed by the Engineer. Excavation shall be measured in its original positions by taking cross sections before the work starts and after it is entirely completed. The quantity shall be worked by the average end area method. When the classification of the strata changes, the contractor shall bring this to notice of the Engineer, who will then verify and if necessary take levels for the changed strata for purpose of measurement.

(b) In spoil Bank : Specification shall be as per Item 2(a) except that the excavated stuff shall be deposited in spoil Bank instead of using same in road embankment.

## Item No.4

**Granular Sub-base with Black trap crushed stone well Graded Material (Table.400.1) by Mix in place Method. Construction of Granular Sub-base by Providing Black Trap cruhsed stone well greded material, spreading in uniform layers with motor graded on prepared surface, mixing by mix in place method with rotavator at OMC, and compacting with Vibratory roller to achieve the desired density, complete as per Technical Specification Clause-401. For Grading-1 Materials**

### 401. GERANULAR SUB-BASE

#### 401.1. Scope

This work shall consist of laying and compacting well-graded material on prepared subgrade in accordance with the requirements of these Specifications. The material shall be laid in one or more layers as sub-base or lower sub-base and upper sub-base (termed as sub-base here-in-after) as necessary according to lines, grades and cross-sections shown on the drawings or as directed by the Engineer.

#### 401.2. Materials

**401.2.1.** The material to be used for the work shall be natural sand, gravel, crushed stone, depending upon the grading required. The material shall be free from organic or other deleterious constituents and conform to one of the three gradings given in Table 400.1. The grading to be adopted for a project shall be as specified in the Contract.

**TABLE 400.1 : GRADING FOR GRANULAR SUB-BASE MATERIALS**

IS Sieve Designation	Per cent by Weight Passing the IS Sieve		
	Grading I	Grading II	Grading III
75.0 mm	100	-	-
53.0 mm	-	100	-
26.5 mm	55-75	50-80	100
9.50 mm	-	-	-
4.75 mm	10-30	15-35	25-45
2.36 mm	-	-	-
0.425 mm	-	-	-
0.075 mm	<10	<10	<10

Notes: (1) The material passing 425 micron (0.425 mm) sieve for all the three gradings when tested according to IS:2720 (Part 5) shall have liquid limit and plasticity index not more than 25 and 6 per cent respectively.

(2) On clayey subgrades, the per cent passing IS Sieve 0.075 mm shall not exceed 5.

#### 401.3. Strength of Sub-base

When directed by the Engineer, this shall be verified by performing CBR tests in the laboratory as required on specimens remoulded at field dry density and moisture content and any other tests for the “quality” of materials, as may be necessary.

#### **401.4. Construction Operations**

**401.4.1. Preparation of subgrade:** Immediately, prior to the laying of sub-base, the subgrade already finished to Clause 303 shall be prepared by removing all vegetation and other extraneous matter, lightly sprinkled with water if necessary and rolled with two passes of 80-100 kN smooth wheeled roller.

The sequence of construction operations shall be such that the construction of granular subbase layer shall match the construction of the adjoining layer in the shoulders, as per Clause 407.4.1.

**401.4.2. Spreading and compacting:** The sub-base material of grading specified in the Contract shall be spread on the prepared subgrade with the help of suitable tractor-towed appliances, for maintaining the required slope and grade during the operation or other means as approved by the Engineer.

When the sub-base material consists of combination of materials mentioned in Clause 401.2.1, mixing shall be done mechanically by the mix-in-place method or by an approved mixing plant.

Manual mixing shall be permitted only where the width of laying is not adequate for mechanical operations, as in small-sized jobs. The equipment used for mix-in-place construction shall be a tractor-towed rotavator or similar approved equipment capable of mixing the material to the desired degree. If so desired by the Engineer, trial runs with the equipment shall be carried out to establish its suitability for the work.

Moisture content of the loose material shall be checked in accordance with IS:2720 (Part 2) and suitably adjusted by sprinkling additional water from a truck mounted or trailer mounted water tank and suitable for applying water uniformly and at controlled quantities to variable widths of surface or other means approved by the Engineer so that, at the time of compaction, it is from 1 per cent above to 2 per cent below the optimum moisture content corresponding to IS:2720 (Part 7). While adding water, due allowance shall be made for evaporation losses. After water has been added, the material shall be processed by mechanical or other approved means, like, tractor-towed disc harrows, rotavators until the layer is uniformly wet.

Immediately thereafter, rolling shall start. If the thickness of the compacted layer does not exceed 100 mm, a smooth wheeled roller of 80 to 100 kN weight may be used. For a compacted single layer upto 225 mm the compaction shall be done with the help of a vibratory roller of minimum 80 to 100 kN static weight. Rolling shall commence at the lower edge and proceed towards the upper edge longitudinally for portions having unidirectional crossfall and superelevation and shall commence at the edges and progress towards the centre for portions having crossfall on both sides.

Each pass of the roller shall uniformly overlap not less than one-third of the track made in the preceding pass. During rolling, the grade and crossfall (camber) shall be checked, with the help of templates and straight edge, and any high spots or depressions, which become apparent, corrected by removing or adding fresh material. The speed of the roller shall not exceed 5 km per hour.

Rolling shall be continued till the density achieved is atleast 100 per cent of the maximum dry density for the material determined as per IS:2720 (Part 7). The surface of any layer of material on completion of compaction shall be well closed, free from movement under compaction equipment and from

compaction planes, ridges, cracks or loose material. All loose, segregated or otherwise defective areas shall be made good to the full thickness of layer and re-compacted.

#### **401.5. Aggregate Plugs**

When the granular sub-base is extended over the full formation, as shown on the drawings, the exposed edges shall be protected with suitable aggregate plugs, 200 to 300 mm wide, as specified on the drawings.

#### **401.6. Surface Finish and Quality Control of Work**

The surface finish of construction shall conform to the requirements of Clause 1802.

Control on the quality of materials and works shall be exercised by the Engineer in accordance with Section 1800.

#### **401.7. Arrangements for Traffic**

During the period of construction, arrangement of traffic shall be maintained in accordance with Clause 111.

#### **401.8. Measurements for Payment**

##### **Granular sub-base shall be measured as finished work in position in cubic metres.**

The protection of edges of granular sub-base extended over the full formation as shown in the drawing shall be considered incidental to the work of providing granular sub-base and as such no extra payment shall be made for the same.

#### **401.9. Rate**

The Contract unit rate for granular sub-base shall be payment in full for carrying out the required operations including full compensation for:

- (i) making arrangements for traffic to Clause 111 except for initial treatment to verges, shoulders and construction of diversions;
- (ii) furnishing all materials to be incorporated in the work including all royalties, fees, rents where necessary and all leads and lifts;
- (iii) all labour, tools, equipment and incidentals to complete the work to the Specifications;
- (iv) carrying out the work in part widths of road where directed; and
- (v) carrying out the required tests for quality control.

### **Item No.5**

#### **WBM Grading-1**

**Providing, laying, spreading and compacting stone agg. Of 90mm to 45mm size to water bound macadam specification including spreading in uniform thickness, hand packing, rolling with smooth wheel roller 80-100 KN in stage to proper grade and camber, applying and brooming, stone screening/binding material to fill-up the intersties of coarse agg., watering and compacting to the required density grading-1 as per Technical Specification Clause.405 By manual means..**

## And Item No.6

### WBM Grading-2

Providing, laying, spreading and compacting stone agg. Of 63mm to 45mm size to water bound macadam specification including spreading in uniform thickness, hand packing, rolling with smooth wheel roller 80-100 KN in stage to proper grade and camber, applying and brooming, stone screening/binding material to fill-up the intersties of coarse agg., watering and compacting to the required density grading-2 as per Technical Specification Clause.405 By manual means..

### 405. WATER BOUND MACADAM SUB-BASE/BASE/SURFACING

#### 405.1. Scope

**405.1.1.** This work shall consist of clean, crushed aggregates mechanically interlocked by rolling and bonding together with screening, binding material where necessary, and water laid on a properly prepared subgrade-sub-base/base or existing pavement, as the case may be and finished in accordance with the requirements of these Specifications and in close conformity with the lines, grades, cross-sections and thickness as per approved plans or as directed by the Engineer.

#### 405.2. Materials

**405.2.1. Coarse aggregates:** Coarse aggregates shall be either crushed or broken stone, crushed slag, overburnt (Jhama) brick aggregates or any other naturally occurring aggregates, such as, kankar and laterite of suitable quality. Materials obtained from rocks, such as, Phyllites, Shales or Slates, etc. shall not be permitted in WBM construction. Materials other than crushed or broken stone and crushed slag shall be used in sub-base courses only. If crushed gravel/shingle is used, not less than 90 per cent by weight of the gravel/shingle pieces retained on 4.75 mm sieve shall have at least two fractured faces. The aggregates shall conform to the physical requirements set forth in Table 400.7. The type and size range of the aggregate shall be specified in the Contract or shall be as specified by the Engineer. If the water absorption value of the coarse aggregate is greater than 2 per cent, the Soundness test shall be carried out on the material delivered to site as per IS:2386 (Part 5).

**TABLE 400.7: PHYSICAL REQUIREMENTS OF COURSE AGGREGATES FOR WATER BOUND MACADAM FOR SUB-BASE/BASE/SURFACING COURSES**

Test	Sub-base	Base	Surfacing
Aggregate Impact Test (IS:2386 Part 4 or IS:5640)	Less than 50	Less than 40	Less than 30
Flakiness Index Test (IS:2386 Part 1)	Less than 30	Less than 25	Less than 20
Soundness Test (IS:2386 Part 1)			
- Loss with Sodium Sulphate	Less than 12%	Less than 12%	Less than 12%
- Loss with Magnesium Sulphate	Less than 18%	Less than 18%	Less than 18%

**405.2.2.** Aggregates, like, brick bats, kankar, laterite, etc. which get softened in presence of water shall be tested for Aggregate Impact Value under wet conditions in accordance with IS:5640.

**405.2.3.** The requirement of flakiness Index shall be enforced only in the case of crushed or broken stone and crushed slag.

**405.2.4. Crushed or broken stone:** The crushed or broken stone shall be hard, durable and free from excess flat, elongated, soft and disintegrated particles, dirt and other deleterious material.

**405.2.5. Crushed slag:** Crushed slag shall be made from air-cooled blast furnace slag. It shall be angular shape, reasonably uniform in quality and density and generally free from thin, elongated and soft pieces, dirt or other deleterious materials.

**405.2.6 Overburnt (Jhama) brick aggregates:** Jhama brick aggregates shall be made from over burnt bricks or brick ballast and be free from dust and other objectionable and deleterious materials.

**405.2.7. Grading requirement of coarse aggregates:** The coarse aggregates shall conform to one of the Gradings given in Table 400.8 as specified, provided, however, the use of Grading No.1 shall be restricted to sub-base courses only.

**TABLE 400.8 : GRADING REQUIREMENTS OF COARSE AGGREGATES**

Grading No.	Size Range	IS Sieve Designation	Per cent by weight passing
(1)	90 mm to 45 mm	125 mm	100
		90 mm	90-100
		63 mm	25-60
		45 mm	0-15
		22.4 mm	0-5
(2)	63 mm to 45 mm	90 mm	100
		63 mm	90-100
		53 mm	25-75
		45 mm	0-15
		22.4 mm	0-5
(3)	53 mm to 22.4 mm	63 mm	100
		53 mm	95-100
		45 mm	65-90
		22.4 mm	0-10
		11.2 mm	0-5

Note: The compacted thickness for a layer with Grading 1 shall be 100 mm while for layer with other Gradings, i.e., 2 & 3, it shall be 75 mm.

**405.2.8 Screenings:** Screenings to fill voids in the coarse aggregate shall generally consist of the same material as the coarse aggregate. However, where economic considerations so warrant, predominantly non-plastic material (other than rounded river borne material) may be used for this purpose provided liquid limit and plasticity index of such material are below 20 and 6 respectively and fraction passing 75 micron sieve does not exceed 10 per cent. The Screenings shall not contain any of the undesirable constituents listed in Clause 301.2.3 which would render it unsuitable as a fill material.

Screenings shall conform to the grading set forth in Table 400.9. The consolidated details of quantity of screenings required for various grades of stone aggregates are given in Table 400.10. The Table also gives the quantities of materials (loose) required for 10 m<sup>2</sup> for sub-base compacted thickness of 100/75 mm.

**TABLE : 400.9 : GRADING FOR SCREENING**

Grading Classification	Size of Screenings	IS Sieve Designation	Percent by Weight Passing the IS Sieve
A	13.2 mm	13.2 mm	100
		11.2 mm	95-100
		5.6 mm	15-35
		180 micron	0-10
B	11.2 mm	11.2 mm	100
		5.6 mm	90-100
		180 micron	15-35

The use of screenings shall be omitted in the case of soft aggregates, such as, brick metal, kankar, laterite, etc. as they are likely to get crushed to a certain extent under rollers.

**405.2.9 Binding material:** Binding material to be used for water bound macadam as a filler material meant for preventing raveling, shall comprise of a suitable material approved by the Engineer having a Plasticity Index (PI) value of less than 6 for sub-base/base course and 4 to 10 for surfacing course as determined in accordance with IS:2720 (Part 5).

The quantity of binding material where it is to be used, will depend on the type of screenings. Generally, the quantity required for 75 mm compacted thickness of water bound macadam will be 0.06-0.09 m<sup>3</sup>/10m<sup>2</sup> and 0.08-0.10 m<sup>3</sup>/10 m<sup>2</sup> for 100 mm compacted thickness.

The above mentioned quantities should be taken as a guide only, for estimation of quantities for construction, etc.

Application of binding materials may not be necessary when the screenings used are of crushable type.

**TABLE 400.10: APPROXIMATE QUANTITIES OF COARSE AGGREGATES AND SCREENINGS REQUIRED FOR 100/75 mm COMPACTED THICKNESS OF WATER BOUND MACADAM (WBM) SUB-BASE/ BASE/ SURFACING COURSE FOR 10 M<sup>2</sup> AREA.**

Classification	Size Range	Compacted thickness	Loose Quantity	Stone Screenings		Crushable Screenings such as moorum or	
				Grading Classification & Size	For WBM Sub-base/ Base Course (Loose Quantity) m <sup>3</sup>	Properties	Loose Quantity
Grading 1	90 to 45	100	1.21 to 1.43	Type A 13.2	0.27 to 0.30	LL<20, PI<6 percent passing 0.075 mm 10	0.30 to 0.32
Grading 2	63 to 45	75	0.91 to 1.07	Type A 13.2	0.12 to 0.15	-do-	0.22 to 0.24
Grading 2	63 to 45	75	0.91 to 1.07	Type B 11.2	0.20 to 0.22	-do-	-do-

Grading 3	53 to 22.4	75	0.91 to 1.07	Type B 11.2	0.18 to 0.21	-do-	-do-
-----------	------------	----	--------------	-------------	--------------	------	------

### 405.3. Construction Operations

**405.3.1. Preparation of base:** The surface of the subgrade/sub-base/base to receive the water bound macadam course shall be prepared to the specified lines and crossfall (camber) and made free of dust and other extraneous material. Any ruts or soft yielding places shall be corrected in an approved manner and rolled until firm surface is obtained if necessary by sprinkling water. Any sub-base/base/surface irregularities, where predominant, shall be made good by providing appropriate type of profile corrective course (leveling course).

Laying water bound macadam course over an existing bituminous layer shall be avoided since it will cause problems of internal drainage of the pavement at the interface of two courses. It is desirable to completely pick out the existing thin bituminous wearing course where water bound macadam is proposed to be laid over it.

**405.3.2. Inverted choke:** Where the WBM layer is to be laid over the subgrade and the subgrade soil is fine-grained, it is advisable to lay 100 mm intervening layer of screening or coarse sand on top of the fine-grained soil.

**405.3.3. Provision of lateral confinement of aggregates:** While constructing water bound macadam, arrangement shall be made for the lateral confinement of the aggregate. This shall be done by laying materials in adjoining shoulders along with that of water bound macadam layer and following the sequence of operations described in Clause 407.4.1.

**405.3.4. Spreading coarse aggregates:** The coarse aggregates shall be spread uniformly and evenly upon the prepared subgrade/sub-base/base to proper profile by using templates placed across the road about 6 mm apart, in such quantities that the thickness of each compacted layer is not more than 100 mm for Grading 1 and 75 mm for Grading 2 and 3, as specified in Clause 405.2.5. Aggregates placed at locations which are inaccessible to the spreading equipment, may be spread in one or more layers by any approved means so as to achieve the specified results.

The spreading shall be done from stockpiles along the side of the roadway or directly from vehicles. No segregation of large or fine aggregates shall be allowed and the coarse aggregate as spread shall be of uniform gradation with no pockets of fine material.

The surface of the aggregates spread shall be carefully checked with templates and all high or low spots remedied by removing or adding aggregates as may be required. The surface shall be checked frequently with a straight edge while spreading and rolling so as to ensure a finished surface as per approved drawings.

The coarse aggregates shall not normally be spread more than 3 days in advance of the subsequent construction operations.

**405.3.5. Rolling:** Immediately following the spreading of the coarse aggregate, rolling shall be started with three wheeled power rollers of 80 to 100 kN capacity or tandem or vibratory rollers of 80 to 100 kN static weight. The type of roller to be used shall be approved by the Engineer based on trial run.

Except on superelevated portions where the rolling shall proceed from inner edge to the outer, rolling shall begin from the edges gradually progressing towards the centre. First the edge/edges shall be compacted with roller running forward and backward. The roller shall then move inward parallel to the centre line of the road, in successive passes uniformly lapping preceding tracks by at least one half width.

Rolling shall be discontinued when the aggregates are partially compacted with sufficient void space in them to permit application of screenings. However, where screenings are not to be applied, as in the case of crushed aggregates, like, brick metal, laterite and kanker, compaction shall be continued until the aggregates are thoroughly keyed. During rolling slight sprinkling of water may be done, if necessary. Rolling shall not be done when the subgrade is soft or yielding or when it causes a wave-like motion in the subgrade or sub-base course.

The rolled surface shall be checked transversely and longitudinally, with templates and any irregularities corrected by loosening the surface, adding or removing necessary amount of aggregates and re-rolling until the entire surface conforms to desired crossfall (camber) and grade. In no case shall the use of screenings be permitted to make up depressions.

Material which gets crushed excessively during compaction or becomes segregated shall be removed and replaced with suitable aggregates.

It shall be ensured that shoulders are built up simultaneously along with water bound macadam courses, in accordance with the procedure given in Clause 407.4.1.

**405.3.6. Application of screenings:** After the coarse aggregate has been rolled to Clause 405.3.4, screenings to completely fill the interstices shall be applied gradually over the surface. These shall not be damp or wet at the time of application. Dry rolling shall be done while the screenings are being spread so that vibrations of the roller cause them to settle into the voids of the coarse aggregate. The screenings shall not be dumped in piles but be spread uniformly in successive thin layers either by the spreading motions of hand shovels or by mechanical spreaders, or directly from tipper with suitable grit spreading arrangement. Tipper operating for spreading the screenings shall be so driven as not to disturb the coarse aggregate.

The screenings shall be applied at a slow and uniform rate (in three or more applications) so as to ensure filling of all voids. This shall be accompanied by dry rolling and brooming with mechanical brooms, hand brooms or both. In no case shall the screenings be applied so fast and thick as to form cakes or ridges on the surface in such a manner as would prevent filling of voids or prevent the direct bearing of the roller on the coarse aggregate. These operations shall continue until no more screenings can be forced into the voids of the coarse aggregate.

The spreading, rolling, and brooming of screenings shall be carried out in only such lengths of the road which could be completed within one day's operation.

**405.3.7. Sprinkling of water and grouting:** After the screenings have been applied, the surface shall be copiously sprinkled with water, swept and rolled. Hand brooms shall be used to sweep the wet screenings into voids and to distribute them evenly. The sprinkling, sweeping and rolling operation shall be continued, with additional screenings applied as necessary until the coarse aggregate has been thoroughly keyed, well-bonded and firmly set in its full depth and a grout has been formed of screenings. Care shall be taken to see that the base or subgrade does not get damaged due to the addition of excessive quantities of water during construction.

In case of lime treated soil sub-base, construction of water bound macadam on top of it can cause excessive water to flow down to the lime treated sub-base before it has picked up enough strength (is still “green”) and thus cause damage to the sub-base layer. The laying of water bound macadam layer in such cases shall be done after the sub-base attains adequate strength, as directed by the Engineer.

**405.3.8. Application of binding material:** After the application of screenings in accordance with Clauses 405.3.5 and 405.3.6 the binding material where it is required to be used (Clause 405.2.7) shall be applied successively in two or more thin layers at a slow and uniform rate. After each application, the surface shall be copiously sprinkled with water, the resulting slurry swept in with hand brooms, or mechanical brooms to fill the voids properly, and rolled during which water shall be applied to the wheels of the rollers if necessary to wash down the binding material sticking to them. These operations shall continue until the resulting slurry after filling of voids, forms a wave ahead of the wheels of the moving roller.

**405.3.9. Setting and drying:** After the final compaction of water bound macadam course, the pavement shall be allowed to dry overnight. Next morning hungry spots shall be filled with screenings or binding material as directed, lightly sprinkled with water if necessary and rolled. No traffic shall be allowed on the road until the macadam has set. The Engineer shall have the discretion to stop hauling traffic from using the completed water bound macadam course, if in his opinion it would cause excessive damage to the surface.

The compacted water bound macadam course should be allowed to completely dry and set before the next pavement course is laid over it.

#### **405.4. Surface Finish and Quality Control of Work**

**405.4.1.** The surface finish of construction shall conform to the requirements of Clause 1802.

**405.4.2.** Control on the quality of material and works shall be exercised by the Engineer in accordance with Section 1800.

**405.4.3.** The water bound macadam work shall not be carried out when the atmospheric temperature is less than 0° C in the shade.

**405.4.4. Reconstruction of defective macadam:** The finished surface of water bound macadam shall conform to the tolerance of surface regularity as prescribed in Clause 1802. However, where the surface irregularity of the course exceeds the tolerances or where the course is otherwise defective due to subgrade soil mixing with the aggregates, the course to its full thickness shall be scarified over the affected area, reshaped with added material or removed and replaced with fresh material as applicable and recompacted. In no case shall depressions be filled up with screenings or binding material.

#### **405.5. Arrangement for Traffic**

During the period of construction, the arrangement of traffic shall be done as per Clause 111.

#### **405.6. Measurements for Payment**

Water bound macadam shall be measured as finished work in position in cubic metres.

#### **405.7. Rate**

The Contract unit rate for water bound macadam sub-base/base course shall be payable in full for carrying out the required operations including full compensation for all components listed in Clause 401.9 (i) to (v) including arrangements of water used in the work as approved by the Engineer.

### **Item No.7**

**Providing, laying, spreading and compacting graded stone aggregate to Wet Mix Macadam specification including premixing the material with water at OMC in mechanical mix plant carriage of mixed material by tipper to site, laying in uniform layers with paver in sub-base/base course on well prepared surface and compacting with vibratory roller to achieve the desired density..**

#### **406. WET MIX MACADAM BASE**

##### **406.1. Scope**

This work shall consist of laying and compacting clean, crushed, graded aggregate and granular material, premixed with water, to a dense mass on a prepared sub-base/base of existing pavement as the case may be, in accordance with the requirements of these Specifications. The material shall be laid in one or more layers as necessary to lines, grades and cross-sections shown on the approved drawings or as directed by the Engineer.

The thickness of a single compacted Wet Mix Macadam layer shall not be less than 75 mm. When vibrating or other approved types of compacting equipment are used, the compacted depth of a single layer of the base course may be adopted upto 200 mm upon approval of the Engineer.

##### **406.2. Materials**

##### **406.2.1. Aggregates**

**406.2.1.1. Physical Requirements:** Coarse aggregates shall be crushed stone. If crushed gravel/shingle is used, not less than 90 per cent by weight of the gravels/shingle pieces retained on 4.75 mm sieve shall have at least two fractured faces. The aggregates shall conform to the physical requirements set forth in Table 400.11.

**TABLE 400.11: PHYSICAL REQUIREMENTS OF COARSE AGGREGATES FOR WET MIX MACADAM FOR SUB-BASE/BASE COURSES**

Test	Test Method	Requirements
1. Aggregate Impact Value	IS:2386 (Part 4) or IS:5640	40 per cent (Max)
2. Flakiness Index	IS:2386 (Part 1)	25 per cent (Max)

If the water absorption value of the coarse aggregate is greater than 2 per cent, the soundness test shall be carried out on the material delivered to site as per IS : 2386 (Part 5).

**406.2.1.2. Grading requirements:** The aggregates shall conform to the grading given in Table 400.12.

**TABLE 400.12: GRADING REQUIREMENTS OF AGGREGATES FOR WET MIX MACADAM**

IS Sieve Designation	Minimum per cent by Weight Passing the IS Sieve
53.00 mm	100

45.00 mm	95-100
26.50 mm	-
22.40 mm	60-80
11.20 mm	40-60
4.75 mm	25-40
2.36 mm	15-30
600 micron	8-22
75 micron	0-8

Materials finer than 425 micron shall have Plasticity Index (PI) not exceeding 6.

The final gradation approved within these limits shall be well graded from coarse to fine and shall not vary from the low limit on one sieve to the high limit on the adjacent sieve or vice versa.

### **406.3. Construction Operations**

**406.3.1. Preparation of base:** Clause 405.3.1. shall apply.

**406.3.2. Provision of lateral confinement of aggregates:** While constructing wet mix macadam, arrangement shall be made for the lateral confinement of the wet mix. This shall be done by laying materials in adjoining shoulders along with that of wet mix macadam layer and following the sequence of operations described in Clause 407.4.1.

**406.3.3. Preparation of mix:** Wet Mix Macadam shall be prepared in an approved mixing plant of suitable capacity having provision for controlled addition of water and forced/positive mixing arrangement like pugmill or pan type mixer of concrete batching plant. For small quantity of wet mix work, the Engineer may permit the mixing to be done in concrete mixers.

Optimum moisture for mixing shall be determined in accordance with IS:2720 (Part 7) after replacing the aggregate fraction retained on 22.4 mm sieve with material of 4.75 mm to 22.4 mm size. While adding water, due allowance should be made for evaporation losses. However, at the time of compaction, water in the wet mix should not vary from the optimum value by more than agreed limits. The mixed material should be uniformly wet and no segregation should be permitted.

**406.3.4. Spreading of mix:** Immediately after mixing, the aggregates shall be spread uniformly and evenly upon the prepared subgrade/sub-base as the case may be, in required quantities. In no case should these be dumped in heaps, directly on the area where these are to be laid nor shall their hauling over a partly completed stretch be permitted.

The mix may be spread either by a paver finisher or motor grader. For portions where mechanical means cannot be used, manual means as approved by the Engineer shall be used. The motor grader shall be capable of spreading the material uniformly all over the surface.

The paver finisher shall be self-propelled, having the following features:

- (i) Loading hoppers and suitable distribution mechanism.
- (ii) The screed shall have tamping and vibrating arrangement for initial compaction to the layer as it is spread without rutting or otherwise marring the surface profile.
- (iii) The paver shall be equipped with necessary control mechanism so as to ensure that the finished surface is free from surface blemishes.

The surface of the aggregate shall be carefully checked with templates and all high or low spots remedied by removing or adding aggregate as may be required. The layer may be tested by depth blocks during construction. No segregation of large and fine particles should be allowed. The aggregates as spread should be of uniform gradation with no pockets of fine materials.

**406.3.5. Compaction:** After the mix has been laid to the required thickness, grade and crossfall/camber, the same shall be uniformly compacted, to the full depth with suitable roller.

If the thickness of single compacted layer does not exceed 100 mm, a smooth wheel roller of 80 to 100 kN weight may be used. For a compacted single layer upto 200 mm, the compaction shall be done with the help of vibratory roller of minimum static weight of 80 to 100 kN or equivalent capacity roller. The speed of the roller shall not exceed 5 km per hour.

In portions having unidirectional cross fall/superelevation, rolling shall commence from the lower edge and progress gradually towards the upper edge. Thereafter, roller should progress parallel to the centre line of the road, uniformly over-lapping each preceding track by at least one third width until the entire surface has been rolled. Alternate trips of the roller shall be terminated in stops at least 1 m away from any preceding stop.

In portions in camber, rolling should begin at the edge with the roller running forward and backward until the edges have been firmly compacted. The roller shall then progress gradually towards the centre, parallel to the centre line of the road uniformly overlapping each of the preceding tracks by at least one-third width until the entire surface has been rolled.

Any displacement occurring as a result of reversing of the direction of a roller or from any other cause shall be corrected at once as specified and/or removed and made good.

Along forms, kerbs, walls or other places not accessible to the roller, the mixture shall be thoroughly compacted with mechanical tampers or a plate compactor. Skin patching of an area without scarifying the surface to permit proper bonding of the added material shall not be permitted.

Rolling should not be done when the subgrade is soft or yielding or when it causes a wave-like motion in the sub-base/base course or subgrade. If irregularities develop during rolling which exceed 12 mm when tested with 3 m straight edge, the surface should be loosened and premixed material added or removed as required before rolling again so as to achieve a uniform surface conforming to the desired grade and crossfall. In no case should the use of unmixed material be permitted to make up the depressions.

Rolling shall be continued till the density achieved is at least 100 per cent of the maximum dry density for the material as determined by the method outlined in IS:2720 (Part 7).

After completion, the surface of any finished layer shall be well-closed, free from movement under compaction equipment or any compaction planes, ridges, cracks and loose material. All loose, segregated or otherwise defective areas shall be made good to the full thickness of the layer and recompact.

**406.3.6. Setting and drying:** After final compaction of wet mix macadam course, the road shall be allowed to dry for 24 hours.

#### **406.4. Opening to Traffic**

Preferably no vehicular traffic of any kind should be allowed on the finished wet mix macadam surface till it has dried and the wearing course laid.

#### **406.5. Surface Finish and Quality Control of Work**

**406.5.1. Surface evenness:** The surface finish of construction shall conform to the requirements of Clause 1802.

**406.5.2. Quality control:** Control on the quality of materials and works shall be exercised by the Engineer in accordance with Section 1800.

#### **406.6 Rectification of Surface Irregularity**

Where the surface irregularity of the wet mix macadam course exceeds the permissible tolerances or where the course is otherwise defective due to subgrade soil getting mixed with the aggregates, the full thickness of the layer shall be scarified over the affected area, reshaped with added premixed material or removed and replaced with fresh premixed material as applicable and recompact in accordance with Clause 406.3. The area treated in the aforesaid manner shall not be less than 5 m long and 2 m wide. In no case shall depressions be filled up with unmixed and ungraded material or fines.

#### **406.7. Arrangement for Traffic**

During the period of construction, arrangement of traffic shall be done as per Clause 111.

#### **406.8. Measurements for Payment**

Wet Mix Macadam shall be measured as finished work in position in cubic metres.

#### **406.9 Rate**

The Contract unit rate for wet mix macadam shall be payment in full for carrying out the required operations including full compensation for all components listed in Clause 401.9.

### **Item No.8**

**Rolling and Watering of earthwork in layers with vibratory roller including filling in depression which occur during the process as directed.**

1. For spreading materials in layers and bringing the appropriate moisture content the embankment materials successive layers of embankment shall be spread uniformly over the entire which of the embankment in layer not exceeding 250mm in loose thickness successive layers of embankment shall not be

placed until the layer under construction has been thoroughly compacted to the requirements set down hereunder:

Moisture content of the materials shall be checked at the source of supply and if found less than that specified for compaction, the same shall be made good either at the source or after spreading the soil in loose thickness for compaction. In the latter case, water shall be sprinkled directly from a hose line or from a truck mounted water tank, and flooding shall not be permitted under any circumstances.

If the materials delivered to the road bed is too wet it shall be dried by evaporation and exposure to the sun till the moisture content is brought down to acceptable standard for compaction. Should circumstances arise where owing to wet weather, the moisture content cannot be reduced to the required level by the above procedure work of compaction shall be suspended.

Moisture content of each layer of soil shall be checked in accordance with IST 2720 (Part : II) and unless otherwise mentioned shall be so adjusted, making due allowance for evaporation losses that at the time of the compaction it is in the range of 1 percent to 2 percent below the optimum moisture content determined in accordance with ISI ( Part - VII) Highly expansive clays shall however be compacted at 2 to 4 percent above the optimum moisture content.

After adding the required amount of water, the soil shall be processed by means of harrows rotary mixers or as otherwise approved until the layer is uniformly wet.

Clods or hard lumps of earth shall be broken to have maximum size of 150 mm when being placed in the lower layers of the embankment and a maximum size of 60mm when being placed in the top 0.5 Metre portion of the embankment to minimise cutting of uneven compaction.

Hauling equipment shall be dispersed uniformly over entire surface of the previously constructed layer to minimise cutting of uneven compaction.

Where the embankment is to be constructed on low area ground that will not support the weight of truck or other hauling equipment, the lower part of the fill should be constructed by dumping successive loads in a uniform distributed layers of a thickness not greater than that necessary to support the hauling equipment while placing subsequent layers.

**2. COMPACTION :** Only compaction equipment approved by the Engineer in charge shall be employed to compact the materials. The contractor shall demonstrate the efficiency of the equipment he intends to use for carrying out compaction trials.

Each layer of the materials shall be thoroughly compacted to the densities specified in Table 1.2

**Table 1.2 Compaction requirements for embankment.**

Sr.No.	Type of Work/ Materials	Field dry density as percentage of maximum Laboratory dry density as per IS:2720 ( Part - VII)
1.	Top 0.5 Metre portion of embankment below subgrade level and shoulders	Not less than 100
2.	Other portion of embankment.	Not less than 95
3.	Highly expansive Class.	85 to 90

Subsequent layers shall be placed only after finished layer has been tested according to M.O.S.T. specification clause 902 and accepted by the Engineer in charge.

When density measurements reveal any soft areas in the embankment further compaction shall be carried out as directed by the Engineer in charge. If inside of that specified compaction is not achieved, the materials in the soft areas shall be removed and replaced by approved materials and compacted to the density requirement to the satisfaction of the Engineer in charge,

**3. Measurement for Payment :** Consolidation of earth embankment construction shall be measured by taking cross section at interval in the original position before the work starts and after its completion and computing of the volume of earthwork in cubic Metres by the method of average and areas. The measurement of fill material from borrow areas shall be the difference between the net quantities of suitable materials brought from roadway and drainage excavation. For this purpose it shall be assumed that one cubic Metre of suitable materials brought to site from roadway and drainage excavation forms one cubic Metre of compacted fill and all bulking or shrinkage shall be ignored.

Stripping including storing and reapplication of top soil shall be measured as volume in cubic Metre.

4. The contract unit rate include cost of mechanical roller required for consolidation including all labour, equipments fuel, hire chares, tolls and incidental necessary.

### **Item No.9**

**Providing and applying primer coat with bitumen emulsion SS1 on prepared surface of granular Base including clearing of road surface and spraying primer at the rate of 0.75kg/sqm using mechanical means,.**

## **502. PRIME COAT OVER GRANULAR BASE**

### **502.1. Scope**

This work shall consist of the application of a single coat of low viscosity liquid bituminous material to a porous granular surface preparatory to the superimposition of bituminous treatment or mix.

### **502.2. Materials**

**502.2.1. Primer:** The choice of a bituminous primer shall depend upon the porosity characteristics of the surface to be primed as classified in IRC:16. These are:

- (i) Surfaces of low porosity; such as wet mix macadam and water bound macadam.
- (ii) Surfaces of medium porosity; such as cement stabilized soil base; and
- (iii) Surfaces of high porosity; such as, a gravel/soil-aggregate base.

**502.2.2. Primer viscosity:** The type and viscosity of the primer shall comply with the requirements of IS:8887, as sampled and tested for bituminous primer in accordance with these standards. Guidance on viscosity and rate of spray is given in Table 500.1.

**TABLE 500.1 : REQUIREMENTS OF VISCOSITY AND QUANTITY OF LIQUID BITUMINOUS MATERIALS FOR PRIMING**

Porosity	Type of Surface	Kinematics Viscosity of Primer at 60°C (Centistokes)	Saybolt Furol Viscosity at 60° C (Seconds)	Quantity per 10 sqm (kg)
Low	WBM/WMM	30-60	14-238	7-10
Medium	Stabilized Base	70-140	33-66	9-12
High	Gravel Base	250-500	117-234	12-15

**502.2.3. Choice of Primer:** The primer shall be Slow Setting Bitumen Emulsion Grade SS-1, complying with IS:8887 or as specified in the Contract or as directed by the Engineer. The use of medium curing cutback as per IS:217 shall be restricted only for sites at sub-zero temperatures or for emergency applications.

### **502.3. Weather and Seasonal Limitations**

Bituminous primer shall not be applied to a wet surface (see Clause 502.4.2) or during a dust storm or when the weather is foggy, rainy or windy or when the temperature in the shade is less than 10° C.

Surfaces which are to receive emulsion primer should be damp, but no free or standing water shall be present.

#### **502.4. Construction**

**502.4.1. Equipment :** The primer distributor shall be a self-propelled or towed bitumen pressure sprayer equipped for spraying the material uniformly at specified rates and temperatures. Hand spraying of small areas, inaccessible to the distributor, or in narrow strips shall be permitted with a pressure hand sprayer. Use of a hand held perforated canister shall, however, not be permitted.

**502.4.2. Preparation of road surface:** The surface to be primed shall be prepared in accordance with Clause 501. Immediately prior to applying the primer, the surface shall be carefully swept clean of dust and loose particles, care being taken not to disturb the interlocked aggregate. This is best achieved when the surface layer is slightly moist (lightly sprayed with water and the surface allowed to dry) and the surface should be kept moist until the primer is applied.

**502.4.3. Application of Bituminous Primer:** The bituminous primer shall be sprayed/distributed uniformly over the dry surface, prepared as per Clause 502.4.2, using self-propelled or towed sprayer, capable of supplying primer at specified rates and temperature so as to provide a uniformly unbroken spread of primer. If the surface to be primed is so dry or dusty as to cause freckling of bituminous material, it shall be lightly and uniformly sprinkled with water immediately prior to priming; however, the bituminous material shall not be applied till such time as no surface water is visible. The primer shall be applied at the rate as specified in Table 500.1.

Temperature of application of a primer need only be high enough to permit the primer to be effectively sprayed through the jets of the spray bar and to cover the granular base surface uniformly in the desired quantity. For a bituminous emulsion primer, the range of spraying temperature shall be 20° C to 60° C and for cutback 50°C - 80° C if Medium Curing grade is used.

The primer coat shall be applied only on the topmost water bound macadam or any granular layer, over which the bituminous base course/wearing course is to be laid.

**502.4.4. Curing of primer and opening to traffic:** A primed surface shall be allowed to cure for at least 24 hours or such other period as is found to be necessary to allow all the volatiles to evaporate before any subsequent surface treatment or mix is laid. Any unabsorbed primer shall be blotted with an application of sand, using the minimum quantity possible. A primed surface shall not be opened to traffic other than that necessary to lay the next course. A very thin layer of clean sand may be applied to the surface of the primer, to prevent the primer picking up under the wheels of the paver and the trucks delivering bituminous material to the paver.

**502.4.5. Tack Coat:** Over the primed surface, a tack coat should be applied in accordance with Clause 503.

#### **502.5. Quality Control of Work**

For control of the quality of materials supplied and the works carried out, the relevant provision of Section 1800 shall apply.

#### **502.6 Arrangements for Traffic**

During construction operations, arrangements for traffic shall be made in accordance with the provisions of Clause 111.

#### **502.7. Measurement for Payment**

**Prime Coat shall be measured in terms of surface area of application in square metres.**

#### **502.8. Rate**

The contract unit rate for prime coat shall be payment in full for carrying out the required operations including full compensation for all components listed in Clause 401.9 (i) to (v) and as applicable to the work specified in these Specifications.

### **Item No.10**

**Providing, laying and rolling 50mm thick compacted bituminous Macadam (B.M.) in one layer with B.T. aggregates as specified and using Emulsion RS1 for tack coat at the rate of 2.50kg/10sqm (As per IRC-16) and using bitumen for mixing with agg. at the rate of 3.40% i.e 34.00kg/MT of total mix including mixing in Drum mix plant and spreading the same by paver finisher and consolidation with vibratory roller including necessary including cost of hire charges, firewood, oil, lubricants, labour charges, etc. by using contractor's own Drum mix plant, machineries and equipment, tools etc. complete in accordance with the requirement of specification.**

**( Read as “ Viscosity Grade bitumen VG-30” inplace of “ Penetration grade 60/70”)**

#### **504.1. Scope**

This work shall consist of construction in a single course having 37.50 mm thickness of compacted crushed aggregates premixed with a bituminous binder on a previously prepared base to the requirements of these Specifications.

#### **504.2. Materials**

**504.2.1. Bitumen:** The bitumen shall be paving bitumen of viscosity Grade complying with Indian Standard Specifications for “Paving Bitumen” IS:73, or Modified Bitumen conforming to Clause 512 or as directed by the Engineer. Further guidelines on the choice of bitumen depending on the maximum and minimum annual temperatures ( $T_{max}$  and  $T_{min}$ ) in the area are given at **Annexure-500.2**.

**504.2.2. Aggregates:** The coarse aggregates shall consist of crushed rock, crushed gravel or other hard material retained on the 2.36 mm sieve. They shall be clean, hard, durable, of cubical shape, free from dust and soft or friable matter, organic or other deleterious matter. Where the Contractor's selected source of aggregate have poor affinity for bitumen, as a condition for the approval of that source, the bitumen shall be treated with approved anti-stripping agents, as per the manufacturer's recommendations, without additional payment. Before approval of the source, the aggregates shall be tested for stripping.

The aggregates shall satisfy the physical requirements set forth in Table 500.3.

Where crushed gravel is proposed for use as aggregate, not less than 90 per cent by weight of the crushed material retained on the 4.75 mm sieve shall have at least two fractured faces.

Fine aggregates shall consist of crushed material, passing 2.36 mm sieve and retained on 75 micron sieve. They shall be clean, hard, durable, dry and free from dust, and soft or friable matter, organic or other deleterious matter.

**TABLE 500.3 : PHYSICAL REQUIREMENTS FOR AGGREGATES FOR BITUMINOUS  
MACADAM**

Property	Test	Specification
Particle shape	Flakiness Index	Max. 25 per cent
Strength	Aggregate Impact Value <sup>2</sup>	Max. 30 per cent
Durability	Soundness <sup>3</sup>	
	Sodium Sulphate	Max. 12 per cent
	Magnesium SULphate	Max. 18 per cent
Water Absorption	Water absorption <sup>4</sup>	Max. 2 per cent
Stripping	Coating and stripping of bitumen aggregate mixtures <sup>5</sup>	Min. retained coating 95 per cent

**Notes:** 1. IS:2386 Part 1  
2. IS:2386 Part 4\*  
3. IS:2386 Part 5  
4. IS:2386 Part 3  
5. IS:6241

\* Aggregates may satisfy requirements or either of these two tests.

**504.2.3. Aggregate grading and binder content:** When tested in accordance with IS:2386 (Part 1) (wet sieving method), the combined aggregate grading for the particular mixture shall fall within the limits shown in Table 500.4. The type and quantity of bitumen are also indicated in Table 500.4.

**TABLE 500.4 : COMPOSITION OF BITUMINOUS MACADAM**

IS Sieve (mm)	Cumulative Per cent Passing by Weight of Total Aggregate
26.5	100
19	90-100
13.2	56-88
4.75	16-36
2.36	4-19
0.3	2-10
0.075	0-5
*Bitumen content, % by weight of total mixture	3.3-3.5
Bitumen Penetration Grade	35 to 90

- \* For conditions in cooler areas of India or where the per cent passing 0.075 mm sieve is on the higher side of the range, appropriate bitumen contents may be upto 0.5 per cent higher, subject to the approval of the Engineer.

The binder content shall be within a tolerance of  $\pm 0.3$  per cent by weight of total mixture when individual specimens are taken for quality control tests in accordance with the provisions of Section 1800.

### **504.3. Construction Operations**

**504.3.1. Weather and seasonal limitations:** Laying of bituminous mixtures shall not be carried out when the air temperature at the surface over which it is to be laid is below 10° C or when the wind speed at any temperatures exceeds 40 km/hr at 2 m height unless specifically approved by the Engineer. Laying shall be suspended while free-standing water is present on the surface to be covered, or during rain, fog and dust storms. After rain, the surface shall be left to dry before laying shall start.

**504.3.2. Preparation of the base:** The base on which bituminous macadam is to be laid shall be prepared, shaped and compacted to the required profile in accordance with Clause 501, as appropriate, and a prime coat, on granular base shall be applied in accordance with Clause 502 where specified, or as directed by the Engineer.

**504.3.3. Tack Coat:** A tack coat in accordance with Clause 503 shall be applied as specified in the Contract or as directed by the Engineer.

**504.3.4. Preparation and transportation of mix:** Bituminous Macadam shall be prepared in a hot mix plant of adequate capacity and capable of yielding a mix of proper and uniform quality with thoroughly coated aggregates. Appropriate mixing temperatures are given in Table 500.7 of these Specifications; the difference in temperature between the binder and aggregate should at no time exceed 14° C. In order to ensure uniform quality of the mix and better coating of aggregates, the hot mix plant shall be calibrated from time to time. A batch type or continuous type or a spot mixer may be used for preparation of mix as decided by the Engineer. If a continuous mixing plant is to be used for mixing, the Contractor must demonstrate by laboratory analysis that cold feed combined grading is within permissible grading limits and binder content is in compliance to job mix formula. The maximum permitted variation in binder content shall be 0.3 per cent.

Bituminous Macadam shall be transported in clean insulated vehicles and unless otherwise agreed by the Engineer, shall be covered while in transit or awaiting tipping. Subject to the approval of the Engineer, a thin coating of diesel or lubricating oil may be applied to the interior of the vehicles to prevent sticking and to facilitate discharge of the material. Any tipper causing excessive segregation of materials by its spring suspension or other contributing factors or that which shows undue delay shall be removed from the work until such conditions are corrected.

**504.3.5. Spreading:** Except in areas where a mechanical paver cannot access, premixed bituminous macadam shall be spread, leveled, and tamped by an approved self-propelled paving machine. As soon as possible, after arrival at site, the materials shall be supplied continuously to the paver and laid without delay.

The rate of delivery of material to the paver shall be regulated to enable the paver to operate continuously. The travel rate of the paver and its method of operation shall be adjusted to ensure an even and uniform flow of bituminous material across the screed, free from dragging, tearing and segregation of the material. In areas with restricted space where a mechanical paver cannot be used, the material shall be

spread, raked and leveled with suitable hand tools by experienced staff and compacted to the satisfaction of the Engineer.

However, in restricted locations and in narrow widths where the available plant cannot be operated in the opinion of the Engineer, he may permit manual laying of the mix.

**504.3.6. Compaction:** After the spreading of mix, rolling shall be done by 80 to 100 kN static weight rollers or other approved equipment. Rolling shall start as soon as possible after the material has been spread deploying a set of rollers as the rolling is to be completed in limited time frame. The roller shall move at a speed not more than 5 km/hr. Rolling shall be done with care to avoid unduly roughening of the pavement surface.

Rolling shall commence at the edges and progress towards the centre longitudinally except that on superelevated and uni-directional cambered portions, it shall progress from the lower to the upper edge parallel to the centerline of the pavement.

The initial or break-down rolling shall be done with 80 to 100 kN static weight rollers, as soon as it is possible to roll the mix without cracking the surface or having the mix pick up on the roller wheels. The second or intermediate rolling shall follow the break-down rolling with vibratory roller of 80 to 100 kN static weight or a suitable pneumatic tyred roller as closely as possible to the paver and be done while the paving mix is still at a temperature that will result in maximum density. The final rolling shall be done while material is still workable, as per the temperatures given in Table 500.5. The joints and edges shall be rolled with a 80 to 100 kN static weight roller.

When the roller has passed over the whole area once, any high spots or depressions which become apparent shall be corrected by removing or adding mix material. The rolling shall then be continued till there is no crushing of aggregates and all roller marks have been eliminated. Each pass of the roller shall uniformly overlap not less than one-third of the track made in the preceding pass. The roller wheel shall be kept damp if necessary to avoid bituminous material from sticking to the wheels and being picked up. In no case shall fuel, lubricating oil be used for this purpose, nor excessive water poured on the wheels. The initial wetting of the roller wheels should be done outside the compaction area.

Rolling operations shall be completed in every respect before the temperature of the mix falls below the rolling temperature given in Table 500.5.

**TABLE 500.5 : MANUFACTURING AND ROLLING TEMPERATURES**

Bitumen viscosity	Bitumen Mixing(°C)	Aggregate Mixing(°C)	Mixed Material (°C)	Laying (°C)	Rolling (°C)
35	160-170	160-175	170 maximum	140 minimum	100 minimum
65	150-165	150-170	165 maximum	130 minimum	100 minimum
90	140-160	140-165	155 maximum	130 minimum	100 minimum

Roller(s) shall not stand on newly laid material while there is a risk that surface will be deformed thereby. The edges along and transverse of the bituminous macadam laid and compacted earlier shall be cut to their full depth so as to expose fresh surface which shall be painted with a thin surface coat of appropriate binder before the new mix is placed against it, as per Clause 504.3.7.

Where Modified Bitumen is used, the manufacturing and rolling temperatures shall be as per Clause 512.4.2.

**504.3.7. Joints:** For single-lane road construction, only transverse joints are made, while for double-lane road construction, longitudinal joints have also to be made in addition to transverse joints. While forming joints it is necessary that the premixed material shall be fully compacted and the joint made flush by cutting back the exposed joint for a distance equal to the specified layer thickness, to a vertical face, discarding all loosened material. The vertical face shall be coated completely with 80/100 penetration grade hot bitumen, or cold-applied bitumen, or polymer modified adhesive bitumen tape with a minimum thickness of 2 mm, before the adjacent width is laid.

#### **504.4. Surface Finish and Quality Control of Work**

The surface finish of the completed construction shall conform to the requirements of Clause 1802. For control of the quality of materials supplied and the works carried out, the relevant provision of Section 1800 shall apply.

#### **504.5. Protection of the Layer**

The bituminous macadam shall be covered with either the next pavement course or wearing course, as the case may be, within a maximum of forty-eight hours. If there is to be any delay on account of the construction procedure adopted by the Contractor, the course shall be covered by a seal coat to the requirement of Clause 509 before opening to any traffic. The seal coat in such cases shall be considered incidental to the work and shall not be paid for separately.

#### **504.6. Arrangements for Traffic**

During the period of construction, arrangements for traffic shall be made in accordance with the provisions of Clause 111.

#### **504.7. Measurements for Payment**

**The work shall be measured as finished work in by weight in metric tones as provided in the Contract.**

#### **504.8. Rate**

The contract unit rate for the work shall be payment in full for carrying out the required operations including full compensation for:

- (i) Making arrangements for traffic to Clause 111 except for initial treatment to verges, shoulders and construction of diversions;
- (ii) Preparation of base;

- (iii) Providing all materials to be incorporated in the work including arrangement for stockyards, all royalties, fees, rents where necessary and all leads and lifts;
- (iv) Mixing, transporting, laying and compacting the mix, as specified;
- (v) All labour, tools, equipment, plant including laying trials, if directed by the Engineer, installation of hot mix plant, power supply units and all machineries, incidental to complete the work to the Specifications;
- (vi) Carrying out the work in part widths of the road where directed;
- (vii) Carrying out all tests for control of quality;
- (viii) The rate shall cover the provision of bitumen at 3.4 per cent of weight of total mix, with the provision that the variation of quantity of bitumen will be assessed and the payment adjusted as per the rate of bitumen quoted; and
- (ix) The rates for premixed material shall include for all wastage in cutting of joints etc.

### **Item No.11**

**Providing and laying S.D.B.C. using B.T. stone chipping and aggregates at 0.66Cum/M.T. as per MORTH gradation, asphalt grade VG 30 (60/70) for mixing at the rate of 51.00 Kg/M.T. of total wt. of mix i.e. (5.10% of total wt. of mix) including heating the asphalt and aggregates by continuous batching Drum mix plant & spreading the same by paver finisher and consolidation with 8-10 tonnes vibratory and power roller and flushing of sand at the rate of 0.30 Cum/10 Sqm. including providing all materials, equipment tools and plants fire wood oil, kerosene labour charges using contractor's own machineries drum mix plant and paver finisher.**

#### **201. SEMI-DENSE BITUMINOUS CONCRETE**

##### **501.1 Scope**

This clause specifies the construction of Semi Dense Bituminous Concrete, for use in wearing / binder and profile corrective courses. This work shall consist of construction in a single or multiple layers of semi dense bituminous concrete on a previously prepared bituminous bound surface. A single layer shall be 25 mm to 100mm in thickness.

##### **501.2. Materials**

**504.2.1. Bitumen:** The bitumen shall be paving bitumen of Penetration Grade complying with Indian Standard Specifications for "Paving Bitumen" IS: 73, and of the penetration indicated in Table 500-15, for semi dense bituminous concrete, or this bitumen as modified by one of the methods specified in Clause 521, or as otherwise specified in the Contract. Guidance on the selection of an appropriate grade of bitumen is given in The Manual for Construction and Supervision of Bituminous Works.

**504.2.2. Coarse aggregates:** The coarse aggregates shall be generally as specified in Clause 507.2.2, except that the aggregates shall satisfy the physical requirements of Table 500-14.

**504.2.3. Fine aggregates:** The fine aggregates shall be all as specified in Clause 507.2.3.

**508.2.4. Filler:** Filler shall be generally as specified in Clause 507.2.4. Where the aggregates fail to meet the requirements of the water sensitivity test in Table 500-14 then 2 per cent by total weight of aggregate, of hydrated lime shall be added without additional cost.

**508.2.5. Aggregate grading and binder content:** When tested in accordance with IS: 2386 Part I (Wet sieving method), the combined grading of the coarse and fine aggregates and added filler shall fall within the limits shown in Table 500-15 for gradings 1 or 2 specified in the Contract.

### 509.3. Mixture Design

**508.3.1. Requirement for the mixture:** Apart from conformity with the grading and quality requirements for individual ingredients the mixture shall meet the requirements set out in Table 500-16.

**TABLE 500-14. PHYSICAL REQUIREMENTS FOR COARSE AGGREGATE FOR SEMI DENSE BITUMINOUS CONCRETE PAVEMENT LAYERS**

Property	Test	Specification
Cleanliness (dust)	Grain size analysis <sup>1</sup>	Max 5% passing 0.75 mm sieve
Particle shape	Flakiness and elongation Index (combined) <sup>2</sup>	Max 30%
Strength*	Los Angeles Abrasion Value <sup>3</sup>	Max 35%
	Aggregate Impact value <sup>4</sup>	Max 27%
Polishing	Polished stone Value <sup>5</sup>	Min 55
Durability	Soundness <sup>6</sup>	
	Sodium Sulphate	Max 12%
	Magnesium Sulphate	Max 18%
Water absorption	Water absorption <sup>7</sup>	Max 2%
Stripping	Coating and stripping of bitumen aggregate mixtures <sup>9</sup>	Minimum retained coating 95%
Water sensitivity**	Retained tensile strength <sup>8</sup>	Min 80%

**Notes:**

1. IS:2386 Part 1

6. IS: 2386 Part 5

2. IS:2386 Part 1

7. IS: 2386 Part 3

(the elongation test may be done only on non-flaky aggregates in the samples)

3. IS: 2386 Part 4\*

8. AASHTO T 283\*\*

4. IS: 2386 Part 4\*

9. IS: 6241

5. BS: 812 Part 114

\* Aggregate may satisfy requirements of either of these two tests

\*\* the water sensitivity test is only required if the minimum retained coating in the stripping test is less than 95%.

The requirement for minimum per cent voids in mineral aggregate (VMA) are set out in Table 500-12.

**508.3.2. Binder content:** The binder content shall be optimised to achieve the requirements of the mixture set out in Table 500-16 and the traffic volume as specified in the Contract. The Marshall method for determining the optimum binder content shall be adopted as described in the Asphalt Institute Manual

MS-2, replacing the aggregates retained on the 26.5 mm sieve and retained on the 22.4 mm sieve, where approved by the Engineer.

**TABLE 500-15. COMPOSITION OF SEMI DENSE BITUMINOUS CONCRETE PAVEMENT LAYERS**

<b>Grading</b>	<b>1</b>	<b>2</b>
<b>Nominal aggregate size</b>	<b>13 mm</b>	<b>10 mm</b>
<b>Layer Thickness</b>	<b>35 – 40 mm</b>	<b>25 – 30 mm</b>
<b>IS Sieve<sup>1</sup> (mm)</b>	<b>Cumulative % by weight of total aggregate passing</b>	
45		
37.5		
26.5		
19	100	
13.2	90 -100	100
9.5	70 - 90	90 - 100
4.75	35 - 51	35 - 51
2.36	24 - 39	24 - 39
1.18	15 - 30	15 - 30
0.6	-	-
0.3	9 - 19	9-19
0.15	-	-
0.075	3 - 8	3 - 8
Bitumen content % by mass of total mix <sup>2</sup>	Min 4.5	Min 5.0
Bitumen grade (pen)	65*	65*

**Notes:**

1. The combined aggregate grading shall not vary from the low limit on one sieve to the high limit on the adjacent sieve.
2. Determined by the Marshall method.

\* Only in exceptional circumstances, 80/100 penetration grade may be used, as approved by the Engineer.

**TABLE 500-16. REQUIREMENTS FOR SEMI DENSE BITUMINOUS PAVEMENT LAYERS**

Minimum stability (kN at 60°C)	8.2
Minimum flow (mm)	2
Maximum flow (mm)	4
Compaction level (Number of blows)	75 blows on each of the two faces of the specimen

Percent air voids	3 - 5
Percent voids in mineral aggregate (VMA)	See Table 500-12
Percent voids filled with bitumen (VFB)	65 - 78

**508.3.3. Job Mix Formula:** The procedure for formulating the job mix formula shall be generally as specified in Clause 507.3.3 and the results of tests enumerated in Table 500-16 as obtained by the Contractors.

**508.3.4. Plant Trials – permissible variation in job mix formula:**

The requirements for plant trials shall be all as specified in Clause 507.3.4 and permissible limits for variation as shown in Table 500 – 13

**508.3.5. Laying Trials:** The requirements for laying trials shall be all as specified in Clause 507.3.5.

**509.4. Construction Operations**

**508.4.1. Weather and seasonal limitations:** The provisions of Clause 501.5.1. shall apply.

**508.4.2. Preparation of base:** The surface on which the Semi Dense Bituminous material is to be laid shall be prepared in accordance with Clauses 501 and 902 as appropriate or as directed by Engineer. The surface shall be thoroughly swept clean by mechanical broom and dust removed by compressed air. In locations where a mechanical broom cannot access, other approved methods shall be used as directed by the Engineer.

**508.4.3 Geosynthetics -** Where Geosynthetics are specified in the Contract this shall be in accordance with the requirements stated in Clause 703.

**508.4.4 Stress absorbing layer -** Where a stress-absorbing layer is specified in the contract, this shall be applied in accordance with the requirements of Clause 500.22.

**508.4.5 Tack coat -** Where specified in the Contract, or otherwise required by the Engineer, a tack coat shall be applied in accordance with the requirements of Clause 500.3.

**508.4.6 Mixing and transportation of the mixture -** The provisions as specified in Clauses 500.1.3 and 500.1.4 shall apply.

**508.4.7 Spreading -** The general provisions of Clauses 501.5.3 and 501.5.4 shall apply.

**508.4.8 Rolling -** The general provisions of Clauses 500.1.6 and 500.1.7 shall apply, as modified by the approved laying trials. The compaction process shall be carried out by the same plant, and using the same method, as approved in the laying trials, which may be varied only with the express approval of the Engineer in writing.

**509.5. Opening to Traffic**

The newly laid surface shall not be open to traffic for at least 24 hours after laying and completion of compaction, without the express approval of the Engineer in writing.

**509.6. Surface Finish and Quality Control**

The surface finish of the completed construction shall conform to the requirements of Clause 902. All materials and workmanship shall comply with the provisions set out in Section 900 of this Specification.

#### **509.7. Arrangement for Traffic**

During the period of construction, arrangements for traffic shall be made in accordance with the provisions of Clause 112.

#### **509.8. Measurement for Payment**

The measurement shall be all as specified in Clause 507.8.

#### **509.9. Rate**

The contract unit rate shall be as specified in Clause 507.9, except that the rate shall include the provision of bitumen 4.75 per cent, by weight of total mixture. The variance in actual percentage of bitumen used will be assessed and the payment adjusted up or down, accordingly.

### **Item No. 12**

#### **Excavation for foundation upto 1.5m depth including sorting out and stacking of useful materials and disposing of the excavated stuff upto all lead. Dense or hard soil.**

1. Excavation for structures shall consist of the removal of material for the construction of foundations for culverts, retaining walls, cut of walls pipe culverts and other similar structures, in accordance with the requirements of these specification and the lines and dimensions shown on the drawing or as indicated by the Engineer in charge. The work shall include all necessary sheeting shoring, bracing draining and pumping and the removal of all logs stumps, grubs and other deleterious matter and obstructions necessary for placing the foundations, trimming bottoms of excavations backfilling and clearing up the site and the disposal of all surplus material.
2. After the site has been cleared the limits of excavation shall be set out true to lines, curves and slopes.
3. Excavation shall be taken to the width of the lowest step of the footing. The contractor at his own expense shall put up necessary shoring, trutting and planking or cut slopes to a safer angle or both with due regard to the safety of persons and works and to the satisfaction of the engineer in charge.
4. The depth to which the excavation is to be carried out shall be as shown, on the drawings, unless the type of material encountered is such as to require changes, in which case the depth shall be as ordered by the Engineer in charge.
5. Where waters are met with in excavation due to stream flow, seepage springs, rain or other reasons, the contractor shall take adequate measures such as bailing, pumping, constructing, diversion channels, drainage channels and other necessary work to keep the foundation trenches dry when so required and to protect green concrete/masonry against damage by erosion or sudden rising of water level. The method to be accepted in the regard and other details thereof shall be left to the choice of the contractor but subject to approval of the engineer in charge. Approval of the Engineer in charge shall, however, not relieve the contractor of the responsibility for the adequacy of dewatering and protection arrangements and for the quality and safety of the work.
6. Pumping from the interior of any foundation enclosures shall be done in such manner as to preclude the possibility of the movement of water through any fresh concrete. No pumping shall be permitted during the placing of concrete or for any period of at least 24 hours thereafter, unless it is done from a suitable sump separated from the concrete work by a water tight wall or other similar means.
7. The bottom of the foundation shall be leveled both longitudinally and transversely or stepped as directed by the Engineer in charge. Before footing is laid, the surface shall be slightly watered and rammed.

In the event of excavation having been made deeper than that shown on the drawings or as otherwise ordered by the Engineer in charge, the extra depth shall be made up with concrete or masonry of the foundation grade at the cost of the contractor, Ordinary filling shall not be used for the purpose of bringing the foundation to level. If there are any slips or blows in the excavation these shall be removed by the contractor at his own cost.

8. Near towns, villages and all frequented places, trenches and foundation pits shall be securely fenced, provided with proper caution signs and marked with red lights at night to avoid accidents. The contractor shall be required to take adequate protective measures to see that the excavation operation does not affect or damage adjoining structures.

9. Backfilling shall be done with approved material after concrete or masonry is full set and carried out in such a way as not to cause under thrust on any part of the structure. All space between foundation masonry or concrete and the sides of excavation shall be refilled to the original surface, making due allowance for settlement in 250 mm loose layers. Which shall be watered and compacted.

10. All the excavated materials shall be the property of the Government where the excavated material is directed to be used in the construction of embankment, it shall be directly deposited at the required locations.

11. All useful materials, not intended for use in the bank, shall be stacked neatly on Government land as directed by the Engineer in charge within 50 metres lead. Unsuitable and surplus materials not intended for use in any part of the road shall be disposed off as directed by the Engineer in charge.

12. Excavation for structures shall be measured in cubic metres for each class of material encountered, limited to the dimensions shown on the drawings or as directed by the Engineer in charge. Excavation over increased width, cutting of slopes, shoring, shattering and planking shall be deemed as convenience for the contractor in executing the work and shall not be measured and paid for separately.

13. The contract unit rate for the items for excavation for structures shall be paid in full for carrying out the required operations including.

(1) Setting out

(2) Construction of necessary shoring and bracing and their subsequent removal:

(3) Removal of all logs, stumps, grubs and other deleterious matter and obstructions for piling the foundations including trimming of bottoms of excavation:

(4) Foundation sealing dewatering including pumping.

(5) Backfilling, clearing up the site and disposal of all surplus material within all lifts and leads up to 100 metres:

(6) All labour, material, tools, equipment, safeguards and incidentals necessary to complete the work to the specification.

14. Excavation shall be for ordinary soil such as vegetable or organic soil, turf slit, and loam, clay mud, plat, black cotton soil, soft shale or soft murrum a mixture of these and similar material which yields other ordinary application of pick and shovel rake or other ordinary digging equipment. Removal of gravel or any other nodular material having diameter in any one direction not exceeding 75 mm occurring in such strata shall be deemed to be covered under this category. The classification of excavation shall be decided by the Engineer in charge and his decision shall be final and binding on the contractor,

#### **(B) -DO- in dense or hard soil**

Specifications shall be same except that the work shall be carried out in strata like dense or hard soil. The work shall be carried out in workmanship like manner.

Useful material available from excavation should be stacked properly and reused as directed and remaining materials should be disposed as directed. **Rate should be paid on cubic Metre basis.**

## **Item No. 13**

### **Excavation for foundation upto 1.5m depth including sorting out and stacking of useful materials and disposing of the excavated stuff upto all lead. Hard Murrum**

1. Excavation for structures shall consist of the removal of material for the construction of foundations for culverts, retaining walls, cut of walls pipe culverts and other similar structures, in accordance with the requirements of these specification and the lines and dimensions shown on the drawing or as indicated by the Engineer in charge. The work shall include all necessary sheeting shoring, bracing draining and pumping and the removal of all logs stumps, grubs and other deleterious matter and obstructions necessary for placing the foundations, trimming bottoms of excavations backfilling and clearing up the site and the disposal of all surplus material.
2. After the site has been cleared the limits of excavation shall be set out true to lines, curves and slopes.
3. Excavation shall be taken to the width of the lowest step of the footing. The contractor at his own expense shall put up necessary shoring, trutting and planking or cut slopes to a safer angle or both with due regard to the safety of persons and works and to the satisfaction of the engineer in charge.
4. The depth to which the excavation is to be carried out shall be as shown, on the drawings, unless the type of material encountered is such as to require changes, in which case the depth shall be as ordered by the Engineer in charge.
5. Where waters are met with in excavation due to stream flow, seepage springs, rain or other reasons, the contractor shall take adequate measures such as bailing, pumping, constructing, diversion channels, drainage channels and other necessary work to keep the foundation trenches dry when so required and to protect green concrete/masonry against damage by erosion or sudden rising of water level. The method to be accepted in the regard and other details thereof shall be left to the choice of the contractor but subject to approval of the engineer in charge. Approval of the Engineer in charge shall, however, not relieve the contractor of the responsibility for the adequacy of dewatering and protection arrangements and for the quality and safety of the work.
6. Pumping from the interior of any foundation enclosures shall be done in such manner as to preclude the possibility of the movement of water through any fresh concrete. No pumping shall be permitted during the placing of concrete or for any period of at least 24 hours thereafter, unless it is done from a suitable sump separated from the concrete work by a water tight wall or other similar means.
7. The bottom of the foundation shall be leveled both longitudinally and transversely or stepped as directed by the Engineer in charge. Before footing is laid, the surface shall be slightly watered and rammed. In the event of excavation having been made deeper than that shown on the drawings or as otherwise ordered by the Engineer in charge, the extra depth shall be made up with concrete or masonry of the foundation grade at the cost of the contractor, Ordinary filling shall not be used for the purpose of bringing the foundation to level. If there are any slips or blows in the excavation these shall be removed by the contractor at his own cost.
8. Near towns, villages and all frequented places, trenches and foundation pits shall be securely fenced, provided with proper caution signs and marked with red lights at night to avoid accidents. The contractor shall be required to take adequate protective measures to see that the excavation operation does not affect or damage adjoining structures.
9. Backfilling shall be done with approved material after concrete or masonry is full set and carried out in such a way as not to cause under thrust on any part of the structure. All space between foundation masonry or concrete and the sides of excavation shall be refilled to the original surface, making due allowance for settlement in 250 mm loose layers. Which shall be watered and compacted.
10. All the excavated materials shall be the property of the Government where the excavated material is directed to be used in the construction of embankment, it shall be directly deposited at the required locations.

11. All useful materials, not intended for use in the bank, shall be stacked neatly on Government land as directed by the Engineer in charge within 50 metres lead. Unsuitable and surplus materials not intended for use in any part of the road shall be disposed off as directed by the Engineer in charge.

12. Excavation for structures shall be measured in cubic metres for each class of material encountered, limited to the dimensions shown on the drawings or as directed by the Engineer in charge. Excavation over increased width, cutting of slopes, shoring, shattering and planking shall be deemed as convenience for the contractor in executing the work and shall not be measured and paid for separately.

13. The contract unit rate for the items for excavation for structures shall be paid in full for carrying out the required operations including:

- (1) Setting out
- (2) Construction of necessary shoring and bracing and their subsequent removal:
- (3) Removal of all logs, stumps, grubs and other deleterious matter and obstructions for piling the foundations including trimming of bottoms of excavation:
- (4) Foundation sealing dewatering including pumping.
- (5) Backfilling, clearing up the site and disposal of all surplus material within all lifts and leads up to 100 metres:
- (6) All labour, material, tools, equipment, safeguards and incidentals necessary to complete the work to the specification.

14. Excavation shall be in hard soil such as stiff heavy clay, hard shale or compact murrum requiring grouting tool or pick or both and shovel close applied and gravel and rubble stone having maximum diameter in any one direction between 75 and 300 mm and soft conglomerate. The classification of excavation shall be decided by the engineer in charge and his decision shall be final and binding on the Contractor.

**Payment shall be made on Cum basis**

### **Item No. 14**

**Excavation of foundation in hard murrum and boulders and very stiff or sticky clays and other similar strata including shorting out and strutting and dewatering as necessary and disposing of the excavated stuff as directed.**

1. Excavation for structures shall consist of the removal of materials for the construction of foundations for bridges, culverts, retaining walls, headwalls, cut off walls, pipe culverts and other similar structures, in accordance with the requirements, of these specifications and the lines and dimensions shown on the drawings or as indicated by the Engineer-in-charge. The work shall include all necessary sheeting, shorting, bracing, draining and pumping and the removal of all logs, stumps, shrubs, and other deleterious matter and obstruction necessary for the foundations, trimming bottoms of excavations; back filling and clearing up the site and the disposal of all surplus materials.

2. After the site has been cleared the limits of excavations shall be set out true to lines, curves, slopes, grades and sections as shown on the drawings or as directed by the Engineer-in-charge. The contractor shall provide all labour, survey instruments and materials such as stirrings, pegs, nails, bamboos, stones, lime, mortar, concrete etc. required in connection with the setting out of works and the establishment of bench mark, center line stones and other marks and stakes as long as in the opinion of the Engineer-in-charge, they are required for the work.

3. Excavation shall be taken to the width of the step of the footing. The contractor at his own expense shall put up necessary shoring, strutting, and planking or cut slopes to a safer angle or both with due regard to the safety of persons and works and to the satisfaction of the Engineer-in-charge.

4. The depth to which the excavation is to be carried out shall be as shown on the drawings, unless the type of materials encountered is such as to require changes, in which case the depth shall be as ordered by the Engineer-in-charge.

5. Where water is met with in excavation due to stream flow, seepage, rain or other reasons, the contractor shall take adequate measure such as bailing, pumping, to keep the foundation trenches dry when so required and to protect the green concrete/masonry against damage by erosion of sudden rising of water level. The methods to be adopted in this regard and other details thereof shall be left to the choice of the contractor but subject to approval of the engineer-in-charge. Approval of the Engineer-in-charge shall,

however not relieve the contractor of the responsibility for the adequacy of dewatering, and production arrangements and for the quality and safety of the works.

6. Pumping from the interior of any foundation enclosure shall be done in such a manner as to preclude the possibility of movement of water through any fresh concrete. No pumping shall be permitted during the placing of concrete or for any period of at least 24 hours thereafter, unless it is done from a suitable sump separated from the concrete work by a water tight wall or other similar means.

7. The bottom of the foundation shall be leveled both longitudinally and transversely or stepped as directed by the Engineer-in-Charge. Before footing is laid, the surface shall be slightly watered and rammed. In the event of excavation having been made deeper than that shown on the drawing or as otherwise ordered by the Engineer-in-charge, the extra depth shall be made up with concrete or masonry of the foundation grade at the cost of the contractor. Ordinary filling shall not be used for the purposes to bring the foundation to level. If there are any slips or blows in the excavation, these shall be removed by the contractor at his own cost.

8. Near towns, villages and all frequented places, trenches and foundation pits shall be securely fenced, provided with proper caution signs and marked with red light at night to avoid accidents. The contractor shall take adequate protective measures to see that the excavation operations do not affect or damage adjoining structures.

9. Backfilling shall be done with approved materials after concrete or masonry is fully set and carried out in such a way as not to cause undue thrust on any part of the structure. All space between foundation masonry or concrete and the sides of excavation shall be refilled to the original surface, making due allowance for settlement in 20mm loose layers, which shall be watered and compacted.

10. All the excavated materials shall be the property of the Government. Where the excavated materials are to be used in the construction of embankment, it shall be directly deposited at the required location within 100 metres lead.

11. All useful materials not intended for use in the bank, shall be stacked neatly on Government land as directed by the Engineer-in-charge within 100 metres lead. Unsuitable and surplus materials not intended for use shall be disposed off as directed by the Engineer-in-charge.

12. Excavation for structures shall be measured in cubic metres for each class of materials encountered, limited to the dimensions shown on the drawing or as directed by the Engineer-in-charge. Excavation over increased width cutting of slopes, shoring, shuttering and planking shall be deemed as convenience for the contractor in executing the work and shall not be measured and paid for separately.

13. The contract unit rate for the items of excavation for structures shall be paid in full for carrying out the required operations including:

14. Excavation shall be in hard soil such as stiff heavy clay, hard shale or compact murrum requiring grafting tool or pick or both and shovel, closely applied and gravel and rubble stone having maximum diameter in any one direction between 75 and 300mm and soft conglomerate. The classification of excavation shall be decided by the Engineer-in-charge and his decision shall be final and binding on the contractor.

15. **Payment shall made on Cum basis**

**Item No.15**

**Excavation in large boulders and soft rock by wedging including shoring, strutting and dewatering as necessary and disposing of the excavated stuff as directed,**

1. Excavation for structures shall consist of the removal of materials for the construction of foundations for bridges, culverts, retaining walls, headwalls, cut off walls, pipe culverts and other similar structures, in accordance with the requirements, of these specifications and the lines and dimensions shown on the drawings or as indicated by the Engineer-in-charge. The work shall include all necessary sheeting, shoring, bracing, draining and pumping and the removal of all logs, stumps, shrubs, and other deleterious matter and obstruction necessary for the foundations, trimming bottoms of excavations; back filling and clearing up the site and the disposal of all surplus materials.

2. After the site has been cleared the limits of excavations shall be set out true to lines, curves, slopes, grades and sections as shown on the drawings or as directed by the Engineer-in-charge. The contractor shall provide all labour, survey instruments and materials such as stirrings, pegs, nails, bamboos, stones, lime, mortar, concrete etc. required in connection with the setting out of works and the

establishment of bench mark, center line stones and other marks and stakes as long as in the opinion of the Engineer-in-charge, they are required for the work.

3. Excavation shall be taken to the width of the step of the footing. The contractor at his own expense shall put up necessary shoring, strutting, and planking or cut slopes to a safer angle or both with due regard to the safety of personal and works and to the satisfaction of the Engineer-in-charge.

4. The depth to which the excavation is to be carried out shall be as shown on the drawings, unless the type of materials encountered is such as to require changes, in which case the depth shall be as ordered by the Engineer-in-charge.

5. Where water is met with in excavation due to stream flow, seepage, rain or other reasons, the contractor shall take adequate measure such as bailing pumping, to keep the foundation trenches dry when so required and to protect the green concrete/masonry against damage by erosion of sudden rising of water level.. the methods to be adopted in this regard and other details thereof shall be left to the choice of the contractor but subject to approval of the engineer-in-charge. Approval of the Engineer-in-charge shall, however not relieve the contractor of the responsibility for the adequacy of dewatering, and production arrangements and for the quality and safety of the works.

6. Pumping from the interior of any foundation enclosure shall be done in such a manner as to preclude the possibility of movement of water through any fresh concrete. No pumping shall be permitted during the placing of concrete or for any period of at least 24 hours thereafter, unless it is done from a suitable sump separated from the concrete work by a water tight wall or other similar means.

7. The bottom of the foundation shall be leveled both longitudinally and transversely or stepped as directed by the Engineer-in-Charge. Before footing is laid, the surface shall be slightly watered and rammed. In the event of excavation having been made deeper than that shown on the drawing or as otherwise ordered by the Engineer-in-charge, the extra depth shall be made up with concrete or masonry of the foundation grade at the cost of the contractor. Ordinary filling shall not be used for the purposes to bring the foundation to level. If there are any slips or blows in the excavation, these shall be removed by the contractor at his own cost.

8. Near towns, villages and all frequented places, trenches and foundation pits shall be securely fenced, provided with proper caution signs and marked with red light at night to avoid accidents. The contractor shall take adequate protective measures to see that the excavation operations do not affect or damage adjoining structures.

9. Backfilling shall be done with approved materials after concrete or masonry is fully set and carried out in such a way as not to cause undue thrust on any part of the structure. All space between foundation masonry or concrete and the sides of excavation shall be refilled to the original surface, making due allowance for settlement in 20mm loose layers, which shall be watered and compacted.

10. All the excavated materials shall be the property of the Government. Where the excavated materials are to be used in the construction of embankment, it shall be directly deposited at the required location within 100 metres lead.

11. All useful materials not intended for use in the bank, shall be stacked neatly on Government land as directed by the Engineer-in-charge within 100 metres lead. Unsuitable and surplus, materials not intended for use shall be disposed off as directed by the Engineer-in-charge.

12. Excavation for structures shall be measured in cubic metres for each class of materials encountered, limited to the dimensions shown on the drawing or as directed by the Engineer-in-charge. Excavation over increased width cutting of slopes, shoring, shuttering and planking shall be deemed as convenience for the contractor in executing the work and shall not be measured and paid for separately.

13. The contract unit rate for the items of excavation for structures shall be paid in full for carrying out the required operations including:

14. Excavation shall be in soft rock or such as lime stone, sand stone, laterite, hard conglomerate or other soft or disintegrated rock which may be quarried or split with crow bars, boulders which do not require blasting having diameter in any direction of more than 300mm. and any rock which in dry state may be hard, requiring blasting but which when wet become soft and manageable means other than blasting. The classification of excavation shall be decided by the Engineer-in-charge and his decision shall be final and binding on the contractor.

#### **15. Payment shall made on Cum basis**

## **Item No.16**

**Excavation in hard rock by dry-wet blasting and chiseling including dewatering and chiseling including dewatering preparing foundation base by proper benching and stepping and disposing of the excavated stuff as directed (B) Blasting prohibited.**

1. Excavation for structures shall consist of the removal of materials for the construction of foundations for bridges, culverts, retaining walls, headwalls, cut of walls, pipe culverts and other similar structures, in accordance with the requirements, of these specifications and the lines and dimensions shown on the drawings or as indicated by the Engineer-in-charge. The work shall include all necessary sheeting, shoring, bracing, draining and pumping and the removal of all logs, stumps, shrubs, and other deleterious matter and obstruction necessary for the foundations, trimming bottoms of excavations; back filling and clearing up the site and the disposal of all surplus materials.

2. After the site has been cleared the limits of excavations shall be set out true to lines, curves, slopes, grades and sections as shown on the drawings or as directed by the Engineer-in-charge. The contractor shall provide all labour, survey instruments and materials such as stirrings, pegs nails bamboos, stones, lime, mortar, concrete etc. required in connection with the sitting out of works and the establishment of bench mark, center line stones and other marks and stakes as long as in the opinion of the Engineer-in-charge, they are required for the work.

3. Excavation shall be taken to the width of the step of the footing. The contractor at his own expense shall put up necessary shoring, strutting, and planking or cut slopes to a safer angle or both with due regard to the safety of personal and works and to the satisfaction of the Engineer-in-charge.

4. The depth to which the excavation is to be carried out shall be as shown on the drawings, unless the type of materials encountered is such as to require changes, in which case the depth shall be as ordered by the Engineer-in-charge.

5. Where water is met with in excavation due to stream flow, seepage, rain or other reasons, the contractor shall take adequate measure such as bailing pumping, to keep the foundation trenches dry when so required and to protect the green concrete/masonry against damage by erosion of sudden rising of water level.. the methods to be adopted in this regard and other details thereof shall be left to the choice of the contractor but subject to approval of the engineer-in-charge. Approval of the Engineer-in-charge shall, however not relieve the contractor of the responsibility for the adequacy of dewatering, and production arrangements and for the quality and safety of the works.

6. Pumping from the interior of any foundation enclosure shall be done in such a manner as to preclude the possibility of movement of water through any fresh concrete. No pumping shall be permitted during the placing of concrete or for any period of at least 24 hours thereafter, unless it is done from a suitable sump separated from the concrete work by a water tight wall or other similar means.

7. The bottom of the foundation shall be leveled both longitudinally and transversely or stepped as directed by the Engineer-in-Charge. Before footing is laid, the surface shall be slightly watered and rammed. In the event of excavation having been made deeper than that shown on the drawing or as otherwise ordered by the Engineer-in-charge, the extra depth shall be made up with concrete or masonry of the foundation grade at the cost of the contractor. Ordinary filling shall not be used for the purposes to bring the foundation to level. If there are any slips or blows in the excavation, these shall be removed by the contractor at his own cost.

8. Near towns, villages and all frequented places, trenches and foundation pits shall be securely fenced, provided with proper caution signs and marked with red light at night to avoid accidents. The contractor shall take adequate protective measures to see that the excavation operations do not affect or damage adjoining structures.

9. Backfilling shall be done with approved materials after concrete or masonry is fully set and carried out in such a way as not to cause undue thrust on any part of the structure. All space between foundation masonry or concrete and the sides of excavation shall be refilled to the original surface, making due allowance for settlement in 20mm loose layers, which shall be watered and compacted.

10. All the excavated materials shall be the property of the Government. Where the excavated materials are to be used in the construction of embankment, it shall be directly deposited at the required location within 100 metres lead.

11. all useful materials not intended for use in the bank, shall be stacked neatly on Government land as directed by the Engineer-in-charge within 100 metres lead. Unsuitable and surplus, materials not intended for use shall be disposed off as directed by the Engineer-in-charge.
12. Excavation for structures shall be measured in cubic metres for each class of materials encountered, limited to the dimensions shown on the drawing or as directed by the Engineer-in-charge. Excavation over increased width cutting of slopes, shoring, shuttering and planking shall be deemed as convenience for the contractor in executing the work and shall not be measured and paid for separately.
13. The contract unit rate for the items of excavation for structures shall be paid in full for carrying out the required operations including:
14. Excavation shall be in any rock or boulders having diameter in any one direction of more than 300 mm. for which the use of mechanical plant or blasting is required. The classification of excavation shall be decided by the Engineer-in-charge and his decision shall be final and binding on the contractor. Merely the use of explosive in excavation will not be considered as a reason for higher classification unless blasting is clearly necessary in the opinion of the Engineer-in-charge.
15. Where blasting is prohibited for any reason, excavation shall be carried out by chiseling, wedging or any other approved method.
16. Blasting shall be carried out only with the written permission of the Engineer-in-charge. All the statutory laws, regulations, rules etc pertaining to the acquisition transport, storage, handling and use of explosive shall be strictly followed.
17. The contractor may adopt any method or methods of blasting consistent with the safety and job requirements, after approval from the Engineer-in-charge.
18. the magazine for the storage of explosive shall be built to the design and specifications of the Explosives Department concerned and located at the approved site. No unauthorized person shall be admitted into the magazine which when not use shall be kept securely located. No matches or inflammable materials shall be allowed in the magazine. The magazine shall have any effective lightning conductor. The following shall be hung in the lobby of magazine.
- (a) A copy of the relevant rules regarding safe storage both in English and in the language with which the workers concerned are familiar.
  - (b) A statement of up-to-date stock in the magazine.
  - (c) A certificate showing the last date of testing of the lightning conductor.
  - (d) A notice that smoking is strictly prohibited.
19. IN addition to these, the contractor shall also observe the following instructions and any further additional instructions which may be given by the Engineer-in-charge and shall be responsible for damage to property and any accident which may occur to workmen or the public on account of any operations connected with the storage handling of use of explosive and blasting. The Engineer-in-charge shall frequently check the contractor compliance with these precautions.
20. All the materials, tools and equipment used for blasting operations shall be approved type. The Engineer-in-charge may specify the type of explosive to be allowed in special cases. the fuse to be used in wet locations shall be sufficiently water-resistant as to be unaffected when immersed in water for 30 minutes. The rate of burning of the fuse shall be uniform and definitely known to permit such a safe length being cut as will permit sufficient time to time firer to reach to place of safety before explosion takes place. Detonators shall be capable of giving effective blasting of the explosives. The blasting powder, explosive detonators, fuses, etc. shall be fresh and not damaged due to damp, moisture or, any other cause. They shall be inspected totally and removed immediately if found unsuitable.
21. The blasting operation shall remain in charge of competent and experienced supervisory staff and workmen who are thoroughly acquainted with the details of handling explosives and blasting operators.
22. The blasting shall be carried out during fixed hours of the day preferably during the mid-day luncheon hour or at the close of the work as ordered in writing by the Engineer-in-charge. The hours shall be made known to the people in the vicinity. All the charges shall be prepared by the man in charge only.
23. Red danger flags shall be displayed permanently in all directions during the blasting operations. People, except those who actually light the fuse, shall be prohibited from entering this area. The flags shall be planted 200 Metres from the blasting site in all directions and all persons including workmen shall be excluded from the flagged area at least 10 minutes before the firing a warning whistle being sounded for the purpose.

24. The charge holes shall be drilled in suitable places to required depths. Blasting should be as light as possible consistent with thorough breakage of the materials necessary for economic loading and hauling. Any method of blasting which leads to over-shooting shall be discontinued.

25. When blasting is done with powder, the fuse cut to the required length shall be inserted into the hole and the powder dropped in. The powder shall be gently tamped with copper rods with rounded ends. The explosive powder shall then be covered with tamping materials which shall be tamped light but firmly.

26. When blasting is done with dynamite and other high explosives, dynamite, cartridges shall be prepared by inserting the square cut end of a fuse into the detonator and finishing it with nippers at the open end., the detonator gently pushed into the primer leaving 1/3<sup>rd</sup> of copper tube exposed outside. The paper of the cartridge shall then be closed up and securely bound with wire, or twine. The primer shall be housed into the explosive. Bore holes shall be of such size that the cartridge can easily go down. The holes shall be cleared of all debris and explosive inserted. The space of about 20 cm. above the charge shall then be gently filled with dry clay, passed home & the rest of the tamping formed of any convenient materials gently packed with a wooden rammer.

27. At a time, not more than 10 such charges will be prepared and fired. The man incharge shall blow a whistle in a recognized manner or cautioning the people. All the people shall then be required to move to safe distance. The charge shall be lighted by the man in charge only, the man in charge shall count the number of explosions. He shall satisfy himself that all the charges have been exploded before allowing the workmen to go back to the work site.

28. In case of a misfire, the following procedure shall be observed:

(1) sufficient time shall be allowed to account for the delayed blast. The man in charge shall inspect all the charges and determine the missed charges.

(2) If it is blasting powder charge it shall be completely flooded with water. A new hole shall be drilled at about 45cm. from the old hole and fired. This should be repeated till the old charge is blasted.

(3) In case of charges of gelatine, dynamite etc. the man in charge shall gently remove the tamping and the primer with the detonator. A fresh detonator and primer shall then be used to blast the charge.

Alternatively, the hole may be cleared of 30cm. of tamping and the direction then ascertained by placing a stick in the hole. Another hole may then be drilled 15cm. away and parallel to it. This hole shall then be charged and fired when the misfired hole should explode at the same time. The man in charge shall at once report to the contractor's Officer and Engineer-in-charge all cases of misfire, the cause of the same and what steps were taken in connection therewith.

29. If a misfire has been found to be due to defective detonator or dynamite, the whole quantity in the box from which defective article was taken must be sent to the authority directed by the Engineer-in-charge for inspection to ascertain whether all the remaining materials in the box are also defective.

30. A careful and day to day account of the explosive shall be maintained by the contractor in an approved manner in a register which shall be open to inspection by the Engineer-in-charge, at all times.

31. Excavation shall be measured after removal of overburden by taking cross-sections at suitable intervals in the original position before the work starts and after its completion and computing the volumes in cubic metres by the method of average and areas. Where it is not feasible to compute volumes by this method because of erratic location of isolated deposits, the volumes shall be computed by other accepted methods. At the option of the Engineer-in-charge, the contractor shall leave depth indicators during excavations of such shape and size, and in such positions as directed so as to indicate the original ground level as accurately as possible. The contractor shall see that these remain intact till the final measurements are taken. Where cross-sectional measurements, could not be taken due to irregular configuration, or where the rock is admixed with other classes of materials, the volumes shall be computed on the basis of stacks of excavated rubble after making 40 per cent deduction therefrom.

32. [Payment shall made on Cum basis](#)

### **Item No. 17**

**Providing and fixing Mild steel dowel bar of minimum 32mm dia. For anchoring by drilling holes in foundation strata including necessary bending, hooking of dowel bars and grouting the holes complete as per detailed drawing and as directed.**

1. For mild steel, specification as per item No. 60 for MS reinforcement shall apply.
2. The M.S. Dowel bars shall be provided and anchored in foundation / sub structure as directed by Engineer-in-charge or as per drawing shall be provided as approved by Engineer-in-charge.
- 3. The payment shall be per Rmt of dowel bars in anchored condition.**
4. Unit rate included cost of all materials, labour, and equipment to complete the job.

### **Item No. 18**

**Providing and casting in situ ordinary cement concrete M-150 mix and providing necessary pin headers including shuttering, scaffolding, laying vibrating, curing and finishing complete Without V-Grooves For all Height.**

**And**

### **Item No. 19**

**Providing and filling in foundation with ordinary cement concrete M-10/M-100 mix and providing necessary vertical pin headers incl. Formwork, vibrating, ramming and curing complete.**

1. In case of ordinary concrete, mix is not required to be designed by preliminary tests and proportion of cement, fine aggregate and coarse aggregates are specified by volume as given in table below for different grades of concrete designed as ordinary M. 100. , M. 150, M.200 and M.250.
2. In the designation of a concrete mix, letter “M” refers to the mix and the number the specified 28 days works cube compressive strength of that mix on 150mm cubes expressed in kg./ cm<sup>2</sup>.
3. The ordinary concrete mix shall generally be specified by volume. For cement which normally comes in bags and is used by weight, volume shall be worked out taking 50kg. of cement as 0.035 cubic metre in volume. While measuring aggregate by volume, shaking, ramming or hammering shall not be done. Proportioning of sand shall be as per its dry volume. In case it is dump, allowance for “bulking” shall be made as per IS: 2386 (Part-III).
4. Ingredients required for ordinary concrete containing one 50 kg bag of cement of different proportions of mix shall be as given in Table below.

**TABLE**

Grade of Concrete	Mix By Volume	Total quantity of dry aggregates by volume per 50 Kg. of cement, to be taken as sum of the individual volumes of fine and coarse aggregates max.,	Proportion of fine aggregate to coarse aggregate	Quantity of water per 50 kg. of cement max.
1	2	3	4	5
Ordinary M.100	Litres 1:3:6	300	General 1:2 for fine aggregate to coarse aggregate by volume but subject to a upper limit of 1:1.1/2 & 2 lower limit of 1:3	Litres 34
M.150	1:2:4	220		32
M.200	1:1 1/2:3	160		30
M.250	1:1:2	100		27

- NOTE:-** The proportions of the aggregates shall be adjusted from upper limit to lower limit progressively as the grading of the fine aggregates becomes finer & the maximum size of coarse aggregate becomes larger.
- Example:-** For an average grading of fine aggregate (that is Zone II of IS: 383-1963) the proportions shall be 1: 1 1/2, 1:2 and 1:3 for maximum size of aggregates 10mm, 20mm, and 40mm respectively (after carrying out sieve analysis).
- Note-2** A mix leaner than M.100 (1:3:6) may be used for non-structural parts, if provided in the contract. In such case grading of aggregates shall be by volume. Other requirements for mixing, placing & curing shall be the same.

5. Following shall be the maximum nominal size of coarse aggregate, for the different items of work:

Sr. No.	Item of Construction	Maximum nominal size of coarse aggregate
(i)	R.C.C. well curb, R.C.C. well steining and R.C.C. Piles	40mm
(ii)	R.C.C. well steining	63mm
(iii)	Well cap or pile cap; solid type piers, abutment and wing-walls, and their pier caps	40mm
(iv)	R.C.C. Works in cross girders deck slab, wearing coars, kewrb, light posts, blast walls, approach slab etc. and hollow type piers, abutments, wing-walls and their pier caps.	20mm
(v)	R.C.C. bearings	20mm
(vi)	For any other item of construction not covered by item (i) to (v)	As specified on the drawing or as desired by the Engineer- in-charge in case it is not specified on drawing.

For heavily reinforced concrete members as in the case of ribs of main beams nominal maximum size of aggregate shall usually be restricted to 5 mm. Less than the minimum lateral clear distance between the main bars or 5mm less than the minimum cover to the reinforcement, whichever is the smaller.

6. Fine aggregate shall be clean, hard, coarse sand, It shall be free from dust and such other substances. The sand be got approved by the Engineer-in-charge.

7. All materials shall be stored as to prevent their deterioration or instruction of their quality and fitness for the work. Any material which has deteriorated or has been damaged or is otherwise considered defective by the Engineer-in-charge shall not be used in the works.

8. Cement shall be stored above the ground level in perfectly and water tight shed. Wherever bulk storage containers are used, their capacity should be sufficient to cater to the requirements at site and should be cleaned at least once every 3 to 4 months. The aggregate shall be stored in such a way as to prevent admixture of foreign materials. Different size of fine or coarse aggregate shall be stored in separate stock-piles sufficiently away from the each other to prevent intermixing the materials.

9. The water for mixing shall be potable water to satisfaction of the Engineer-in-charge. The quantity of water shall be just sufficient to produce a dense concrete of required workability for the job.

10. For all work concrete shall be mixed in a mechanical mixer which along with other accessories shall be kept in first class working condition and so maintained through the construction. Mixing shall be continued till materials are uniformly distributed and uniform colour of the entire mass is obtained and each individual particle of the coarse aggregate show complete coating of mortar containing its proportionate amount of cement, In no case shall the mixing be done for less than 2 minutes after all ingredients have been put into the mixer.

11. When hand mixing is permitted by the Engineer-in-charge for small jobs or for certain other reasons. It shall be done on a smooth watertight platform large enough to allow efficient turning over of the ingredients of concrete before and after adding water. Mixing platform shall be so arranged that no foreign materials shall get mixed with concrete nor does the mixing water flow out. Cement in required number of bags shall be placed in a uniform layer on top of the measured quantity of fine and coarse aggregate, which shall also be spread in a layer of uniform thickness on the mixing platform. Dry coarse and fine aggregate and cement shall then be mixed thoroughly by turning over to get a mixture of uniform colour. Enough water shall then be added gradually through a rose can and the mass turned over till a mix of required consistency is obtained. In hand mixing quantity of cement shall be increased by 10 per cent above that specified.

12. Mixers which have been out of use for more than 30 minutes shall be thoroughly cleaned before putting in a new batch. Unless otherwise agreed to be the Engineer-in-charge, the first batch of concrete from the mixer shall contain only two thirds of normal quantity of coarse aggregate. Mixing plant shall be thoroughly cleaned before changing from one type of cement to another.

13. The method of transporting and placing concrete shall be approved by the Engineer-in-charge. Concrete shall be so transported and placed that no contamination, segregation or loss of its constituent materials takes place. All form work and reinforcement contained in it shall be cleaned and made free from standing water, dust, snow or ice immediately before placing of concrete. No concrete shall be placed in any part of the structure until the approval of the Engineer-in-charge has been obtained.

14. If concreting is not started within 24 hours of the approval given, it shall have to be obtained again from the Engineer-in-charge. Concreting being given, it shall proceed continuously over the area between construction joints. Fresh concrete shall not be placed against concrete which has been in position for more than 30 minutes unless a proper construction joint is formed. Concrete shall be compacted in its final position within 30 minutes of its discharge from the mixer unless carried in properly design agitators, operating continuously, when this time shall be with 2 hours of the addition of cement to the mix and within 30 minutes of its discharge from the agitator. Except where otherwise agreed to be the Engineer-in-charge, concrete shall be deposited in horizontal layers to a compacted depth of not more than 0.45 metre when internal vibrators are used and not exceeding 0.30 metre in all other cases.

15. Unless otherwise agreed to by the Engineer-in-charge concrete shall not be dropped into place from a height exceeding 2 metres. When trunking or chutes are used they shall be kept clean and used in such a way as to avoid segregation. When concreting has to be resumed on a surface which has hardened, it shall be roughened, swept, clean, thoroughly wetted and covered with a 13 mm thick layer of mortar composed of cement and sand in the same ratio as in the concrete mix itself. This 13mm layer of mortar shall be freshly mixed and placed immediately before placing of new concrete. Where concrete has not fully hardened, all laitance shall be removed by scrubbing the well surface with wire or bristle brushes, care being taken to avoid dislodgement of any particles of coarse aggregate. The surface shall then be thoroughly wetted, all free water removed and then coated with neat cement grout. The first layer of concrete to be placed on this surface shall not exceed 150mm in thickness, and shall be well rammed against old work particular attention being given to corners and close spots.

16. All concrete shall be compacted to produce a dense homogeneous mass with the assistance of vibrators, unless otherwise permitted by the Engineer-in-charge for exceptional cases, such as concreting under water, where vibrators can not be used, Sufficient vibrators in serviceable condition shall be kept at site so that spare equipment is always available in the event of break downs.

17. Immediately after compaction, concrete, shall be protected against harmful effects of weather, including rain, running water, shocks, vibration, traffic, rapid temperature changes, frosts and drying out process. It shall be covered with wet sacking, hessian or other similar absorbent material approved by the Engineer-in-charge soon after the initial set, and shall be kept continuously wet for a period of not less than 14 days from the date of placement. Masonry work over the foundation concrete may be started after 48 hours of its laying but the curing of concrete shall be continued for a minimum period of 14 days.

18. Formwork shall include all temporary or permanent forms required for forming the concrete, together with all temporary construction required for their support. Formwork shall however be divided into following two distinct categories:-

- (1) Shuttering i.e. form work required for forming the concrete.
- (2) Scaffolding i.e. form work required for supporting shuttering.

Forms for shuttering shall be constructed only in metal suitable lined. Forms for scaffolding shall be constructed for metal or timber. Both shuttering and scaffolding shall be of substantial rigid construction and shuttering shall be true to shape and dimensions shown on the drawings. All bolts and rivets shall be counter-sunk and well ground to provide a smooth, true surface.

19. Forms shall be mortar-tight and shall be made sufficiently rigid by the use of ties and bracings to prevent any displacement or sagging between supports. They shall be strong enough to withstand all pressure, ramming and vibration, without deflection from the prescribed line occurring during and after placing the concrete. Screw jacks or hard wood wedges where required shall be provided to make up any settlement in the form work either before or during the placing of concrete. Suitable camber shall be provided in horizontal members of structure, specially in long spans to counteract the effects of any fixed as to provide such camber. Forms shall be so constructed as to be removable in sections in the desired sequence, without damaging the surface of concrete or disturbing other sections. Unless otherwise specified or directed, chamfers or fillets of sizes 25mm x 25mm shall be provided at all angles of formwork to avoid sharp corners.

20. The inside surface of shuttering shall, except in the case of permanent form work or where otherwise agreed to by the Engineer-in-charge, be coated with an approved material to prevent adhesion of concrete to the formwork. Release agents shall be applied strictly in accordance with the manufacturer's instructions and shall not be allowed to come into contact with any reinforcement or prestressing tendons and anchorages. Different release agents shall not be used in form work for concrete which will be visible in the finished works.

21. Special measures shall be taken to ensure that the formwork does not hinder the shrinkage of concrete because without these cracking could occur before the formwork is removed. Wherever applicable arrangements must be made to ensure that the formwork does not restrain the shortening and hogging of the beams or slabs during tensioning of the tendons. The formwork should take due account of the calculated amount of positive or negative camber so as to ensure the correct final shape of the structures having regard to the deformation of a formwork, scaffolding or propping and the instantaneous or deferred deformation due to various causes affecting prestressed structures. Where there are re-entrant angles in the concrete sections the formwork should be removed at those sections as soon as possible after the concrete has set in order to avoid cracking due to shrinkage of concrete. Formwork shall be tight enough to prevent any appreciable loss of cement during vibrations, suitable tolerances should be provided in the formwork. Immediately before concreting all forms shall be thoroughly cleaned. Contractor shall give the Engineer-in-charge due notice before placing any concrete in the forms to permit him to inspect and accept the formwork and forms as to their strength alignment and general fitness, but such inspection shall not relieve the contractor of his responsibility for safety of men, machinery, materials and or results obtained.

22. The Engineer-in-charge shall be informed in advance by the contractor of his intention to strike any formwork. While fixing the time for removal of formwork, due consideration shall be given to local conditions, character of the structure, the weather and other conditions that influence the setting of concrete and of the materials used in the mix. Where field operations are controlled by strength tests of concrete, the removal of the load-supporting or soffit forms may commence when concrete has attained strength equal to at least twice the stress to which the concrete will be subjected at the time of striking props including the effect of any further addition of loads. When field operations are not controlled by strength tests of concrete the vertical forms of beams, columns and walls may be removed after 2 days. The props of slabs and beams may be removed after 14 and 21 days respectively. All formwork shall be removed without causing any damage to the concrete. Centering shall be gradually and uniformly lowered in such a manner as to permit the concrete to take stresses due to its own weight uniformly and gradually. Where internal metal ties are permitted, they or their removable parts shall be extracted without causing any damage to the concrete and remaining holes filled with mortar. No permanently embedded metal part shall have less than 25 mm. cover to the finished concrete surface. Where it is intended to reuse the formwork, it shall be cleaned and made good to the satisfaction of the Engineer-in-charge.

23. Immediately after the removal of forms, all exposed bars or bolts passing through the concrete member and used for shuttering or any other purposes shall be cut inside the concrete

member to a depth of at least 25mm. below the surface of the concrete and the resulting holes be filled by cement mortar. All fins caused by form joints, all cavities produced by the removal of form ties and all other holes and depressions, hone comb spots, broken edges or comers and other defects, shall be thoroughly cleaned, saturated with water and carefully pointed and rendered true with mortar of cement and fine aggregate mixed in the proportions used in the grade of concrete that is being finished and of as dry as consistency as is possible to use, considerable pressure shall be applied in filling and pointing to ensure thorough filling in all voids, surface which have been pointed shall be kept moist for a period of twenty four hours. If rock pockets/ honeycombs, in the opinion of the Engineer-in-charge are of such an extent or character as to affect the strength of the structure materially or to endanger the life of the steel reinforcement, he any declare the concrete defective and require the removal and replacement of the portions of the structure affected.

24. In the case of reinforced concrete work workability shall be such that the concrete surrounds and properly grips all reinforcement. The degree of consistency, which shall depend upon the nature of work and methods of vibration of concrete shall be determined by regular slump tests. Following slump shall be adopted for different types of works.

Type of work		Where vibrators are used	Slumps Where vibrators are not used
(i)	Mass concrete in R.C. C. foundations, footings and retaining walls	10mm to 25mm	80mm
(ii)	Beams, slabs and columns simply reinforced	25m to 40mm	100mm to 120mm
(iii)	Thin R.C.C. section or section with congested steel	40mm to 50mm	125mm to 150mm

25. Works strength tests shall be made in accordance with IS:516. Each test shall be conducted on ten specimens, five of which shall be tested at seven days and the remaining five at 28 days. The samples of concrete shall be taken on each day of concreting and cubes shall be made at the rate of one for every 5 cubic metre of concrete or a part thereof. However, if concreting done in a day in less than 15 cubic Metree, the minimum number of cubes can be reduced to 6 with the specific permission of the Engineer-in-charge, similar works tests shall be carried out whenever the quality and grading of materials is charged irrespective of the quantity of concrete proud. The number of specimens may be suitably increased as deemed necessary by the Engineer-in- charge when procedure of tests given above reveal a poor quality of concrete and in other special cases.

26. The average strength of the group of cubes cast for each day shall not be less than the specified works cube-strength. 20 per cent of the cubes cast for each day may have values less than the specified strength, provided the lowest value is not less than 85 per cent of the specifies strength.

27. R.C.C. work shall have exposed concrete surface. Centering design and its erection shall approved by he Engineer-in- charge. One carpenter with helper will invariably be kept present throughout the period of concreting. Movement of labour and other persons shall be totally prohibited over reinforcement laid in position. For access to different parts, suitable mobile platforms shall provided so that steel reinforcement in position is not disturbed. For ensuring proper cover, motar blocks of suitable size shall be cast and tied to the reinforcement. Timber, kapchi, or matal pieces shall not be used for this purpose. Concreting of important structural members shall always be done in the presence and under the supervision of department person not below the rank of Asstt. Engineer/ Addi-Asstt. Engineer Overseer or as instructed by the Engineer-in- charge. After removal of form work checks that concrete produced is of good quality. Plastering shall not be allowed to the expressed faces of concrete.

28. In reinforced concrete the volume occupied by reinforcement shall not be deducted. The slab shall be measured as running continuously through and the beam as the portion below the slab.

29. All necessary labour, materials equipment, etc. for sampling, preparing test cubes, curing etc., shall be provided by the Contractor. Testing of the materials and concrete may be arranged by Engineer-in-charge in an approved labouratory at the cost of the contractor.

**30. The payment will be made on cmt. basis of the finished work.**

31. The unit rate for concrete shall include the cost of all materials, labour, tools and plan required for mixing, placing in position, vibrating and compacting finishing as per directions of the Engineer- in-charge, curing and all other incidental expenses for producing concrete of specified strength to complete

the structure or its components as show on the drawings and according to these specifications. The rate shall also include the cost of making/ fixing and remixing of all centers and forms required for the work.

### **Item No. 20**

**Providing and casting in situ Controlled cement concrete M-200 for R.C.C. work in Piers, abutment, returns and riding returns as per drawing including centering, shuttering, scaffolding where necessary laying, vibrating curing and finishing complete (A) For all Height**

**And**

### **Item No. 21**

**Providing and casting in situ Contolled Cement concrete M 200 mix for R.C.C. works in pier cap, abutment cap, and dirt wall including controlled cement concrete M 250 bed block or pedestals for required size below bearings as per detailed drawings, centering, shuttering, scaffolding wherever necessary laying, vibrating, curing and finishing complete..**

**And**

### **Item No. 22**

**Providing and casting in situ Controlled cement concrete M 250 for R.C.C. Solid slab including centering, scaffolding, curing and finishing complete..**

**And**

### **Item No. 23**

**Providing and casting in situ Contolled cement concrete- M-200 for average 75/150/200mm thick wearing coat laid as directed incuding. tamping, vibrating, finishing, curring and filling in joints with bitumen complete.**

**And**

### **Item No. 24**

**Providing and casting in situ Contolled cement concrete- M-200 mix for Approach slab including formwork, curing and finishing complete..**

**And**

### **Item No. 25**

**Providing and casting in situ Controlled cement concrete- M-200 mix for kerbs/Kerb blocks including formwork,curing and finishing complete..**

1. For controlled concrete, design of the mix shall be approved after preliminary tests and all necessary precautions shall be taken in its production to ensure that the required works cube strength is attained and maintained. The controlled concrete shall be in eight grades designed as M.100, M. 150, M.200, M.250, M.300, M.350, M.400, M.450 with the suffix 'controlled' added to it.

2. In the designation of a concrete mix, letter 'M' refers to the mix and the number to the specified 28 days works cubs compressive strength of that mix on 150 m. cubes, expressed in kg/cm. where ordinary. Portland cement conforming to IS:269 or Portland blast furnace cement conforming to IS:455 is used. the compressive strength requirements for various grades of concrete shall be as given below on the next page:

Grade of Concrete	Compressive works test strength in Kg. / cm <sup>2</sup> on 150mm, cubes, conducted in accordance with IS: 516	
	Min. at 7 days	Min.at 28 days
M 100 ...	70	100
M 150 ...	100	150
M 200 ...	135	200
M 250 ...	170	250
M 300 ...	200	300
M 350 ...	235	350
M 400 ...	270	400
M 450 ...	300	450

**NOTE:** In cases the 28 days compressive strength specified in the above. Table shall alone be the criterion for acceptance or rejection of the concrete.

Where the strength of a concrete mix, as indicated by tests, lies in between the strength for any two grades specified in the above. Table such concrete shall be classified for all purposes as a concrete belonging to the lower or the two grades between which its strength lies.

3. Concrete mix shall be designed on the basis of preliminary tests so as attain a strength at least 33 per cent higher than that required on work tests. The proportions for ingredients chosen shall be such that concrete has adequate workability for conditions prevailing on the work in question and can be properly compacted with the means available. Except where it can be shown to the satisfaction of the Engineer-in-charge that supply of properly graded aggregate of uniform quality can be maintained till the completion of work, grading of aggregate should be controlled by obtaining the coarse aggregates in different sizes and bleeding them in the right proportions as required. Aggregates of different size shall be stocked in separate stock piles. Required quantity of material shall be stock piled several hours, preferably a day, before use. Grading of coarse and fine aggregate shall be checked as frequently as possible, frequency for a given job being determined by the Engineer-in-charge to ensure that the suppliers are maintaining the uniform grading as approved for samples used in the preliminary tests.

4. In proportioning concrete, the quantity of both cement and aggregate shall be determined by weight. Where the weight of cement is determined by accepting the majors weight per beg, a reasonable number of bags shall be weighed separately to check the net weight. Where cement is weighed from bulk stocks at site and not by bags, it shall be weighed separately from the aggregates. Water shall either be measured by volume in calibrated tanks or weighed. All measuring equipment shall be maintained in a clean, and serviceable condition. Their accuracy shall be periodically checked.

5. It is most important to keep the specified water cement ration constant and at its correct value. To this end, moisture content in both fine and coarse aggregate shall be determined by the Engineer-in-charge according to the weather conditions. The amount of mixing water shall then be adjusted to compensate for variations in the moisture cement. For the determination of moisture content in the aggregates IS: 2386 (Part-III) shall be referred to. Suitable adjustment shall also be made in the weights of aggregates to allow for the variation in weights of aggregates due to variation in their moisture content Minimum quantity of cement to be used in controlled concrete shall not be less than 210 Kg. per cubic metre in plain concrete and not less than 300 kg/.per cubic metre in reinforced concrete structural members. The minimum quantity of cement for professed concrete work shall not less than 360 kg/p[er cubic metre of concrete nor shall it be more than 540 kg/per cubic metre of concrete.

6. Following shall be the maximum nominal size of coarse aggregate for the different items of work.

Sr. No.	Item of construction	Maximum nominal size of Coarse aggregate
(i)	R.C.C. well curb, R.C.C. well steining and R.C.C. Piles	40mm
(ii)	P.C.C. well steining.	63mm
(iii)	Well cap or pile cap, solid type pires, abutments and wing- walls, their pier caps.	40mm
(iv)	R.C.C. works in cross girders, deck slab, wearing coarse, kerb, light posts, blast, walls approach slab etc. and hollow type piers, abutments wing-walls and their pier caps.	20mm
(v)	R.C.C. bearings	20mm
(vi)	For any other item of construction covered by items (i) to (v) above	As specified on the drawing or as desired by the Engineer-in-charge in case it is not specified on drawing.

For heavily reinforced concrete members as in the case of ribs of main beams, nominal maximum size of aggregate shall usually be restricted to 5mm less than the minimum lateral clear distance between the main bars of 5mm. less than the minimum cover to the reinforcement whichever is the smaller.

7. Fine aggregate shall be clean, hard, coarse sand. It shall be free dust and such other substances. The sand be get approved by the Engineer-in- charge.

8. All materials shall be stored as to prevent their deterioration of there quality and fitness for the work. Any materials which has deteriorated or has been damaged or is otherwise considered defective by the Engineer-in- charge shall not be used in the works.

9. Cement shall be stored above the ground level in perfectly dry and watertight sheds. Wherever bulk storage containers are used, their capacity should be sufficient to cater to the requirements at site and should be cleaned atleast once every 3 to 4 months. the aggregates shall be stored in such a way as to prevent admixture of foreign materials. Different sizes of fine or coarse aggregate shall be stored in separate stock piles sufficiently away from such other to prevent intermixing the materials.

10. the water for mixing shall be potable water to satisfaction of the Engineer-in- charge. The quantity of water shall be just sufficient to produce a dense concrete of required workability for the job.

11. For all work concrete shall be mixed in a mechanical mixer which alongwith other accessories shall be kept in first class working condition and so maintained throughout the construction Mixing shall be continued till materials are uniformly distributed and uniform colour of the entire mass is obtained and each indiua particle of the coarse aggregate shows complete coating of mortar containing its proportionate amount of cement. In no case shall the mixing be done for less than 2 minutes after all ingredients have been put into the mixer.

12. Mixer which have been out of use more than 30 minutes shall be thoroughly cleaned before putting in a new batch. Unless otherwise agreed toi be the Engineer-in- charge, the first batch of concrete from the mixer shall contain only two thirds of normal quantity of coarse aggregate. Mixing plant shall be thoroughly cleaned before changing from one type of cement to another.

13. The method of transporting and placing concrete shall be approved by the Engineer-in- charge. Concrete shall be so transported and placed that no contamination, segregation or loss of its constituent materials takes place. All form work and reinforcement contained in it shall be cleaned and made free from standing water, dust, snow or ice immediately before placing of concrete. No concrete shall be placed in any part of the structure until the approval of the Engineer-in- charge has been obtained.

14. If concreting is not started within 24 hours of the approval being given. It shall have to be obtained again from the Engineer-in- charge. Concreting then shall proceed continuously over the area between construction joints. FResh concrete shall not be placed against concrete which has been in position for more than 30 minutes unless a proper construction joint is formed. Concrete shall be compacted in its final position within 30 minutes of its discharge from the mixer-unless carried in properly design agitators, operating continuously when this time shall be within hours of the addition of cement to the mix an within minutes of its discharge from the agitator. Except where otherwise agreed to be the. Concrete shall be deposited in horizontal layers to a compacted depth of not more than .5 metre when internal vibrator are used not exceeding . metre in all other cases.

15. Unless otherwise agreed to be the Engineer-in-charge concrete shall not be dropped into place from a height exceeding metres. When trunking or chutes are used they shall be kept clean and used in such a way as to avoid segregation. When concreting has to be resumed on a surface which has hardened, it shall be roughened, swept clean, thoroughly wetted and covered with a 13mm. thick layer or mortar composed of cement and sand in the same ratio as in the concrete mix itself. This 13mm layers of mortar shall be freshly mixed and placed immediately before placing of new concrete. Where concrete has not fully hardened, all laitance shall be removed by scrubbing the wet surface with wire or bristle brushes, care being taken to avoid dislodgement of any particles of coarse aggregate. The surface shall then be thoroughly wetted, all free water removed and then coated with neat cement grout. The first layers of concrete to be placed on this surface shall not exceed 150mm. in thickness and shall be well rammed against old particular attention being to comers and close sports.

16. All concrete shall be compacted to produce a dense homogeneous mass with the assistance of vibrators, unless otherwise permitted by the Engineer-in-charge for exceptional cases, such as concreting under water, where vibrators can not be used. Sufficient vibrator in serviceable condition shall be kept at site so that spare equipment is always available in the event break downs.

17. Immediately after compaction, concrete shall be protected against harmful effects of weather including rain, running water, shocks, vibration, traffic, rapid temperature changes, frost and drying out process. It shall be covered with wet sacking, hessian or other similar absorbant materials approved by the Engineer-in-charge soon after the initial set, and shall be kept continuously wet for a period of not less than 14 days from the date of placement. Masonary work over the foundation concrete may be started after 48 hours of its laying but the curing of concrete shall be continued for a minimum period of 14 days.

18. Form work shall include all temporary or permanent forms required for forming the concrete, together with all temporary construction required for their support. Formwork shall however be delived into following two distict categories:

(1) Shuttering i.e. from work required for forming the concrete.

(2) Scaffolding i.e. form work required for supporting shuttering.

Forms for shuttering shall be constructed only, in metal suitably lined. Forms for scaffolding shall be constructed of metal or timber. Both shuttering and scaffolding shall be substantial rigid construction and shuttering shall be true to shape and dimensions show on the drawings. All bolts and riverts shall be counter-sunk and well ground to provide a smooth, plane surface.

19. Forms shall be mortar-tight and shall be made sufficiently rigid by the use of ties and bracings to prevent any displacement or sagging between supports. They shall be strong enough to with stand all pressure ramming and vibration, without deflection from the prescribed lines occurring during and after placing the concrete. Screw jacks or hardwood wedges where required shall be provided to make up any settlement in the formwork either before or during the placing of concrete. Suitable camber shall be provided in horizontal members of structure specially in long spans to conterate the effects of any deflection. The formwork shall be so fixed as to provide for such camber, forms shall be so constructed as to be removable in sections in the desired sequence. Without damaging the surface of concrete or disturbing other sections. Unless otherwise specified or directed, chamfer or filletllls or sizes 25mm x 25mm shall be provided at all angles of form work to avoid sharp comers.

20. The inside surface of shuttering shall, except in the case of permanent form work or where otherwise agreed to be the Engineer-in-charge, be coated with an approved material to prevent adhesion of concrete to the form work. Release agents shall be applied strictly in accordance with the manufacture instructions and shall not be allowed to come into contact with any reinforcement or prestressing tendons and anchorages. Different release agent shall not be used in form work for concrete which will be visible in the finished works.

21. Special measures shall be taken to ensure that the form does not hinder the shrinkage of concrete because without these cracking could occur before the form work is removed. Wherever applicable arrangements must be made to ensure that the form work does not restrain the shortening and hogging of the beams or slabs during tensioning of the tendons. The form work should take due account of the calculated amount of positive or negative camber so as to ensure the correct final shape of the structure having regard to the deformation due of false work, scaffolding or propping and the instructure or deferred deformation due to various causes affecting prestressed structures. Where they are re-entrant angles in the concrete sections the form work should be removed at these sections as soon as possible after the concrete has set in order to avoid cracking due to shrinkage of concrete. Form work shall be tight enough to prevent any appreciable loss of cement during vibrations, Suitable tolerance should be provided in the formwork, immediately before concreting all forms shall be thoroughly cleaned. Contractor shall give the Engineer-in-charge due notice before placing any concrete in the forms to permit him to inspect and accept the false work notice before placing any concrete in the forms to permit him to inspect and accept the false work and forms as to their strength, alignment and general fitness, but such unsection shall not relieve the contractor of his responsibility for safety of men, machinery, materials and for results obtained.

22. The Engineer-in-charge shall be informed in advance by the contractor of his intension to stike any formwork. While fixing the time for removal of formwork, due consideration shall be given to local conditions that influence the setting of concrete and of concrete and of the materials used in the mix. Where filed operations are controlled by strength tests of concrete the removal of the load supporting of sofit forms may commence when concrete has attained strengthing props including the effect or any further additional of loads. When field re-operations are not controlled by strength tests of concrete the vertical forms beams, columns and walls may be removed after 2 days, The props of slabs and beams may be removed after 14 and 21 days respectively. All formwork shall be removed without causing any damage to the concrete. Cenetring shall be gradually and uniformly lowered in such a manner as to permit the concrete

to take stresses due to its own weight uniformly and gradually. Where internal metal ties are permitted, they or their removable parts shall be extracted without causing any damage to the concrete. and remaining holes filled with mortar. No permanently embedded metal part shall have less than 25mm. cover to the finished concrete surface. Where it is intended to be cleaned and made good to the satisfaction of the Engineer-in-charge.

23. Immediately after the removal of forms, all exposed bars or bolts passing through the Cement concrete member to a depth of at least 25mm, below the surface of the concrete and the resulting holes be filled by cement mortar. All fins caused by form joints, all cavities produced by the removal of form ties and all other holes and depressions, honey comb spots, broken edges or corners and other defects, shall be thoroughly cleaned saturated with water and carefully pointed and rendered true with mortar of cement and fine aggregated mixed in the proportions used in the grade of concrete that is being finished and of as dry a consistency as is possible to use. Considerable pressure shall be applied in filing and pointing to ensure thorough filling in all voids. Surface which have been pointed shall be kept moist for a period of twenty four hours. If rock pockets / honey-combs, in the opinion of the Engineer-in-charge are of such an extent or character as to effect the strength of the structure materially or to endanger the life of the steel reinforcement, he may declare the concrete defective and require the removal and replacement of the portions of the structure affected.

24. In the case of reinforced concrete work, workability shall be such that the concrete surrounds and properly grips all reinforcement. The degree of consistency, which shall depend upon the nature of work and methods of vibration of concrete shall be determined regular slump tests. Following slump shall be adopted for different types of works.

Type of Work		Slumps	
		Where vibrators are used	where vibrators are not used
(i)	Mass concrete in R.C.C. Foundations footings and retaining walls	10mm to 25mm	80mm
(ii)	Beams, slabs and columns simply reinforced	25mm to 40mm	100mm to 120mm
(iii)	Thin R.C.C. section or section with congested steel	40mm to 50mm	125mm to 150mm

25. For controlled concrete preliminary tests shall consist of three sets of separate tests, and in each set, tests shall be conducted on six specimens. Not more than one set of six specimens shall be made on any particular day. Of the six specimens in each set, three shall be tested at seven days and the remaining three at 28 days. The preliminary tests at 27 days are intended only to indicate the strength likely to be attained at 28 days. Work strength tests shall be made in accordance with IS: 516 EACH test shall be conducted on ten specimens five of which shall be tested at seven days and the remaining five at 28 days. The samples of concrete shall be taken on each day of concreting and cubes shall be made at the rate of one for every 5 cubic metre of concrete or a part thereof. However, if concreting done in a day is less than 15 cubic metre, the minimum number of cubes can be reduced to 6 with the specific permission of the Engineer-in-charge. Similar work tests shall be carried out whenever the quality and grading of materials is changed irrespective of the quantity of concrete poured. The number of specimens may be suitably increased as deemed necessary by the Engineer-in-charge when procedure to tests given above reveals a poor quality of concrete and in other special cases.

26. The average strength of the group of cubes cast for each day shall not be less than the specified work cube strength 20 per cent of the cubes cast each day may have values less than the specified strength, provided the lowest value is not less than 85 per cent of the specified strength.

27. R.C.C. work shall have exposed concrete surface. Centering design and its erection shall be approved by the Engineer-in-charge. One carpenter with helper will invariably be kept throughout the period of concreting. Movement of labour and other persons shall be totally prohibited over reinforcement laid in position. For access to different parts, suitable mobile platforms shall be provided so that steel reinforcement in position is not disturbed. For ensuring proper cover, mortar blocks of suitable size shall be cast and tied to the reinforcement. Timber, kapachi or metal pieces shall not be used for this purpose. Concreting of important structural members shall always be done in the presence and under the supervision of department person not below the rank of Asst. Engineer/Addl. Asst. Engineer/ Overseer or as instructed by the Engineer-in-charge. After removal of formwork and setting, the executive Engineer

shall inspect the work and satisfy by random checks that concrete produced is of good quality. Plastering shall not be allowed to the exposed faces of concrete.

28. In reinforced concrete the volume occupied by reinforcement shall not be deducted. The slab shall be measured as running continuously through and the beam as the portion below the slab.

29. All necessary labour, materials, equipment, etc., for sampling, preparing test cubes, curing etc. shall be provided by the contractor. Testing of the materials and concrete may be arranged by the Engineer-in-charge in an approved laboratory at the cost of the contractor.

**30. The payment will be made on cmt. basis of the finished work.**

31. The unit rate for concrete shall include the cost of all materials labour, tools and plant required for mixing, placing in position, vibrating and compacting finishing as per directions of the Engineer-in-charge, curing and all other incidental expenses for producing concrete of specified strength to complete the structure or its components as shown on the drawings and according to these specifications. The rate shall also include the cost of making fixing and removing of all centers and forms required for the work.

## **Item No. 26**

**Providing and laying weep hole in Abutment and returns by using A.C pipe of 100mm. Incl. fixing in proper grade and jointing the complete as per detailed specification..**

### **614. WEEP HOLES**

Weep holes as shown on the drawings shall be provided in the masonry structures with height more than 2 m to drain moisture from the backfilling. Weep holes shall be provided with 100 mm dia AC pipes and shall extend through the full width of the masonry with slope of about 1 vertical to 20 horizontal towards the draining face.

The weep hole shall be suitably staggered and the spacing of weep holes shall not exceed 2 m in horizontal and 1 m vertical direction with the lowest one at about 150 mm above the low water level or bed level which ever is higher or as directed by the Engineer.

**The payment will be made on Nos. basis of the finished work.**

## **Item No. 27**

**Providing and laying filter media 600mm. thick directed at the back of abutments, returns and wing walls as per detailed specifications..**

1. Well graded pebbled or metal of 40mm. to 63mm. size shall be used. The grading and tolerances of metal of pebbles shall be as under :-

Sr. No.	No. of Size Range	Sieve Designation	Percentage by weight passing through the sieve.
1	63mm. to 40mm.	90mm	100-00
		63mm	85-100
		50mm	35-70
		40mm	00-15
		20mm	00-05

The size shall be 40mm. to 63mm. where in tolerance limit for over size shall be upto 15% and that for lower size should be upto 15% and below 20mm. it shall be allowable upto 5% the filter Materials shall be tightly placed to a thickness of not less than 600m. and provided over the entire surface behind abutments, wings or return walls to the full height.

2. Materials shall be first stacked in boxed of 2 m 1.1/2m x 0.5 m. size on fairly level ground and measured.

**3. The measurement for payment shall be made on sq.mt basis** of finished No deduction shall be made for voids.

4. The unit rate includes the cost of materials, scaffolding labour and tools to complete the work.

### **Item No. 28**

**Providing and fixing in position Mild steel dowel bars in pier cap or abutment caps for anchorage in fixed end as per detailed drawings including cutting bending and welding complete.**

**And**

### **Item No. 29**

**Providing and fixing in position Mild steel dowel bars in pier cap or abutment caps for anchorage in free end as per detailed drawings including cutting bending and welding complete.**

1. For Mild Steel, specification for Ms reinforcement shall apply.

2. The M.S. dowel bars shall be provided and anchored in pier caps, abutment caps and superstructure as per detailed drawings for free ends and fixed ends. G.I. Pipes and other materials such as mastic asphalt as directed by Engineer-in-charge or as per drawing shall be provided. G.I. pipes shall be as approved by Engineer-in-charge.

**3. The payment shall be made per number** of dowel bars in anchored condition.

4. Unit rate shall include cost of all materials, labour, and equipments to complete the job.

### **Item No. 30**

**Providing and laying in Position FE -500/500D TMT bar reinforcement including cutting, bending, hooking and tying complete as per detailed drawings for the following (A) Piers (B) Abutments (C) Returns (D) Walls etc.**

**And**

### **Item No. 31**

**Providing and Fixing in position FE-500/500D TMT bar reinforcement including cutting, bending, hooking, and tying complete as per detailed drawing (A) RCC kerb (B) RCC Footpath (B) RCC Solid Slab/ App. Slab / Wearing coat**

**2.00 Materials :-** T.M.T. shall conform to IS : 1789-FE 500/500D Mild steel binding wires shall conform to the specification.

**2.1** The work shall consist of furnishing and placing reinforcement of the shape and dimensions shown on the drawing or as directed by the Engineer-in-charge.

**2.2** Steel shall be clean and free from loose rust mill scale at the time of fixing in position and subsequent concreting.

**2.3** Reinforcing steel shall conform accurately to the dimensions given in bar bending schedules shown on relevant drawing. Bar shall be bent cold to the specified shape and dimensions or as directed by the Engineer-in-charge using a proper bar bender, operated by hand or power to attain proper radius of bends. Bars shall not be bent or straightened in manner that will injure the material. Bars bent during transporting or handling shall be straightened before use on work; they shall not be invariably be provided. The diameter of the bend shall not be less than twice the diameter of the round bar and length of the straight part of the bend beyond the end of the curve shall be at least four times the diameter of the round bar. In the case which are not round and in the case of deformed bars, the diameter shall be taken as the diameter of a circle having an equivalent effective area. The work shall be suitably encased to prevent any splitting of the concrete.

**2.4** All reinforcement bars shall be accurately placed in exact on the drawings, and shall be securely held in position during placing of concrete by annealed binding wire not less than 1mm, in size and confirming to IS : 280 and by using stay blocks or metal chairs, spacer, metal hangers, supporting wires or other approved device at sufficiently close intervals. Bars will not be allowed to sag between supports or displaced during concreting or any of their operations over the work. All devices used for positioning shall be non-corrodible material. Wooden and metal supports will not extend to the surface of concrete except where shown on the drawings. Placing bars on layers of freshly laid concrete as the work progress or adjusting bar will not be allowed. Pieces of broken stone or brick and wooden blocks shall not be used. Layers of bars shall be separated by spacer bars, precast mortar block, or other approved device. Reinforcement after being placed in position shall be maintained in clean condition until completely embedded in concrete. Special care shall

be exercised to prevent any displacement of reinforcement in concrete already placed. To protect reinforcement from corrosion, concrete cover shall be provided as indicated on the drawing. All bars protruding from concrete and to which other bars are to be spliced and which are likely to be exposed for an indefinite period shall be protected by a thick coat of neat cement grout.

2.5. Bars crossing each other, where required shall be secured by binding wire (annealed) of size not less than 1 mm. in such a manner that they do not slip over each other at the time of fixing and concreting.

2.6. As far as possible, bars of full length shall be used. In case this is not possible, overlapping of bars shall be done as directed by the engineer-in-charge. When practicable, overlapping bars shall not touch each other, but be kept apart by 25mm or 1.25 times the maximum size of the coarse aggregate whichever is greater, by concrete between them. Where not feasible, overlapping bars shall be bound with annealed steel wire, not less than 2mm thickness twisted right. The overlaps shall be staggered for different bars and located at points, along the span where neither shear nor bending movement is maximum.

2.7. Whenever indicated on the drawings or desired by the Engineer-in-charge, bars shall be joined by couplings which shall have a cross-section sufficient to transmit the full strength of bars. The end of the bars that are joined by coupling shall be upset for a sufficient length so that the effective cross-section at the base of threads shall be standard with the threads. Steel for coupling shall conform to IS : 226.

2.8. When permitted or specified on the drawings joints of reinforcement bars shall be butt welded so as to transmit their full strength. Welded joints shall preferably be located at points where steel will not be subject to more than 75 per cent of the maximum permissible stresses and so staggered that at any one section not more than 20 per cent of the rods are welded. Only electric arc welding shall be used using a process which excludes air from the molten metal and conforms to any or all the special provisions for the work which will be accepted. Suitable means shall be provided for holding the bars securely in position during welding. It must be ensured that no voids are left in welding and when welding is done in 2 or 3 stages, previous surface shall be cleaned properly. Ends of the bars shall be cleaned of all loose scale, rust, grease, paint and other foreign matter before welding. Only competent welders shall be employed on the work. The M.S. electrodes used for welding shall conform to IS : 814. Welded pieces of reinforcement shall be tested. Specimen shall be taken from the actual site and their number and frequency of test shall be as directed by the Engineer-in-charge.

## **MEASUREMENTS FOR PAYMENT**

Reinforcement shall be measured in length including hooks, if any, separately for different diameters as actually used in work, excluding overlaps. From the length so measured, the weight of reinforcement shall be calculated in tonnes on the basis of IS: 1732. Wastage, overlaps, couplings, welded joints, spacer bars, chairs, stays, hangers and annealed steel wire or other methods for binding and placing shall not be measured and cost of these items shall be deemed to be included in the rates for reinforcement.

### **RATE**

The contract unit rate for coated/uncoated reinforcement shall cover the cost of material, fabricating, transporting, storing, bending, placing, binding and fixing in position as shown on the drawings as per these specifications and as directed by the Engineer, including all labour, equipment, supplies, incidentals, sampling, testing and supervision.

The unit rate for coated reinforcement shall be deemed to also include cost of all material, labour, tools and plant, royalty, transportation and expertise required to carry out the work. . The rate shall also cover sampling, testing and supervision required for the work.

### **Mode of Measurement and Payment**

The rate shall be for a unit of One M.T

## **Item No. 32**

### **Providing 12mm. Thick Pre-molded asphalt filler joints as per drawings**

1. Open joints shall be constructed at the locations as directed by the Engineer-in-charge using a wood strip, metal plate, other suitable material which is subsequently removed. When removing the material, care shall be exercised to avoid chipping or breaking the corners of the concrete. The edge of the concrete at the joints shall be edge finished. Reinforcement shall not extend across an open joint.

2. When rate for each type of bearings shall include the cost of supplying and fixing the bearings in position complete. The rate shall also include the cost of samples and their testing as desired by the Engineer in charge. The rate shall also include the cost of adhesives for fixing them.

3. The material used for filling expansion joint shall be bitumen impregnated felt which shall conform to the requirement of IS: 1838, and shall be got approval from the Engineer-in-charge. The joint shall consist of large pieces and assembly of small pieces to make up the required size shall be avoided.

4. The expansion joint shall be measured in running metres. Thickness of the expansion joint will be 20 to 25mm. Width of the expansion joint shall be equal to full depth of the slab.

5. The rate shall include the cost of all material, labour, equipments and other incidental charges for fixing the joints complete in all respect as per these specifications and as shown on the drawings.

**6. Payment shall made on Sqmt basis**

**Item No. 33**

**Providing G.I. 100mm. Dia Meter water spouts including necessary iron gratings as per drawings.**

1. Material for the water spout shall be as mentioned in the item and shall be got approved from in Engineer in Charge.

2. Water spout shall be 100 mm. internal dia. Cost iron grating shall be provided at the entry and shall be fixed in the recess so as to be flush with the read surface. The quality and size of the grating shall be approved from the Engineer-in-charge. The water spout shall project at-least 10 cm. outside the concrete and shall be rigidly fixed in it. The grating and G.I. pipes shall be painted with two coats of anticorrosive black bitumen paint.

**3. Measurement shall be per Number of water spout fixed.** unit Rate included cost of material, labor and to completed the works.

**Item No. 34**

**Providing flood gauge marks on sub structure as per design including painting complete**

1. The width of the flood gauge shall be 60cm. and will have caneri yellow background colour. The flood gauge marking will be in 10cm. thick strips of alternative black and white colour. The width of the strip shall be as under.

- |     |                |                     |
|-----|----------------|---------------------|
| (a) | At very 10cm   | 15cm width          |
| (b) | At every ½ cm  | 25cm width in black |
| (c) | At every metre | 35cm width in white |

The lettering shall be in black colour and of 10cm height. The lettering shall show every metre and 1/2m level. The lettering shall show based on either GST B.M. of Arbitrary B.M. as furnished by Engineering-in-charge.

2. All the painting work shall be done in 3 coats. The paint shall be of approved make.

**3. The measurement for payment shall be on running Metre basis** measured vertically in height.

4. The unit rate includes the cost of materials, labour, painting, equipment if any to complete the work.

**Item No. 35**

**Filling available excavated earth (excluding rock ) in trenches plinth sides of foundation etc. in layers not exceeding 20cm in depth consolidating each deposited layer by ramming and watering.**

1.0 The earth to be used for filing shall be free from salts, organic or other foreign matter, All clods of earth shall be broken.

2.0 As soon as the work in foundation has been completed and measured, the site of foundation shall be cleared of all debris, stone, mortar droppings etc. and filled with earth in layers not exceeding 20 cms. each layer shall be adequately watered, rammed and consolidated before the succeeding layers is laid, the earth shall the rammed with iron rammers where reasible and with the butt ends of crow-bars. Where rammer can not be used. With iron rammers finished level, the surface shall be flooded with water for at least 24 hours and allowed to dry and then rammed and consolidated.

3.0 The excavated stuff of the selected type shall be allowed to be used in filling the trenches and plinth under no circumstances black cotton soil be used for filling.

4.0 The payment shall be made for filling in trenches and plinth. No deduction shall be made for shrinkage of voids, if consolidated as instructed above.

**5.0 The rate shall be for a unit of one cubic Metre.**

**Item No. 36**

**Numbering the CD work with approved paint including all materials for painting etc. complete.**

1. Numbering the C.D. works shall be carried out as per relevant I.R.C. specification Oil paint of approved quality and male shall be used for the purpose. Numbering shall be very neat and clean Arrow shall be marked on the head wall in the correct direction of flow of water. Payment shall be made on the number basis Unit rate includes the cost of all materials. labours for painting & lettering as directed by Engineer-in-charge.

**Item No. 37**

**Supplying and fixing reinforced concrete heavy duty non presure pipes with collars for culverts carrying heavy traffic as per IS 458-1991 specification including setting and joinng the pipes in C.M. 1:2 watering and laying (to level or slope) of I.S. Class NP-3 of following internal diameter with all lead and lift. (i) 900mm Dia..**

**And**

**Item No. 38**

**Supplying and fixing reinforced concrete heavy duty non presure pipes with collars for culverts carrying heavy traffic as per IS 458-1991 specification including setting and joinng the pipes in C.M. 1:2 watering and laying (to level or slope) of I.S. Class NP-3 of following internal diameter with all lead and lift. (i) 600mm Dia.**

1. The work shall consist to furnishing and installing reinforced cement concrete pipe of the type dia metre and length required at the location shown on the drawings or as ordered by the Engineer in charge.

2. Reinforced concrete pipe shallbe NP3 type conforming to the requirements of IS : 458 and shall be of dia as specified in the item each consignment of cement concrete pipes shall be inspected. If neccessary and approved by the engineer in charge, either at the place of manufacture or at the site before their incorporation in the works.

NP3 , NP3 , NP1 pipes are used for RCC pipes where testing of pipes will not be feasible the contractors will have to produce a certificate from the manufacturers on company;s letter head the given hereinafter form.

Production of such certificate will not however relieve the contractor from this responsibility of supplying pipes of required standard and will have to bear the loss or damage caused to the work in account of defects found subsequently during the execution It will also be necessary to purchase these pipes from manufacturere having standard equipments for carring out various test as per IS : 458 at his factory.

**FORM OF CERTIFICATE FOR NP3, NP2, NP1 PIPES**

We..... manufacture of RCC pipes prudude RCC pipes as per the requirement of IS : 458 and also carry out the required test at our place. We have acquired equipments for carrying out test and are prepared to carryout test at our factory sites.

We have experience of manufacturing of pies of ..... years The pipes supplied by us to M/s ..... Satisfy the requirement of IS " 458.

Date .....

Place .....

Manufacturer;s sign. ....

3. No pipe shall be placed in position until the foundations have been approved by the eingneer in charge, Where two or more pipes are to be laid adjacent to each other they shall be separated by a distace equal to at least half the diaMetre of the pipe subject to minimum of 450mm. The laying of pipes on the prepared foundation shall start from the outlet and proceed toward the inlet and be completed to teh specified lines and grades. The pipes shall be fitted and matched so that when laid in works they form a

culvert with a smooth uniform invert. Any pipe found defective or damaged during laying shall be removed at the cost of contractor.

4. The pipes shall be jointed either by collar joint or by flush joint in the former case the collars shall be of RCC 150 to 200 mm wide and having the same strength as the pipes to be jointed. Caulking space shall be slightly wet mix of cement and sand in the ratio of 1:2 rammed with caulking irons. Before caulking the collar shall be so placed that its centre coincides with that of pipe and an even annular space is left between the collar and the pipes. Flush joint may be shaped to form a self centering joint with a joint space 13 cm wide. The joining space shall be filled with cement mortar, 1 cement 2. sand, mixed sufficiently dry to remain in position when forced with a trowel or rammer. Care shall be taken to fill all voids and excess mortar shall be removed. All joints shall be made with care so that their interior surface is smooth and consistent with the interior surface of the pipes. After finishing, the joint shall be kept covered and damp for at least four days.

5. RCC pipe shall be measured along its centre between its inlet and outlet ends in linear Metres.

6. The rate for the pipes shall include the cost of pipe including loading unloading handling storing laying in position and joining complete.

7. Payment shall be made on Running Metre basis.

### **Item No. 39**

**Dismantling the existing structure including removing and stacking the dismantled materials as and where directed. Rubble masonry/ U.C.R. Masonry.**

**And**

### **Item No. 40**

**Dismantling G.I. Pipes G.S.W. Pipes and R.C.C. NP2 pipes with fitting and clamps including stacking the materials with all lead and lift (for any of pipe)**

## **202. DISMANTLING CULVERTS, SMALL BRIDGES, PAVEMENTS AND OTHER STRUCTURES**

### **202.1. Scope**

This work shall consist of removing, as hereinafter set forth, existing culverts, bridges, pavement, kerbs and other structures, like, railings, fences, utility services, manholes, catch basins, inlets etc., which are in place but interfere with the new construction or are not suitable to remain in place. It shall include salvaging and disposing of the resulting materials and backfilling the resulting trenches and pits.

Existing culverts, bridges, pavement and other structures which are within the road land and which are designated for removal, shall be removed up to the limits and extent specified in the drawings or as directed by the Engineer.

Dismantling and removal operations shall be carried out preferably with locally available tools and equipments and in such a manner as to leave undisturbed adjacent pavement, structures and any other work to be left in place. Use of specialized tools and equipments by the agency shall be incidental to this item.

All operations necessary for the removal of any existing structure which endanger new construction shall be completed prior to the start of new work.

### **202.2. Dismantling Culverts and Small Bridges**

The structures shall be dismantled carefully and the resulting materials so removed as not to cause any damage to the serviceable materials to be salvaged, the part of the structure to be retained and any other properties or structures or utilities nearby.

Unless otherwise specified, the superstructure portion of culverts/bridges shall be entirely removed and other parts removed below the ground level or as necessary depending upon the interference they cause to the new construction. Removal of overlying or adjacent material, if required in connection with the dismantling of the structures, shall be incidental to this item.

Where existing culverts/bridges are to be widened / strengthened or otherwise incorporated in the new work, only such part or parts of the existing structure shall be removed as are necessary for execution of work shown in drawings to provide a proper connection to the new work. The connecting edges shall be cut, chipped and trimmed to the required lines and grade without weakening or damaging any part of the structure to be retained. Due care should be taken to ensure that reinforcing bars which are to be left in place so as to project into the new work as dowels or ties are not damaged during removal of concrete and protected against rusting or corrosion.

Pipe culverts shall be carefully removed in such a manner as to avoid damage to the pipes.

Steel structures shall be carefully dismantled in such a manner as to avoid damage to members thereof, if the structure is to be removed in a condition suitable for re-erection as specified in the drawings or directed by the Engineer. All members shall be match marked with white lead paint by the Contractor before dismantling. All loose parts like pins, nuts, loose plates, etc. shall be securely wired to adjacent members or packed in boxes with proper markings for the ease of identification at the time of re-erection of the structure at later stage.

Timber structures shall be removed in such a manner as to avoid damage to such timber or lumber as is designated by the Engineer to be salvaged after joint inspection by the Engineer and the Contractor or their authorized representatives.

### **202.3. Dismantling Pavement and Other Structures**

In removing pavements, kerbs, gutters, and other structures, like, railings, fences, manholes, catch basins, inlets, etc. where portions of the existing construction are to be left in the finished work, the same shall be removed to an existing joint or cut and chipped to a true line with a face perpendicular to the surface of the existing structure. Sufficient removal shall be made to provide for proper grades and connections with the new work as directed by the Engineer.

Concrete pavements, base courses in carriageway and shoulders, etc. designated for removal shall be broken to pieces and stock piled at designated locations or as directed by the Engineer, if the material is to be used later or otherwise, the Contractor shall arrange for disposal as stipulated in Clause 202.5.

### **202.4. Backfilling**

Holes and depressions caused by dismantling operations shall be backfilled with excavated or other approved materials and compacted to required density conforming to these specifications, or as directed by the Engineer.

### **202.5 Disposal of Materials**

All materials, obtained by dismantling, shall be the property of Government. Unless otherwise specified, materials having any salvage value shall be placed in neat stacks of like materials within the right-of-way, as directed by the Engineer with all lifts and upto a lead of 1000 m.

Pipe of culverts which are removed shall be cleaned and neatly piled on the right-of-way at spots designated by the Engineer with all lifts and lead upto 1000 m.

Structural steel removed from old structures shall, unless otherwise specified be stored in a neat and presentable manner in blocks at locations suitable for loading.

Timber or lumber salvaged from old structures shall have all nails and bolts removed therefrom and shall be stored in neat piles in locations suitable for loading in the right-of-way.

All materials obtained from dismantling operations which cannot be used or auctioned shall be disposed off as directed by the Engineer with all lifts and upto a lead of 1000 m.

#### **202.6. Acceptance**

Acceptance of dismantling and removal of salvaged material shall be based on visual inspection of the work and backfilling and compaction shall comply the tests specified for such work in these Specifications.

#### **202.7. Measurements for Payment**

The work of dismantling structures shall be paid for in units indicated below by taking measurements before and after, as applicable:

(i)	Dismantling brick/stone masonry/concrete (Plain and reinforced)	cu.m.
(ii)	Dismantling flexible and cement concrete pavement	cu.m.
(iii)	Dismantling steel structures	tonne
(iv)	Dismantling pipes, guard rails, kerbs, gutters and fencing	Linear m
(v)	Utility services	Nos./linear m

#### **202.8. Rate**

The Contract unit rates for the various items of dismantling including utility services shall be paid in full for carrying out the required operations including all labour, materials tools, equipment, safeguards and incidental expenditure for the satisfactory completion of the work. These rates will also include excavation and backfilling where necessary to the required compaction and for handling, salvaging, piling and disposing of the dismantled materials within all lifts and upto a lead of 1000 m.

### **Item No.41**

**Providing and fixing precast cement concrete Hectometer as per IRC type design incl. painting, lettering etc. fixing in C.C. 1:5:10.**

#### **(1) Fixing in Earth :**

The work shall be carried out as per the item of ordinary kilometre stone except that the size of hectoMetre stone shall be smaller than that of ordinary kilometre stone as per IRC 26 (type design for 200 metre stone fixing shall be in earth the measurement for payment as well as operations included in the unit rate shall be as per hectoMetre stone.

#### **(2) Fixing in C.C. 1:5:10**

Specification same as 11(1) above except that the indicator stone shall be fixed in C.C. 1:5::10 which will consist of one part of cement, five part of good sand and ten parts of good brick bats, Rate includes all labour and curring etc. necessary for concrete.

Payment shall be made on number basis

### **Item No.42**

**Providing and fixing precast cement concrete Guard stone as per I.R.C. type design including white washing etc. complete. Fixing in C.C. 1:5:10**

**(1) Fixing in Earth / Wearing Coat :**

1. The guard stone shall be of approved quality and of 20 cm x 15 cm size and its length shall not be less than 75 cms. The top portion shall be rounded. The top 38 cm shall be chisel dressed on all sides. The size shape and dimensions of the guard stones shall be exact and shall be nearly dressed and finished.

2. The guard stone shall be fixed in position as directed by the Engineer in charge in earth / wearing coat. If the guard stone shall be fixed in wearing coat, the equivalent volume covered by the guard stones shall be given three coats of white wash. Any excavation necessary for fixing of the guard stones shall be done by the contractor at his own cost. The measurement for payment shall be per number of guard stone fixed in position.

3. Unit rate of guard stone includes the cost of all materials, labours, tools, fixing & white washing as directed by the Engineer in charge.

**(2) Fixing in C.C. 1:5:10**

Specification same as 12(1) above except that the indicator stone shall be fixed in C.C. 1:5:10 which will consist of one part of cement, five parts of good sand and ten parts of good brick bats. Rate includes all labour and curing etc. necessary for concrete.

### **Item No.43**

**Providing and fixing Ordinary KiloMetre stone of pre-cast C.C. 1:2:4 including necessary reinforcement as per I.R.C. type design fixing in C.C. 1:4:8 including painting lettering etc. (For ODR, VR)**

1. KiloMetre stone shall be of approved quality and shall be either black Rajula stone or of precast 1:2:4 RCC specified in the item.

2. The size, manner of fixing, painting and lettering of K.M. stone shall conform specification as per IRC - 8 (Type design for Highway kilometre stones) The fixing of K.M. stone shall be carried out in ordinary concrete of grade specified in the item using hand broken metal field metal or gravel, The measurement for payment shall be made per No. of K.M. stone fixed in position.

3. Unit rate for kilometre stone alone includes the cost of all materials labours tools fixing finishing curing lettering and painting as directed by the engineer in charge.

### **Item No.44**

**Providing and fixing Precast cement concrete Indicator stone of approved stone as per I.R.C. type design including white washing etc. complete Fixing in Earth.**

**(1) Fixing in earth.**

1. Indicator stones shall be of approved quality and of the size 20 cm x 20 cm, its length shall not be less than 80 cms. The top 38 cm shall be chisel dressed on all sides. The size shape and dimension of indicator stones shall be fixed firmly in position in embankment or cutting as the case may be. The exposed part of the indicator stone shall be done by the contractor at his own cost. The measurement for payment shall be per number of indicator stone fixed in position.

2. Unit rate indicator stone includes the cost of all materials labour, tools, fixing and white washing as directed by the Engineer in charge.

**ITEM -8(2) Fixing in C.C. 1:5:10**

Specification same as 8(1) above except that the indicator stone shall be fixed in c,c, 1:5:10 which will consist of one part of cement. five part of good sand and ten parts of good briks bats. Rate includes all labour and curing etc. necessary for concrete.

### **Item No.45**

**Supplying and fixing Junction Boards of M.S. plate and angles as per I.R.C. design incl;. Fixing in C.C. 1:4:8 with necessary excavation painting, figuring, lettering on boards etc. complete.**

1. These boards should be fixed at a distance of 120 metre from the centre line of the crossing and they should be located on the left hand side of the road in the direction of the traffic facing the traffic.
2. The board will be located in such a way that the edge of the board towards the centre of the road will be at a distance of 4.57 metres from the centre of a National Highway and 3:66 Metres from the centre of State Highway or Major District Road.
3. The size for junction board MS plate and angle shall be as per stanadrad confirming to IRC type
4. The post shall be fixed in concrete and the projection of this above the road level shall be 4 cm x 45 cm and height of 24 cms. above the road level and the topic to be finished in plaster from the height of 15 cm.
5. The size of letter and figures shall be 8 cm for English and 10 cm for devnagri and Gujarati scripts.
7. The post shall be painted in black and white reflective strips 23 cm in height.
8. The board shall be painted in white with border 23 cm wide.
9. The board shall be painted in white with blaboard 2 cm. vide.
10. On this board tablets shall be painted in yellow with black and the tablets shall have 5 cm. clear distance from the board.
11. Each such tablet shall be 61 cm. in length and 33 cm in height arrow lines indicating the direction of the road at the junctions shall be painted in black and shall have a thickness of .....cm for National Highway and 4 cm. on a State Highway and a.....cm. for a Major district road.
12. All letters and figures shall be painted in black.
13. The work shall be carried out as per design as per the instructions of the Engineer-in-charge.

**The measurements shall be recorded and paid on number basis for board fixed in position.**

### **Item No.46**

**Providing and fixing Village name Boards as per standard I.R.C. type design of steel plate incl. painting, lettering etc. complete. With fixing in C.C. 1:4:8 block with necessary excavation etc. complete**

1. The work shall be carried out as per the item of sign boardm except that there shall not be top palte of 90 cm x 90 cm triangular shape and lower plate of 90 cm x 61 cm rectangular plate of 6 mm thickness shall be fixed at top facing towards the direction of the village.
2. The board plate shall be painted in black colour letters & figures shall be painted in white colour with an arrow directing towards the village painting & lettering shall be done both sides. The size of the letters & figures as well as thickness of arrow will be as directed by the Engineer in charge.
3. The measurement for payment as well as operations included in the unit rate shall be as per item of sign boards.

**4. The Payment shall be made on Number basis.**

### **Item No.47**

**Providing and fixing Road sign of M.S. plate and angle iron incl. painting, lettering etc. complete. fixing in C.C. 1:4:8 block with necessary excavation etc. complete as per IRC type design (i) Reflective Type.**

**(1) Non reflective type :**

1 The board shall consist of a 90cm x 90 cm traingular plate of 6 cm thickness at the top and a 90 cm x 61 cm rectangular plate of 6 mm thickness below if fixed at suitable distance. This shall be fixed to the angle iron post of 75 mm x 75 mm x 6 mm size by means of welding or reveting as directed by the engineer in charge. The angle iron post shall be split at the bottom end to 10 cm (minimum) in length and shall be fixed at right angle to the central line of the road in ordinary concrete of grade as specified in the item. using hand broken metal, field metal or gravel. Two steel bars of 12 mm dia, shall project 2.5 cm above ground level and shall be at least 60 cm below ground level. Total height of post shall be 3. mt. (minimum). The exposed platform shall be neatly finished and its shape shall be as directed by the engineer in charge.

2. The post will be painted with two coats alternatively in black and white strips 23 cm in high after applying one coat of anticorrosive paint. The paint shall be of approved quality. The board shall be painted with approved colour and letering shall be in accordance with IRC 30 (Standard letters and Numerals of Different Heights for use on Highway desings) and as per notified sign of Motor Vehicle Act. respectively.

**3. The measurement for payment shall be per number of sign board fixed in position.**

4. The unit rate includes the cost of materials , labour tools , dirilling of holes, riveting or welding, fixing curing, lettering , painting as directed by the Engineer in charge.

**(2) Reflective Type**

**Retro-reflective Sheeting:-** The retro-reflective sheeting used on the signs shall consists of the white or coloured sheeting having a smooth outer surface which has the property of reflection over its entire surface. It shall be weather resistant and exhibit colourfastness. It shall be new and unused and shall show no evidence of cracking, scaling, pitting, blistering, edge lifting or curling and shall have negligible shrinkage or expansion. The reflective sheeting can be either of Engineering Grade material with enclosed lens.

**Engineering grade sheeting:-** The sheeting shall be of enclosed lens type con of microscopic lens elements embedded beneath the surface of a smooth, flexible, transperant, water-proof plastic, resulting in a non-exposed lens optical reflecting system. The retro-reflective surface after cleaning with soap and water and in dry condition shall have the minimum co-efficient retro-reflection(determined in accordance with ASTM Standard:E-810) as indicated in Table below.

**Table Showing the Acceptable Minimum Co-efficient of Retro-Reflection for Engineering Grade Sheeting(Candelas per Lux per Square Metre)**

Observation angle in degrees	Enterance angle in degree	White	Yellow	Orange	Green	Red	Blue
0.2	- 4	70	20	25	9.0	14.5	4.0
0.2	+30	30	22	7.0	3.5	6.0	1.7
0.5	- 4	30	25	13.5	4.5	7.5	2.0
0.5	+30	15	13	4.0	2.2	3.0	0.8

When totally wet, the sheeting shall not show less than 90 percent of the values of retro-reflection indicated in above table. At the end of 5 years, the sheeting shall retain at least 50 percent of its original retro-reflectance.

**Adhesive:-** The sheeting shall either have a pressure-sensitive adhesive of the aggressive- tack type requiring no heat, solvent or other preparation for adhesion to a smooth clean surface, or a tack free adhesive activated by heat, applied in a heat vacuum applicator, in a manner recommended by the sheeting manufacturer. The adhesive shall form a durable bond to smooth, corrosion and weather resistant surface of the base plate such that it shall not be possible to remove the sheeting from the sign base in one piece by use

of sharp instrument. In case of pressure-sensitive adhesive sheeting, the sheeting shall be applied in accordance with the manufacturer's specification. Sheetting with adhesive requiring use of solvents or other preparation for adhesive shall be applied strictly in accordance with the manufacturer's instructions.

**Fabrication:-** Surface to be refletorised shall be effectively prepared to receive the retro-reflective sheeting. The alluminium sheeting shall be de-greased either by acid or hot alkaline etching and all scale/dust removed to obtain a smooth plain surface before the application of retro-reflective sheeting. If the surface is rough, approved surface primer may be used. After cleaning, metal shall not be handled, except by suitable device or clean canvas gloves, between all cleaning and preparation operation and application of reflective sheeting/primer. There shall be no opportunity for metal to come in contact with grease, oil or other contaminants prior to the application of retro-reflective sheeting.

Complete sheets of the material shall be used on the signs except where it is unavoidable. At splices, sheeting with pressure-sensitive adhesives shall be overlapped not less than 5 mm or butted with a gap not exceeding 0.75mm. Where screen printing with transparent colour is proposed, only butt jointing shall be used. The material shall cover the sign surface evenly and shall be free from twists, cracks and folds. Cut-outs to produce legends and borders shall be bonded with the sheeting in the manner specified by the manufacturer.

**Colour for signs:-** Signs shall be provided with retro-reflective sheeting in colours as shown on the detailed drawings. The reverse side of all sign shall be painted grey.

Colours shall comply with with the following I.S.I. shades given in Bureau of Indian Standar(B.I.S.):5-1978 "Colours for Ready Mixed Paints":

<b>Blue</b>	-	Indian Standard Colour No. 166 : French Blue
<b>Red</b>	-	Indian Standard Colour No. 537 : Signal Red
<b>Grey</b>	-	Indian Standard Colour No. 630 : French Grey
<b>Green -</b>		Indian Standard Colour No. 284 : Indian Green

**Testing:-** Retro reflective sheeting of various colours shall be got tested in the recognized/Govt. laboratory as decided by the Engineer-in-charge before being used.

**Measurement:-** The measurement for payment shall be per number of sign board post fixed in position.

### **Item No.48**

**Providing and fixing Flood guage post mark of 'C' angle size 100mm x 50mm x 6mm thick (in head wall 0.500mt. And 1.50mt. Out side with painting and lettering with redeum color as directed..**

#### **-: Scope :-**

The item covers supplying and installing flood gauge post conforming to IRC:67:2001 in all respect in accordance with these specifications and as approved by the Engineer-in-charge.

#### **General:-**

The colour, configuration, size and location of flood gauge shall be as shown on the drawings and in absence of any details if any missing details, the same shall be provided as directed by the Engineer-in-charge.

#### **Material for Sign:-**

The various materials and fabrication of traffic signs shall conform to the following requirement  
**Concrete:-** Concrete shall be of M-150 grade (mix 1:2:4).

**Reinforcing Steel:-** Reinforcing steel shall conform to the requirements of IS:1786 unless otherwise specified.

**Aluminium:-** Alluminium sheets used for sign boards shall be of smooth, hard and corrosistant alluminium alloy conforming to IS 736- Material designation 24345 or 1900.

**Plate Thickness:-** Plate thickness shall be at least 2 mm thick. The thickness of the sheet be related to the size of the sign and its support and shall be such that it dose not bend or deform prevailing wind and other loads.

**Retro-reflective Sheeting:-** The retro-reflective sheeting used on the signs shall consists of the white or coloured sheeting having a smooth outer surface which has the property of reflection over its entire surface. It shall be weather resistant and exhibit colourfastness. It shall be new and unused and shall show no evidence of cracking, scaling, pitting, blistering, edge lifting or curling and shall have negligible shrinkage or expansion. The reflective sheeting can be either of Engineering Grade material with enclosed lens.

**Engineering grade sheeting:-** The sheeting shall be of enclosed lens type con of microscopic lens elements embedded beneath the surface of a smooth, flexible, transperant, water-proof plastic, resulting in a non-exposed lens optical reflecting system. The retro-reflective surface after cleaning with soap and water and in dry condition shall have the minimum co-efficient retro-reflection(determined in accordance with ASTM Standard:E-810) as indicated in Table below.

**Table Showing the Acceptable Minimum Co-efficient of Retro-Reflection for Engineering Grade Sheeting(Candelas per Lux per Square Metre)**

Observation angle in degrees	Enterance angle in degree	White	Yellow	Orange	Green	Red	Blue
0.2	- 4	70	20	25	9.0	14.5	4.0
0.2	+30	30	22	7.0	3.5	6.0	1.7
0.5	- 4	30	25	13.5	4.5	7.5	2.0
0.5	+30	15	13	4.0	2.2	3.0	0.8

When totally wet, the sheeting shall not show less than 90 percent of the values of retro-reflection indicated in above table. At the end of 5 years, the sheeting shall retain at least 50 percent of its original retro-reflectance.

**Adhesive:-** The sheeting shall either have a pressure-sensitive adhesive of the aggressive- tack type requiring no heat, solvent or other preparation for adhesion to a smooth clean surface, or a tack free adhesive activated by heat, applied in a heat vacuum applicator, in a manner recommended by the sheeting manufacturer. The adhesive shall form a durable bond to smooth, corrosion and weather resistant surface of the base plate such that it shall not be possible to remove the sheeting from the sign base in one piece by use of sharp instrument. In case of pressure-sensitive adhesive sheeting, the sheeting shall be applied in accordance with the manufacturer's specification. Sheeting with adhesive requiring use of solvents or other preparation for adhesive shall be applied strictly in accordance with the manufacturer's instructions.

**Fabrication:-** Surface to be refletorised shall be effectively prepared to receive the retro-reflective sheeting. The alluminium sheeting shall be de-greased either by acid or hot alkaline etching and all scale/dust removed to obtain a smooth plain surface before the application of retro-reflective sheeting. If the surface is rough, approved surface primer may be used. After cleaning, metal shall not be handled, except by suitable device or clean canvas gloves, between all cleaning and preparation operation and application of reflective sheeting/primer. There shall be no opportunity for metal to come in contact with grease, oil or other contaminants prior to the application of retro-reflective sheeting.

Complete sheets of the material shall be used on the signs except where it is unavoidable. At splices, sheeting with pressure-sensitive adhesives shall be overlapped not less than 5 mm or butted with a gap not exceeding 0.75mm. Where screen printing with transparent colour is proposed, only butt jointing shall be used. The material shall cover the sign surface evenly and shall be free from twists, cracks and folds. Cut-outs to produce legends and borders shall be bonded with the sheeting in the manner specified by the manufacturer.

#### **Posts and mountings for signs**

Sign posts, their foundations and sign mountings shall be so constructed as to hold these in a proper and permanent position against the normal storm wind loads or displacement by vandalism. Normally, signs with an area up to 0.9 sqm shall be mounted on a single post, and for greater area two or more support shall be provided. Sign supports post shall be of mild steel section of size 125X50X125X50 4mm thick hollow section of 2.3 to 2.5 mtr long. End(s) shall be firmly fixed by means of properly designed foundation. The work of foundation shall conform to relevant specifications as specified.

All components of signs and support, other than the reflective portion of G.I. posts shall be thoroughly de sealed, cleaned, primed and painted with two coats of epoxy paint. Any part of mild steel(M.S.)post below ground shall be painted with three coats of red lead paint.

The signs shall be fixed to the post by welding in case of steel post or riveted as directed by Engineer-in-charge.

**Colour for signs:-** Signs shall be provided with retro-reflective sheeting in colours as shown on the detailed drawings. The reverse side of all sign shall be painted grey.

Colours shall comply with with the following I.S.I. shades given in Bureau of Indian Standard(B.I.S.):5-1978 "Colours for Ready Mixed Paints":

<b>Blue</b>	-	Indian Standard Colour No. 166 : French Blue
<b>Red</b>	-	Indian Standard Colour No. 537 : Signal Red
<b>Grey</b>	-	Indian Standard Colour No. 630 : French Grey
<b>Green</b>	-	Indian Standard Colour No. 284 : Indian Green

**Testing:-** Retro reflective sheeting of various colours shall be got tested in the recognized/Govt. laboratory as decided by the Engineer-in-charge before being used.

**Measurement:-** The measurement for payment shall be per number of flood gauge post fixed in position.

**Rate:-** The unit rate including the cost of materials, labor, tools, drilling hole, welding, riveting, curing lettering painting as directed by the engineer in charge.

#### **Item No.49**

**Village/Bump Ahead sign. :** Providing and fixing sign boards made out of 2mm Aluminum sheet size 90x60 cms. Rectangle as per the design of IRC-67-1977 pre treated with phosphating process and acid etching coated with one coat of epoxy primer and two coats of best quality epoxy paint reflectorized with retro reflective sheeting as per latest MOST specification letter and numbers should be as per IRC:30-1968, 3.1 Mt. long (2 nos) stand post and frame fabricated from suitable size iron angle of 50x50x5mm, painted with best quality epoxy coating in black and white bends, the details of symbol on inscription/ numerals for each board shall be as per the instruction of the Engineer in charge. The fixing at site shall be in C.C 1:2:4 block of size 45x45x60cms. for each leg including excavation curbing etc. complete under the supervision of engineer in charge (A) Engineer Grade.

**And**

#### **Item No.50**

### **Hazard Marker sign :**

**Providing and Fixing sign boards made out of 2mm aluminum sheet : size 90\*30 cms. rectangle as per design / Drawing attached (IRC). Pretreated with phosphating process and acid etching : coated with one coat of epoxy primer and two coats of best quality epoxy paint: reflectorized with retro reflective sheeting as per latest M.O.S.T specification: 3.1 M. long (2 nos) stand post and frame fabricated from suitable size iron angle of 35\*35\*3mm and 50\*50\*5mm : painted with best quality epoxy coatings in black and white bends the details of symbol or inscription / numerals for each board shall be as per the instruction of engineer in charge the fixing at site shall be in 1:2:4 CC block of size 45\*45\*60 cms for each leg: including excavation curing etc. comp. under the supervision of engineer-in-charge.(B) Engineering Grade**

## **TRAFFIC SIGNS**

### **801.1. General**

**801.1.1.** The colour, configuration, size and location of all traffic signs for highways other than Expressways shall be in accordance with the Code of Practice for Road Signs, IRC: 67 or as shown on the drawings. For Expressways, the size of the signs, letters and their placement shall be as specified in the contract drawings and relevant Specifications. In the absence of any details or for any missing details, the signs shall be provided as directed by the Engineer.

**801.1.2.** The signs shall be either reflectorised or non-reflectorised as shown on the drawings or as directed by the Engineer. When they are of reflectorised type, they shall be of retro-reflectorised type and made of encapsulated lens type reflective sheeting vide clause 801.3, fixed over aluminium sheeting as per these Specifications.

**801.1.3.** In general, cautionary and mandatory signs shall be fabricated through process of screen printing. In regard to informatory signs with inscriptions, either the message could be printed over the reflective sheeting, or cut letters of non-reflective black sheeting used for the purpose which must be bonded well on the base sheeting as directed by the Engineer.

### **801.2 Materials**

The various materials and fabrication of the traffic signs shall conform to the following requirements :

**801.2.1. Concrete:** Concrete shall be of the grade shown on the Contract drawings or otherwise as directed by the Engineer.

**801.2.2. Reinforcing steel:** Reinforcing steel shall conform to the requirement of IS: 1786 unless otherwise shown on the drawing.

**801.2.3. Bolts, nuts, washers:** High strength bolts shall conform to IS: 1367 whereas precision bolts, nuts, etc., shall conform to IS: 1364.

**801.2.4. Plates and supports:** Plates and support sections for the sign posts shall conform to IS: 226 and IS: 2062 or any other relevant IS Specifications.

**801.2.5. Aluminium:** Aluminium sheets used for sign boards shall be of smooth, hard and corrosion resistant aluminium alloy conforming to IS: 736 – Material designation 24345 or 1900.

**801.2.6.** Signs with a maximum side dimension not exceeding 600 mm shall not be less than 1.5 mm thick. All others shall be at least 2 mm thick. The thickness of the sheet be related to the size of the sign and its support and shall be such that it does not bend or deform under the prevailing wind and other loads.

**801.2.7.** In respect of sign sizes not covered by IRC: 67, the structural details (thickness, etc.) shall be as per the approved drawings.

### **801.3. Traffic Signs Having Retro-Reflective Sheeting**

**801.3.1. General requirements:** The retro-reflective sheeting used on the sign shall consist of the white or coloured sheeting having a smooth outer surface which has the property of retro-reflection over its entire surface. It shall be weather-resistant and show colour fastness. It shall be new and unused and shall show no evidence of cracking, scaling, pitting, blistering, edge lifting or curling and shall have the negligible shrinkage and expansion. A certificate of having tested the sheeting for these properties in an unprotected outdoor exposure facing the sun for two years and its having passed these tests shall be obtained from a reputed laboratory, by the manufacturer of the sheeting. The reflective sheeting shall be either of engineering grade material with enclosed lens or of high intensity grade with encapsulated lens. The type of the sheeting to be used would depend upon the type, functional hierarchy and importance of the road.

**800.1.3.2. High intensity grade sheeting:** This sheeting shall be of encapsulated lens type consisting of spherical glass lens, elements adhered to a synthetic resin and encapsulated by a flexible, transparent waterproof plastic having a smooth surface. The retro-reflective surface after cleaning with soap and water and in dry condition shall have the minimum co-efficient of retro-reflection (determined in accordance with ASTM Standard E: 810) as indicated in Table 800-1.

**TABLE 800- 1. ACCEPTABLE MINIMUM COEFFICIENT OF RETRO-REFLECTION FOR  
HIGH INTENSITY GRADE SHEETING  
(CANDELAS PER FLUX PER SQUARE METRE)**

Observation angle (in degrees)	Entrance angle (in degrees)	White	Yellow	Orange	Green/ Red	Blue
0.2	-4	250	170	100	45	20
0.2	+30	150	100	60	25	20
0.5	-4	95	62	30	15	7.5
0.5	+30	65	45	25	10	5.0

When totally wet, the sheeting shall now show less than 90 percent of the values of retro-reflectance indicated in Table – 800 – 1. At the end of 7 years, the sheeting shall retain at least 75 percent of its original retro-reflectance.

**801.3.3. Engineering grade sheeting:** This sheeting shall be of enclosed lens type consisting of microscopic lens elements embedded beneath the surface of a smooth, flexible, transparent, water-proof plastic, resulting in a non-exposed lens optical reflecting system. The retro-reflective surface after cleaning with soap and water and in dry condition shall have the minimum coefficient of retro-reflection (determined in accordance with ASTM Standard: E-810) as indicated in Table 800-2.

**TABLE 800 –2. ACCEPTABLE MINIMUM COEFFICIENT OF RETRO-REFLECTION FOR  
ENGINEERING GRADE SHEETING  
(CANDELAS PER LUX PER SQUARE METRE)**

Observation angle in degree	Entrance angle in degree	Whit e	Yello w	Orange	Green	Red	Blue
0.2	-4	70	50	25	9.0	14.5	4.0
0.2	+30	30	22	7.0	3.5	6.0	1.7
0.5	-4	30	25	13.5	4.5	7.5	2.0
0.5	+30	15	13	4.0	2.2	3.0	0.8

When totally wet, the sheeting shall not show less than 90 percent of the values, of retro-reflection indicated in Table 800 -2. At the end of 5 years, the sheeting shall retain at least 50 percent of its original retro-reflectance.

**801.3.4. Messages / borders:** The messages (legends, letters, numerals etc.) and borders shall either be screen printed or of cut-outs. Screen printing shall be processed and finished with materials and in a manner specified by the sheeting manufacturer. Cut-outs shall be of materials as specified by the sheeting manufacturer and shall bonded with the sheeting in a manner specified by the manufacturer.

**801.3.5.** For screen-printed transparent coloured areas on white sheeting, the co-efficient of retro-reflection shall not be less than 50 percent of the values of corresponding colour in Table 800-1 and 2, as applicable.

**801.3.6.** Cut-out messages and borders, wherever used, shall be made out of retro-reflective sheeting (as per Clause 801.3.2. or 801.3.3. as applicable), except those in black which shall be of non-reflective sheeting.

**801.3.7. Colour:** Unless otherwise specified, the general colour scheme shall be as stipulated in IS: 5 “Colour for Ready Mixed Paints “. viz.

Blue	IS	Colour	No.166	French Blue
Red	IS	Colour	No.537	Signal Red
Green	IS	Colour	No.284	India Green
Orange	IS	Colour	No.591	Deep Orange

The colours shall be durable and uniform in acceptable hue when viewed in day light or under normal headlights at night.

**801.3.8. Adhesives:** The sheeting shall either have a pressure-sensitive adhesive of the aggressive –tack type requiring no heat, solvent or other preparation for adhesion to a smooth clean surface, or a tack free adhesive activated by heat, applied in a heat – vacuum applicator, in a manner recommended by the sheeting manufacturer. The adhesive shall be protected by an easily removable liner (removable by peeling without soaking in water or other solvent) and shall be suitable for the type of material of the base plate used for the sign. The adhesive shall form a durable bond to smooth, corrosion and weather resistant surface of the base plate such that it shall not be possible to remove the sheeting from the sign base in one piece by use of sharp instrument. In case of pressure-sensitive adhesive sheeting, the sheeting shall be applied in accordance with the manufacturer’s specifications. Sheetting with adhesives requiring use of solvents or other preparation for adhesive shall be applied strictly in accordance with the manufacturer’s instructions.

**801.3.9. Refurbishment:** Where existing signs are specified for refurbishment, the sheeting shall have a semi-rigid aluminium backing pre-coated with aggressive – tack type pressure sensitive adhesive. The adhesive shall be suitable for the type of material used for the sign and should thoroughly bond with that material.

#### **801.3.10 Fabrication:**

**801.3.10.1.** Surface top be reflectorised shall be effectively prepared to receive the retro-reflective sheeting. The aluminium sheeting shall be de-greased either by acid or hot alkaline etching and all scale/dust removed to obtain a smooth plain surface before the application of retro-reflective sheeting. If the surface is rough, approved surface primer may be used. After cleaning, metal shall not be handled, except by suitable device or clean canvas gloves, between all cleaning and preparation operation and application of reflective sheeting/primer. There shall be no opportunity for metal to come in contact with grease, oil or other contaminants prior to the application of retro-reflective sheeting.

**801.3.10.2.** Complete sheets of the material shall be used on the signs except where it is unavoidable; at splices, sheeting with pressure sensitive adhesives shall be overlapped not less than 5 mm. Sheetting with heat-activated adhesives may be spliced with an overlap not less than 5 mm or butted with a gap not exceeding 0.75 mm. Where screen printing with transparent colours is proposed, only butt jointing shall be used. The material shall cover the sign surface evenly and shall be free from twists, cracks and folds. Cut –

outs to produce legends and borders shall be bonded with the sheeting in the manner specified by the manufacturer.

**801.3.11. Warranty and durability:** The contractor shall obtain from the manufacturer a seven-year warranty for satisfactory field performance including stipulated retro-reflectance of the retro-reflective sheeting of high intensity grade and a five year warranty for the adhesive sheeting of engineering grade and submit the same to the engineer. In addition, a seven year and a five year warranty for satisfactory in-field performance of the finished sign with retro-reflective sheeting of high intensity grade and engineering grade respectively, inclusive of the screen printed or cut out letters/legends and their bonding to the retro-reflective sheeting shall be obtained from the Contractor/supplier and passed on to the Engineer. The Contractor/supplier shall also furnish a certification that the signs and materials supplied against the assigned work meets all the stipulated requirements and carry the stipulated warranty.

Processed and applied in accordance with recommended procedures, the reflective material shall be weather resistant and, following cleaning, shall show no appreciable discolouration, cracking, blistering or dimensional change and shall not have less than 50 percent of the specified minimum reflective intensity values (Table 800-1 and 800-2) when subjected to accelerated weathering for 1000 hours, using type E or EH WeatheroMetre (AASHTO Designation M 268).

#### **801.4. Installation**

**801.4.1.** Sign posts, their foundations and sign mountings shall be so constructed as to hold these in a proper and permanent position against the normal storm wind loads or displacement of vandalism. Normally, signs with an area up to 0.9 sq. m. shall be mounted on a single post, and for greater area two or more supports shall be provided. Sign supports may be of mild steel, reinforced concrete or galvanized iron (G. I). Post-end(s) shall be firmly fixed to the ground by means of properly designed foundation. The work of foundation shall conform to relevant Specifications as specified.

**801.4.2.** All components of signs and supports, other than the reflective portion and G. I. posts shall be thoroughly descaled, cleaned, primed and painted with two coats of epoxy paint. Any part of mild steel (M. S.) post below ground shall be painted with three coats of red lead paint.

**801.4.3.** The signs shall be fixed to the posts by welding in the case of steel posts and by bolts and washers of suitable size in the case of reinforced concrete or G. I. posts. After the nuts have been tightened, the tails of the bolts shall be furred over with a hammer to prevent removal.

#### **801.5. Measurements for Payment**

The measurement of standard cautionary, mandatory and information signs shall be in numbers of different types of signs supplied and fixed, while for direction and place identification signs, these shall be measured by area in square metres.

#### **801.6. Rate**

The contract unit rate shall be payment in full for the cost of making the road sign, including all materials, installing it at the site and incidentals to complete the work in accordance with the Specifications

**Payment shall made on number basis**

### **Item No.51**

**Cautionary Warning Sign : Providing and fixing sign boards made out of 2mm Aluminium sheet size 90x90x90 cms. Equilateral triangle as per the design of IRC-67-1977 pre treated with phosphating process and acid etching coated with one coat of epoxy primer and two coats of best quality epoxy paint reflectorized with retro reflective sheeting as per latest MOST specification 3.1 Mt. long stand post and frame fabricated from suitable size iron angle of 35x35x3mm, 75x75x6mm. as required painted with best quality epoxy coating in black and white bends the details of symbol for each board shall be as per the instruction of Engineer in charge the fixing at site shall be in 1:2:4 CC block of size 45x45x60cms. for each leg including excavation curbing etc. complete under the supervision of engineer in charge (A) Engineering Grade.**

### 1403.11. Warning/Cautionary Signs :

**1403.11.1.** Advance warning / cautionary signs giving the information about the nearness of submersible bridge, speed limit and depth of water at ordinary flood level, length of submergence of road to the user shall be installed.

Advance warning-cum-informatory signs shall be located at about 200 m. from the start of submerged portion of approach road / bridge / SLOW DOWN SUBMERSIBLE BRIDGE 200 m AHEAD" and second sign at about 50 m from the starting point of submersible bridge "DEAD SLOW SUBMERSIBLE BRIDGE 50 M AHEAD. NOT SAFE FOR VEHICULAR TRAFFIC TO CROSS WHEN FLOOD WATER OVERTOPS BRIDGE DECK".

**1403.11.2.** Advance warning / cautionary signs shall be in English as well as in local language and shall conform to the provisions of Clause 1701 of these Specifications.

### 1701.3. Materials

The various materials and fabrication of the traffic signs shall conform to the following requirements:-

**1701.3.1. Concrete :** Concrete for footing shall be of the grade shown on the Contract drawings or of minimum M15 grade conforming to Section 801 of these Specifications.

**1701.3.2. Reinforcing steel :** Reinforcing steel shall conform to the requirement of IS:1786 unless otherwise shown on the drawing.

**1701.3.3. Bolts, nuts, washers :** High strength bolts shall conform to IS: 1367.

**1701.3.4. M.S. Sheets, Plates and supports :** Plates and support sections for the sign posts shall conform to IS:2062 or any other relevant IS Specifications.

**1701.3.5. Reflectorised paint:** Reflectorised paint shall conform to IS:5 or the manufacturer's specifications in case of proprietary product and as approved by the Engineer.

**1701.3.6. Non reflectorised paint :** Non-reflectorised paint shall conform to IS: 164 and as approved by the Engineer.

**1701.3.7. Engineering grade sheeting :** This sheeting shall be enclosed lens type consisting of microscopic lens elements embedded beneath the surface of a smooth, flexible, transparent, water-proof plastic, resulting in a non-exposed lens optical reflecting system. The retro-reflective surface after cleaning with soap and water and in dry condition shall have the minimum coefficient of retro-reflection (determined in accordance with ASTM Standard) as indicated in Table 1700.1.

When totally wet, the sheeting shall not show less than 90 per cent of the values, of retro-reflection indicated in Table 1700.1. At the end of 5 years, the sheeting shall retain at least 50 per cent of its original retro-reflectance.

**TABLE 1700.1 : ACCEPTABLE MINIMUM COEFFICIENT OF RETRO-REFLECTION FOR ENGINEERING GRADE SHEETING (CANDEL AS PER LUX PER SQUARE METRE)**

Observation angle in degree	Entrance angle in degree	White	Yellow	Orange	Green	Red	Blue
-----------------------------	--------------------------	-------	--------	--------	-------	-----	------

0.2	-4	70	50	25	9.0	14.5	4.0
0.2	+30	30	22	7.0	3.5	6.0	1.7
0.5	-4	30	25	13.5	4.5	7.5	2.0
0.5	+30	15	13	4.0	2.2	3.0	0.8

**1701.3.8.** Signs with a maximum side dimension not exceeding 600 mm shall not be less than 1.5 mm thick. All others shall be at least 2 mm thick. The thickness of the sheet shall be related to the size of the sign board and its support and shall be such that it does not bend or deform under the prevailing wind and other loads.

**1701.3.9.** In respect of sign sizes not covered by IRC:67, the structural details (thickness, etc.) shall be as per the approved drawings.

#### **1701.4. Installation**

**1701.4.1.** Sign posts, their foundations and sign mountings shall be so constructed as to hold these in a proper and permanent position against the normal storm wind loads or displacement by vandalism. Normally signs with an area upto 0.9 sq.m can be mounted on a single post and for greater area two or more supports shall be provided. Sign supports may be of mild steel, reinforced concrete or Galvanised Iron (G.I.) posts and should be firmly fixed to the ground by means of properly designed foundation. The work of foundation shall conform to relevant Specifications as specified.

**1701.4.2.** All components of signs and supports, other than the reflective portion and G.I. posts shall be thoroughly de-scaled, cleaned, primed and painted with two coats of epoxy paint. Any part of mild steel (M.S.) post below ground shall be painted with three coats of red lead paint.

**1701.4.3.** The signs shall be fixed to the posts by welding in the case of steel posts and by bolts and washers of suitable size in the case of reinforced concrete or G.I. posts. After the nuts have been tightened, the tails of the bolts shall be furred over with a hammer to prevent removal.

**1701.4.4.** Mild steel sheets of sign boards shall be stove enameled on both sides in furnace at required temperature, the lettering, borders shall be painted with ready mix synthetic enamel paint of superior quality in required shade and colour as specified.

#### **1701.5. Measurements for Payment**

The measurement of standard cautionary, mandatory and facility information signs shall be in numbers of different types of signs supplied and fixed, while for direction and place identification signs, these shall be measured by area in square metres.

#### **1701.6. Rate**

The Contract unit rate shall be payment in full for the cost of making the road sign including all materials and installing it at the site and incidentals to complete the work to the Specifications.

The work covers supplying and installing traffic signs conforming to IRC 67 complete in all respects in accordance with these specifications and as approved by the Engineer.

- (1) The Board will be a composite unit consisting of aluminum Plates of 2 mm thickness. The main lower most Aluminum will be 1800mm x 1600mm size welded over M.S. angle iron frame of 35mm x 35mm x 3mm size. Welding of all sheet over angle and flat iron frame will be done neatly to have plain surface on side. The angle iron frame of the lower most plate and flat frame of the middle plate will be welded to two not. 75mm x 75mm x 6mm M.S angle

posts placed at 1125 mm apart center to center. The top of the middle. These posts will be embedded in cement concrete M-15 grade blocks of 450mm x 450mm x 600mm below ground level. The height of bottom of the lower most plate will be 1200mm from ground level

- (2) All Aluminum plates will be stove enameled on both sides in furnace at required temperature. The lettering details of works in prescribed format will be painted with ready mixed synthetic enamel paints of superior quality in required shade and colour as specified. All the sections for frame and posts will be painted with primer and two coats of Epoxy paint. The steel angle below ground level will be painted with three coats of epoxy paint, painting and lettering will be done as per approved drawing.

Payment shall made on number basis

## **Item No.52**

**Citizen's information Board. Providing and fixing of typical MMGSY information board as per instruction. Two MS sheets of 3 mm thick, of 900 mm x 750mm size fixed at top & bottom duly rivetted with MS angles of 25 x 25 x 5 mm thick M.S angle shall be welded by two vertical M.S angle of 5 mm thick to 75 mm x 75 mm of 12 SWG square tubes posts duly embedded in cement concrete M-15 grade blocks of 600mm x 600mm x 750mm, below ground level. The letters & figure of any shade reflectorized with High Intensity Prismatic Grade Retro Reflective Sheeting of Type-4 as per ASTM D-4956 and latest MORD specifications; All sections of framed posts and steel tube will be painted with primer and two coats of epoxy paints as per drawing Clause 1701 and Annexure 1700.1 (10.16). (A) Class-B High intensity Grade Retro Reflective sheeting.**

### **Guidelines for Installation of Signages for "MUKHYAMANTRIGRAMSADAKYOJANA"**


All the roads under MMGSY shall be installed with Mandatory regulatory signs, Cautionary / Warning Signs and informatory signs as per the provisions contained in code of practice for Road signs, IRC 67-2012 and as per the provisions given in Section 1700 of Specifications for Rural Roads, Ministry of Rural Development published by IRC in year January-2014. Adequate provisions for Road Signs, Road Markings, Cat Eyes and other road appurtenances shall be made in project.

In addition to above, it would be mandatory to install "MMGSY Logo Board", Main Informatory Sign board as per the guidelines given Below:

1. **Logo Board at Starting point of the MMGSY Road:** Any road work under Mukhya Mantri Gram Sadak Yojana generally starts from existing NH, SH, MDR or ODR and it is essential that the information should be displayed on the road from where the MMGSY road starts, as such, a "Logo Board – Entry" shall be installed as per the design & details given in Figure-1. The information should be displayed in such a way that the information should be visible from both the directions
2. **Logo Board at Intermediate distance on the MMGSY Road:** logo boards shall be fixed in the following manner:
  - 2.1. If the road length is < 2km (Less than 2kms), one logo board at finishing point of the road
  - 2.2. If the road length is > 2km (More Than 2kms), one logo board at appr. 2km including the board at the finishing point of the road
  - 2.3. Size of the MMGSY Logo: 600mm x 600mm
  - 2.4. Size of the MMGSY Title Plate: 1100mm x 300mm
3. **MMGSY Project Title Information Board:** A Title information board as prescribed in section 1700 of specifications for Rural road published by IRC in January 2014 shall be fixed at starting point of MMGSY road. The details and design are given in figure 2.
4. **MMGSY Citizen Information Board:** A Citizen information board should be fixed at starting point of MMGSY road. The details and design are given in figure 3.

**FIGURE: 3 - MMGSY CITIZEN INFORMATION SIGN BOARD**

**MMGSY Citizen's information Board-** Providing and fixing of typical MMGSY information board as per instruction. Two MS sheets of 3 mm thick, of 900 mm x 750mm size fixed at top & bottom duly rivetted with MS angles of 25 x 25 x 5 mm thick M.S angle shall be welded by two vertical M.S angle of 5 mm thick to 75 mm x 75 mm of 12 SWG square tubes posts duly embedded in cement concrete M-15 grade blocks of 600mm x 600mm x 750mm, below ground level. The letters & figure of any shade reflectorised with High Intensity Prismatic Grade Retro Reflective Sheeting of Type-4 as per ASTM D-4956 and latest MORD specifications; All sections of framed posts and steel tube will be painted with primer and two coats of epoxy paints as per drawing Clause 1701 and Annexure 1700.1 (10.16). (A) Class-B High intensity Grade Retro Reflective sheeting.

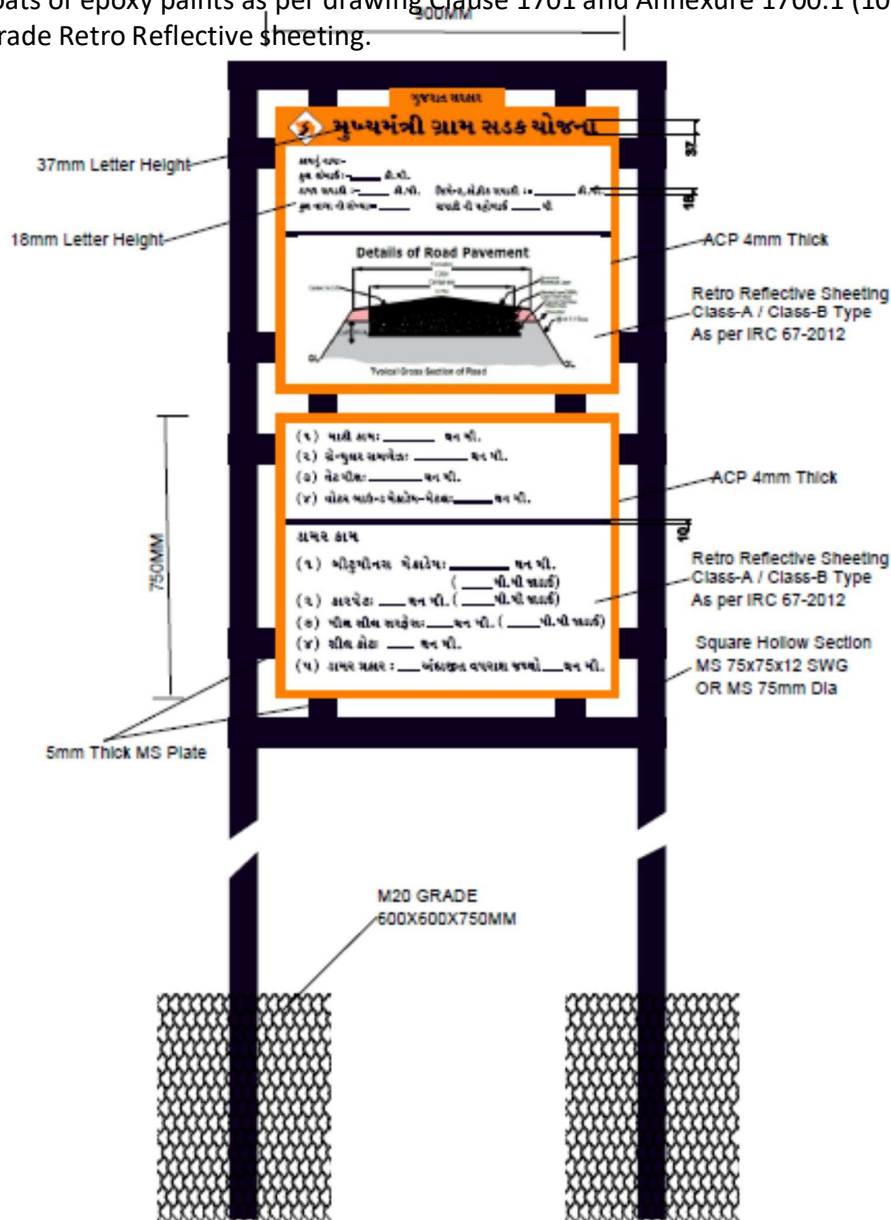

## **Detailed Technical Specifications**

### **Placement and Operation of Road Signs**

Placement of road signs will be within road users' view. To aid in conveying proper meaning, road signs will be positioned with respect to the location or situation to which it applies. The location and legibility of the road sign will be such as to provide adequate response time to road users to read and take action at the operating speed.

### **Orientation of Signs**

The signs will be placed at right angles to the line of travel of the approaching traffic. Where light reflection from the sign face is encountered to such an extent as to reduce legibility, the sign should be turned slightly away from the road. On horizontal curves, the sign should not be fixed normal to the carriageway but the angle of placement will be determined with regard to the course of the approaching traffic.

Sign faces will be normally vertical, but on gradients it may be desirable to tilt a sign forward or backward from the vertical to make it normal to the line of sight and improve the viewing angle.

**Cautionary/warning** and mandatory signs will be fabricated through process of screen printing. In case the facility is not locally available in the region of work, these signs and informatory signs may have inscription /message having cut letters of non-reflective black sheeting which shall be bonded well or the base sheeting as directed by Engineer in charge.

### **1. Material for Signs:**

The various materials and fabrication of road signs shall conform to the following requirements:

#### **1.1 Concrete**

Concrete for footing shall be of the grade shown on the contract drawings or of minimum M15 grade confirming to section 800 of the specifications for MORD.

#### **1.2 Reinforcing Steel**

Reinforcing steel shall conform to the requirements of IS 1786 unless otherwise specified.

#### **1.3 Bolts, Nuts and Washers**

High strength bolts shall conform to IS 1367 whereas precision bolts, nuts, etc. shall conform to IS 1364.

#### **1.4 Plates and Supports**

Plates and support sections for the signposts shall conform to IS 226 and IS 2062 or any other stated IS specification.

#### **1.5 Substrate**

Aluminium Composite Material(ACM) conforming to following subsections.

**a) Aluminium Sheet**

Aluminium sheets used for sign boards shall be of smooth, hard and corrosion resistant aluminium alloy conforming to IS 736 - Material Designation 24345 or 1900.

**b) Aluminum Composite Material (ACM)**

ACM sheets used for sign boards is a sandwiched construction with a thermoplastic core of „Low Density Polyethylene“ (LDPE) between two thick skins/sheets of Aluminium with overall thickness of 4 mm and 3 mm, and Aluminium skin thickness of 0.4 - 0.5 mm and 0.25 - 0.3 mm respectively on both sides. The retro reflective sheeting must be applied on the top surface with aluminum surface with recommended surface preparation from sheeting manufacturer. A fluorocarbon coating may be applied over the exposed surface of aluminium to ensure corrosion resistant and weatherability and shall conform to relevant ASTM. The mechanical properties of 4mm and 3mm ACM and that of its Aluminum skin shall conform to the requirement given in Table 1.1, when tested in accordance with the test methods mentioned against each of them

Table 1.1 Specifications for Aluminum Composite Material (ACM)

<i>Sl No.</i>	<i>Description</i>	<i>Specification for 4mm</i>		<i>Specification for 3mm</i>
		<i>Standard test</i>	<i>Acceptable value</i>	<i>Acceptable value</i>
<b>A</b>	<b><i>Mechanical Properties of ACM</i></b>			
<b>1</b>	Peel off strength with retro reflective sheeting. (Drum Peel Test)	ASTM D903	<i>Min. 4 N/mm</i>	<i>Min. 4 N/mm</i>
<b>2</b>	Tensile strength	ASTM E8	<i>Min. 40 N/mm<sup>2</sup></i>	<i>Min. 30 N/mm<sup>2</sup></i>
<b>3</b>	0.2% Proof Stress	ASTM E8	<i>Min. 34 N/mm<sup>2</sup></i>	<i>Min. 34 N/mm<sup>2</sup></i>
<b>4</b>	Elongation	ASTM E8	<i>Min. 6 %</i>	<i>Min. 5 %</i>
<b>5</b>	Flexural strength	ASTM C393	<i>Min. 130 N/mm<sup>2</sup></i>	<i>Min. 120 N/mm<sup>2</sup></i>
<b>6</b>	Shear strength with Punch shear test	ASTM D732	<i>Min. 18 N/mm<sup>2</sup></i>	<i>Min. 18 N/mm<sup>2</sup></i>
<b>B</b>	<b><i>Properties of Aluminium Skin</i></b>			
<b>1</b>	Tensile strength (Rm)	ASTM E8	<i>Min. 150 N/mm<sup>2</sup></i>	<i>Min. 130 N/mm<sup>2</sup></i>
<b>2</b>	Modulus of elasticity	ASTM E8	<i>Min. 70,000 N/mm<sup>2</sup></i>	<i>Min. 70,000 N/mm<sup>2</sup></i>
<b>3</b>	Elongation	ASTM E8	<i>A<sub>50</sub> Min. 2%</i>	<i>A<sub>50</sub> Min. 2%</i>
<b>4</b>	0.2 % Proof Stress	ASTM E8	<i>Min. 110 N/mm<sup>2</sup></i>	<i>Min. 110 N/mm<sup>2</sup></i>

### **c) Plate Thickness**

Shoulder mounted ground signs with a maximum side dimension not exceeding 600 mm shall not be less 3 mm thick with Aluminium Composite Material. All other signs shall be at least 4 mm thick with Aluminium Composite Material. The thickness of the sheet shall be related to the size of the sign and its support and shall be such that it does not bend or deform under prevailing wind and other loads. All overhead signs made with Aluminium Composite Material shall be minimum 4 mm thick to withstand wind and other loads without deformation.

#### **1.6 Retro Reflective Sheeting**

The retro reflective sheeting used on the signs shall consist of white or coloured sheeting having a smooth outer surface, which has the property of retro reflection over its entire surface. It shall be weather resistant and exhibit colour fastness. It shall be new and unused and show no evidence of cracking, scaling, and pitting, blistering, edge lifting or curling and shall have negligible shrinkage or expansion. A certificate of having the sheeting tested for coefficient of retro reflection, daytime colour and luminance, shrinkage, flexibility, liner removal, adhesion, impact resistance, specular gloss and fungus resistance, 3 years outdoor weathering and its having passed these tests shall be obtained from International/Government laboratory/Institute by the manufacturer of the sheeting and in case the certificate is obtained from international agency, it should also be obtained from Indian agency within 3 years of launching of product by the manufacture in abroad. Alternatively, a certificate conforming to ASTM Specification (D 4956-09) on artificial accelerated weathering requirements from a reputed laboratory in India will be accepted. The supplier will have to submit performance guarantee of meeting the requirement of three years outdoor weathering of the sheeting.

All micro prismatic grade sheets will be as per ASTM D 4956-09 Type IV. The reflective sheeting shall be made of micro prismatic retro-reflective material. The retro-reflective surface, after cleaning with soap and water and in dry condition shall have the minimum co-efficient of retroreflection (determined in accordance with ASTM D 4956-09), When totally wet, the sheeting shall show not less than 90 percent of the values, of retro-reflection indicated in **6.4**. at the end of the 7 years, the sheeting shall retain at least 80 percent of its original retro-reflectance.

**1.7 Messages/borders:** The message (legends, letters, numerals etc.) letter, numerals, symbols /legend/arrow etc. in Gujarati, Hindi and /or English, should either be screen-printed or to be cut out from durable transparent Overlay Electrocutable film or cut out from the same type of reflective sheeting for the cautionary /mandatory sign boards. The screen printing shall be processed and finished with materials and in a manner specified by the sheeting manufacturer. For the informatory and other sign boards, the messages (legends, letters, numerals etc.) and borders shall be cut out from durable transparent overlay film or cut-out from the same reflective sheeting only. Cut outs shall be from durable transparent overlay materials as specified by the sheeting manufacturer and shall be bonded with the sheeting in the manner specified by the manufacturer. For screen-printed transparent coloured areas on white sheeting, the coefficient of retro-reflection shall not be less than 50 per cent of the values of corresponding colour in the

above table. Cut-out messages and borders, wherever used, shall be either made out of retro reflective sheeting or made out of durable transparent overlay except those in black which shall be of non-reflective sheeting or opaque in case of durable transparent overlay.

Table 6.4: Acceptable Minimum Coefficient of Retro-reflection for Type-IV Prismatic Grade Sheeting (Candelas per Lux per Square Metre)

Observation Angle	Entrance Angle	White	Yellow	Orange	Green	Red	Blue	Brown	Yellow-Green	Fluorescent Yellow	Fluorescent Orange	Fluorescent
0.1° <sup>B</sup>	-4°	500	380	200	70	90	42	25	400	300	150	
0.1° <sup>B</sup>	+30°	240	175	94	32	42	20	12	185	140	70	
0.2°	-4°	360	270	145	50	65	30	18	290	220	105	
0.2°	+30°	170	135	68	25	30	14	8.5	135	100	50	
0.5°	-4°	150	110	60	21	27	13	7.5	120	90	45	
0.5°	+30°	72	54	28	10	13	6	3.5	55	40	22	

<sup>A</sup> Minimum Coefficient of Retro reflection ( $R_A$ )(cd.lx<sup>-1</sup>.m<sup>-2</sup>).

<sup>B</sup> Values for 0.1° observation angles are supplementary requirements that shall apply only when specified by the purchaser in the contract or order.

**1.8 Adhesives:** The sheeting shall have a pressure-sensitive adhesive of the aggressive-tack type requiring no heat, solvent or other preparation for adhesion to a smooth clean surface. The adhesive shall be protected by a removable liner (removable by peeling without soaking in water or other solvent) and shall be suitable for the type of material of the base plate used for the sign. The adhesive shall form a durable bond to smooth, corrosion and weather resistant surface of the base plate such that it shall not be possible to remove the sheeting from the sign base in one piece by use of sharp instrument. In case of pressure-sensitive adhesive sheeting, the sheeting shall be applied in accordance with the manufacturer's Specifications.

### 1.9 Fabrication:

Surface to be reflectorised shall be effectively prepared to receive the retroreflective sheeting. The aluminum sheeting shall be de-greased either by acid or hot alkaline etching and all scale/dust removed to obtain a smooth plain surface before the application of retro-reflective sheeting. If the surface is rough, approved surface primer may be used. After cleaning, metal shall not be handled, except by suitable device or clean canvas gloves, between all cleaning and preparation operation and application of reflective sheeting/primer. There shall be no opportunity for metal to come in contact with grease, oil or other contaminants prior to the application of retro-reflective sheeting. Complete sheets of the material shall be used on the signs except where it is unavoidable. At splices, sheeting with pressure-sensitive adhesives shall be overlapped not less than 5 mm. Where screen printing with transparent colours is proposed, only butt joint shall be used. The material shall cover the sign surface evenly and shall be free from twists, cracks and folds. Cut-outs to produce legends and borders shall be bonded with the sheeting in the manner specified by the manufacturer.

### 1.10 Installation

**1.10.1** Sign posts, their foundations and sign mountings shall be so constructed as to hold these in a proper and permanent position against the normal storm wind loads or displacement by vandalism. Normally, signs with an area upto 0.9 sq. m. shall be mounted on a single post, and for greater area two or more supports shall be provided. Sign supports may be of mild steel, reinforced concrete or galvanized iron (G.I.). Post( s) shall be firmly fixed to the ground by means of properly designed foundation. The work of foundation shall conform to relevant Specifications as specified.

**1.10.2** All components of sign and supports, other than the reflective portion and MS / G.I. posts shall be thoroughly descaled, cleaned, primed and painted with two coats of epoxy paint. Any part of mild steel (M.S.) post below ground shall be painted with three coats of red lead paint.

**1.10.3** The signs shall be fixed to the posts by welding in the case of steel posts and by bolts and washers of suitable size in the case of reinforced concrete or G.I. posts. After the nuts have been tightened, the tails of the bolts shall be furred over with a hammer to prevent removal.

#### **1.10.4 Fixing**

##### **1.10.4.1 Materials**

The various materials and fabrication of the traffic signs shall conform to the following requirements:

**4.1.1. Concrete:** Concrete shall be of the M20 grade or as shown on the Contract drawings or otherwise as directed by the Engineer.

**4.1.2. Water:** Water shall conform to IS: 456-1978. Storage & handling of water shall be clean.

**4.1.3. Cement:** Cement shall conform to IS: 269-1976 or I.S: 455-1976.

**4.1.4. Sand, aggregates:** Sand, aggregate & its gradation shall conform to M6, M12 & M13 of General Technical Specifications for Building Works..

##### **1.10.4.2. Installation**

**4.2.1.** The supporting structure and signs shall be fabricated and erected as per details given in the plans.

**4.2.2.** The work of construction of foundation for sign supports including excavation and backfill, forms, steel reinforcement, concrete and its placement shall conform to the relevant Specifications given in these Specifications.

**4.2.3.** Signs posts, their foundations and sign mountings shall be so constructed as to hold signs in a proper and permanent position to adequately resist swaying in the wind or displacement by vandalism.

**4.2.4** After installation of sign is complete, the sign shall be inspected by the Engineer. If specular reflection is apparent on any sign, its positioning shall be adjusted by the Contractor to eliminate or minimize this condition.

**1.11 Warranty and durability:** The Contractor shall obtain from the manufacture a seven-year warranty for satisfactory field performance including stipulated retroreflectance of the retro- reflectance sheeting. And submit the same to the Engineer. The Contractor/supplier shall also furnish a certification that the signs and materials supplied against the assigned work meets all the stipulated requirements and carry the stipulated warranty. Processed and applied in accordance with recommended procedures, the reflective material shall be weather resistant and, following cleaning, shall show no appreciable discolouration, cracking, blistering or dimensional change and shall not have less than 50 per cent of the specified minimum reflective intensity values (Table 800-1 and 800-2) when subjected to accelerated weathering for 1000 hours, using type E or EH weatherometer (AASHTO Designation M 268).

#### **1.12 Measurements for Payment**

The measurement of standard cautionary, mandatory and information signs supplied and fixed, while for direction and place identification signs, these shall be measured in No. basis.

### **1.13 Rate**

The Contract unit rate shall be payment in full for the cost of making the road sign, including all materials, installing it at the site and incidentals to complete the work in accordance with the Specifications.

### **Item No.53**

**Road Marking with Hot Applied paints with reflectorising glass beads on bitumin surface providing and laying a hot applied thermoplasting compound 2.5mm thick including reflectorising glass beads @250 gm per sq.mtr area, thickness of 2.5mm is excluding of surface applied glass beads as per IRC:35-2015 the finished surface to be level, uniform and free from streaks and holes, zebra patta/bump/centerline/edge line/ cut patta. the while color marking should provide liminance coefficient on cement road shall be min. 130 mcd/m2/lux and asphalt road shall be min 100 mcd/m2/lux during the survice life during the date the marking should meet the performanace criteria for night time reflectivity, wet reflectivity and skid resistance as mentioned in the section-15 of IRC 35-2015 warranty for retroreflectivity shall be two years.**

#### ***1702 road MarkinGs***

##### **1702.1 scope**

The work shall consist of providing road markings at site including supply of materials and carrying out the work in accordance with IRC:35 and these Specifications.

##### **1702.2 General**

The colour, width and layout of road markings shall be in accordance with the Code of Practice for Road Markings IRC:35 and as specified in the drawings or as directed by the Engineer. No centre line marking shall be done on single-lane roads.

##### **1702.3 Materials**

Ordinary paints shall be used for road markings, conforming to IS:164. These shall have a wear resistance of at least 4 hours under accelerated laboratory test. Yellow colour (conforming to IS colour No. 356) as given in IS:164, white and black colours are the standard colours used for markings.

##### **1702.4. application**

**1702.4.1** Painting may be done by machine or by hand (preferably by machine). The Contractor shall maintain traffic control while painting operations are in progress so as to cause minimum inconvenience to traffic compatible with protecting the workmen.

**1702.4.2** The finished lines shall be free from ruggedness on sides and ends and be in true plane with the general alignment of the carriageway. The upper surface of the lines shall be level, uniform and free from streaks.

##### **1702.5 Measurements for payment**

The painted markings shall be measured in linear metres with no deductions for intermediate gaps as shown on the drawings.

In respect of markings, like directional arrows and lettering, etc., the measurement shall be by numbers.

## **1702.6 rate**

The Contract unit rate for road markings shall be payment in full compensation for furnishing all labour, materials, tools, equipment, and carrying out the markings at site as per the approved drawing(s) or as directed by the Engineer and all other incidental costs necessary to complete the work in accordance with these Specifications.

### **Payment shall made on Sgm basis**

## **Item No.54**

**Cate eye / road stud/ RPM : Supplying Raised Pavement markers of polycarbonate and ABS moulded body and reflective panels with micro prismatic lens (No glass bead lens) capable of providing total internal reflection of the light entering the lens face and shall support a load of 13635 kgs. tested in accordance to ASTM D 4280 type H and complying to specification of category A of MORTH circular No RW/NH/33023/10-97-DO III Dt. 11-06-1997. the height, width and length shall be exceed 20mm, 130mm and 130mm and with minimum reflective area of 13sqcm on each side and the slope to the base shall be 35+/-5 degree. the body of the marker should having finger grip for easy and accurate placement and application with epoxy /bituminous adhesive as recommended by the manufacturer of the marker. the colour of the marker should be as per the IRC:35-2015 and as directed by Engineer-in-charge..**

### **1707 reflective paveMent Markers (roaD stuDs)**

#### **1707.1scope**

The work shall cover the providing and fixing of Reflective Pavement Marker (RPM) or a road stud, a device which is bonded to or anchored within the road surface, for lane marking and delineation for night-time visibility as specified in the Contract.

#### **1707.2 Material**

**1707.2.1** Plastic body of RPM/road stud shall be moulded from ASA (Acrylic Styrene Acrylonitrile) or HIPS (Hi-impact Polystyrene) or Acrylonitrile Butadiene Styrene (ABS) or any other suitable material approved by the Engineer. The markers shall support a load of 13,635 kg tested in accordance with ASTM D 4280.

**1707.2.2** Reflective panels shall consist of number of lenses containing single or dual prismatic cubes capable of providing total internal reflection of the light entering the lens face. Lenses shall be moulded of methyl methacrylate conforming to ASTM D 788 or equivalent.

#### **1707.3 Design**

The slope or retro-reflecting surface shall preferably be  $35^{\circ} \pm 5^{\circ}$  to base and the area of each retro-reflecting surface shall be not less than 13.0 sqcm.

#### **1707.4 optical performance**

##### **1707.4.1 Unidirectional and bi-directional studs**

Each reflector or combination of reflectors on each face of the stud shall have a minimum Coefficient of Luminous Intensity (CIL) as given in **tables 1700.6 or 1700.7** as appropriate.

**table 1700.6 Minimum cil values for category ‘a’ studs**

entrance angle	observation angle	cil in mcd/lx		
		white	amber	red
0°U 5°L&R	0.3°	220	110	44

0°U 10°L&R	0.5°	120	60	24
------------	------	-----	----	----

**table 1700.7 Minimum cil values for category ‘B’ studs**

entrance angle	observation angle	cil in mcd/lx		
		white	amber	red
0°U 6°L&R	0.3°	20	10	4
0°U 10°L&R	0.5°	15	7.5	3

**Notes :** 1) The entrance angle of 0°U corresponds to the normal aspect of the reflectors when the reflecting road stud is installed in horizontal road surface.

- 2) The stud incorporating one or more corner cube reflectors shall be included in Category ‘A’. The stud incorporating one or more bi-convex reflectors shall be included in Category ‘B’.

#### **1707.4.2 Omni-directional studs**

Each Omni-directional stud shall have a minimum (CIL) of 2 mcd/lx.

#### **1707.5 tests**

**1707.5.1** Co-efficient of luminance intensity can be measured by procedure described in ASTM E 809 “Practice for Measuring Photometric Characteristics” or as recommended in BS:873-Part 4: 1973.

**1707.5.2** Under test conditions, a stud shall not be considered to fail the photometric requirements if the measured CIL at any one position of measurement is less than the values specified in **tables 1700.6 or 1700.7** provided that

- i) the value is not less than 80 percent of the specified minimum, and
- ii) the average of the left and right measurements for the specific angle is greater than the specified minimum.

#### **1707.6 Measurements for payment**

The road studs shall be measured in numbers

#### **1707.7 rate**

The Contract unit rate for studs shall be payment in full compensation for furnishing all labour, materials, tools required for installation and fixing at the site and incidentals to complete the work in accordance with these Specifications.

### **Item No.55**

**Providing and erecting a "W" metal beam crash barrier comprising of 3mm thick corrugated sheet metal beam rail, 70cm above road/ground level, fixed on ISMC series chanel vertical post, 150x75x5mm spaced 2m center to center, 1.8m high, 1.1m below ground/road level, all steel parts and fitments to be galvanised by hot dip process, all fittings to confirm to IS: 1367 and IS 1364 metal beam rail to be fixed on the vertical post with a spacer of chanel section 150x75x5mm, 330mm long complete.**

### **810. METAL BEAM CRASH BARRIERS**

#### **810.1. General**

**810.1.1.** This work shall consist of furnishing and erection of metal beam crash barrier of dimensions and at locations as shown on the drawing (s) or as directed by the Engineer.

**810.1.2.** Metal beam crash barrier shall generally be located on approaches to bridge structures, at locations where the embankment height is more than 3 metres and at horizontal curves.

### **810.2. Materials**

**810.2.1.** Metal beam rail shall be corrugated sheet steel beams of the class, type, section and thickness indicated on the plans. Railing posts shall be made of steel of the section, weight and length as shown on the plans. All complete steel rail elements, terminal sections, posts, bolts, nuts, hardware and other steel fittings shall be galvanized. All elements of the railing shall be free from abrasions, rough or sharp edges and shall not be kinked, twisted or bent.

**810.2.2.** Steel beam elements and terminal sections shall be galvanized (zinc coated, 0.55 kg per square metre, minimum single spot) unless otherwise specified. The galvanizing on all other steel parts shall conform to the relevant IS Specifications. All fittings (bolts, nuts, washers) shall conform to the IS : 1367 and IS : 1364. All galvanizing shall be done after fabrication.

**810.2.3.** Concrete for bedding and anchor assembly shall conform to section 1700 of these Specifications.

### **810.3. Construction Operations**

**810.3.1.** The line and grade of railing shall be true to that shown on the plans. The railing shall be carefully adjusted prior to fixing in place, to ensure proper matching at abutting joints and correct alignment and camber throughout their length. Holes for field connections shall be drilled with the railing in place in the structure at proper grade and alignment.

**810.3.2.** Unless otherwise specified on the drawing, railing steel posts shall be given one shop coat of paint (primer) and three coats of paint on structural steel after erection, if the sections are not galvanised. Any part of assembly below ground shall be painted with three coats of red lead paint.

**810.3.3.** Splices and end connections shall be of the type and designs or shown on the plans and shall be of such strength as to develop full design strength of the rail elements.

### **810.4 Installation of Posts**

**810.4.1.** Holes shall be dug or drilled to the depth indicated on the plans or posts may be driven by approved methods and equipment, provided these are erected in proper position and are free from distortion and burring or any other damage.

**810.4.2.** All post holes that are dug or drilled shall be of such size as will permit proper setting of the posts and allow sufficient room for back filling and tapping.

**810.4.3.** Holes shall be back filled with selected earth or stable materials in layers not exceeding 100 mm thickness and each layer shall be thoroughly tamped and rammed. When back filling and tamping are completed, the posts or anchors shall be held securely in place.

**810.4.4.** Post holes that are drilled in rock and holes for anchor posts shall be back filled with concrete.

**810.4.5.** Posts for metal beam guardrails on bridges shall be bolted to the structure as detailed on the plans. The anchor bolts shall be set to proper location and elevation with templates and carefully checked.

### **810.5 Erection**

**810.5.1.** All guardrail anchors shall be set and attachments made and placed as indicated on the plans or as directed by the Engineer.

**810.5.2.** All bolts or clips used for fastening the guardrail or fittings to the posts shall be drawn up tightly. Each bolt shall have sufficient length to extend at least 6 mm through and beyond the full nut, except where such extensions might interfere with or endanger traffic in which case the bolts shall be cut off flush with the nut.

**810.5.3.** All railings shall be erected, drawn and adjusted so that a length of 3 metre. The railing barrier shall be erected true to line and grade.

**810.6. Tolerance -** The posts shall be vertical with a tolerance not exceeding 6 mm in a length of 3 metre. The railing barrier shall be erected true to line and grade.

**810.7. Measurements for Payment**

**810.7.1.** Metal beam railing barriers will be measured by linear metre of completed length as per plans and accepted in place. Terminals/anchors of various types shall be paid for by numbers.

**810.7.2.** No measurement for payment shall be made for projections or anchors beyond the end posts except as noted above. Furnishing and placing anchor bolts and/or devices for guard rail posts on bridges shall be considered incidental to the construction and the costs thereof shall be included in the price for other items of construction.

**810.7.3.** No measurement for payment will be made for excavation or back filling performed in connection with this construction.

**810.8. Rate**

The Contract unit rate shall include full compensation for furnishing

**CONTRACTOR'S SIGNATURE**

**EXECUTIVE ENGINEER**

Deputy Executive Engineer  
Panchayat R&B Sub Dn  
Jetpur

Executive Engineer  
Panchayat R&B Division  
Rajkot.

**- : SCHEDULE FOR TESTING OF MATERIALS :-**

For ensuring quality control and workmanship Various tests prescribed below for materials shall be taken at periodical intervals as stipulated below. The materials shall be got tested at Government recognized Laboratory (R&B) or field Laboratory of GERI (R&B) for which 1% of the estimated amount put to tender shall be recovered from the contractor from the RA bills and final bills and the testing charges shall be paid to the GERI by the Government . However if the charges increase over 1% no excess recovery shall be made from the contractor as per resolution of B & C department dated 10th May 1985 vide TNC/ 1085/ (4)/ S

Sr. No.	Material /Item	Approx. Qty.		Description of tests.	Frequency of test	No. of reqd. tests
1	Cement	1604.50	MT	Fineness, Compressive Strength, Consistency setting time, Chemical Analysis	1 test /50MT	8
2	Asphalt VG-30	118.50	MT	Penetration, Ductility, Softening point, Viscosity,	1 test / 10 tankers	2
3	Earthwork	36182	Cum	PI/ LL/ OMC / MDD / CBR Sieve Analysis	1 test / 3000 cum	13
4	for GSB material 53mm to 9.5mm	3091	Cum	CBR, Elongation, Gradation, Flakiness ,Water absorption, Impact, Abrasion etc	3 test/100 to 500cum	7
5	for GSB material 9.5mm to 2.36mm	1236	Cum	CBR, Elongation, Gradation, Flakiness ,Water absorption, Impact, Abrasion etc	3 test/100 to 500cum	5
	for WMM 45mm to 22.40	1509	Cum	Elongation, Gradation, Flakiness ,Water absorption, Impact, Abrasion etc	3 test/100 to 500cum	7
	for WMM 22.40mm to 2.36	2011	Cum	Elongation, Gradation, Flakiness ,Water absorption, Impact, Abrasion etc	3 test/100 to 500cum	7
6	M/C agg. 40 to 63 mm	75	Cum	Elongation, Gradation, Flakiness ,Water absorption, Impact, Abrasion etc	7 test/> 1500cum	1

7	M/C agg. 45 to 63 mm	326	Cum	Elongation, Gradation, Flakiness ,Water absorption, Impact, Abrasion etc	7 test/> 1500cum	3
8	M/C agg. 90 to 45 mm	348	Cum	Elongation, Gradation, Flakiness ,Water absorption, Impact, Abrasion etc	7 test/> 1500cum	3
9	Stone dust	3620	Cum	PI Value	3 test/100 to 500cum	7
10	M/C agg 13.20mm	128	Cum	Elongation, Gradation, Flakiness ,Water absorption, Impact, Abrasion etc	3 test/100 to 500cum	3
11	M/C agg 5mm and below	270	Cum	Elongation, Gradation, Flakiness ,Water absorption, Impact, Abrasion etc	3 test/100 to 500cum	3
12	M/C agg.13.20 to 10mm	135	Cum	Elongation, Gradation, Flakiness ,Water absorption, Impact, Abrasion etc	3 test/100 to 500cum	3
13	M/C agg. 37.50 to 25mm	195	Cum	Elongation, Gradation, Flakiness ,Water absorption, Impact, Abrasion etc	3 test/100 to 500cum	3
14	M/C agg.10 to 5mm	579	Cum	Elongation, Gradation, Flakiness ,Water absorption, Impact, Abrasion etc	3 test/100 to 500cum	5
15	M/C agg. 25 to 10mm Agg.	585	Cum	Elongation, Gradation, Flakiness ,Water absorption, Impact, Abrasion etc	3 test/100 to 500cum	5
<b>For C.C. Works</b>						
16	Course Sand	2223	Cum	Silt content Gradation	1test /Work	1
17	M/C 10mm.	1261	Cum	Elongation, Gradation, Flakiness ,Water absorption, Impact, Abrasion etc	3 test/100 to 500cum	5
18	M/C 20mm.	2731	Cum	Elongation, Gradation, Flakiness ,Water absorption, Impact, Abrasion etc	3 test/100 to 500cum	7

19	M/C 40mm.	335	Cum	Elongation, Gradation, Flakiness, Water absorption, Impact, Abrasion etc	1 test/100 cum	3
20	NP3 Pipes 900mm. dia.	175	Rmt	-	Manu. certificate	Manu. certificate
21	NP3 Pipes 600mm. dia.	38	Rmt	-	Manu. certificate	Manu. certificate
22	C.C. cube M-150	2335	Cum	Comp. strength	4 test / 20 to 50 cum + 1 test/50cum	50
23	C.C. cube M-250	231	Cum	Comp. strength	4 test / 20 to 50 cum + 1 test/50cum	8
24	CC Cube M-200	2004	Cum	Comp. strength	4 test / 20 to 50 cum + 1 test/50cum	44
25	CC Cube M-100	516	Cum	Comp. strength	4 test / 20 to 50 cum + 1 test/50cum	14
26	TMT Bar reinforcement	50.75	MT	Tensile strength Yield stress Elongation	1 test / for Each dia.	5
27	Water	-	-	Chemical Test	1 test / source	1

The Number of tests will be as per Manual of quality control or latest Govt. G.R./Circular and it will be considered final

The contractor shall have to pay 1% of the estimated cost put to tender towards all testing of materials and the same shall be deducted from their bills for the works.

Testing charges of GERI shall be borne by Govt. No refund be made nor extra charges over 1% shall be recoverable from the contractor.

If directed by the Engineer in charge, the materials intended to be used for the work but not included in the above schedule shall also be got tested at Government recognized Laboratory or field Laboratory.

**The Numbers of tests will be as per manual of quality control or latest Govt. G.R./Circular will be final.**

Signature of Contractor

Executive Engineer  
Panchayat (R&B) Division  
Rajkot

Deputy Executive Engineer  
Panchayat R&B Sub Dn  
Jetpur