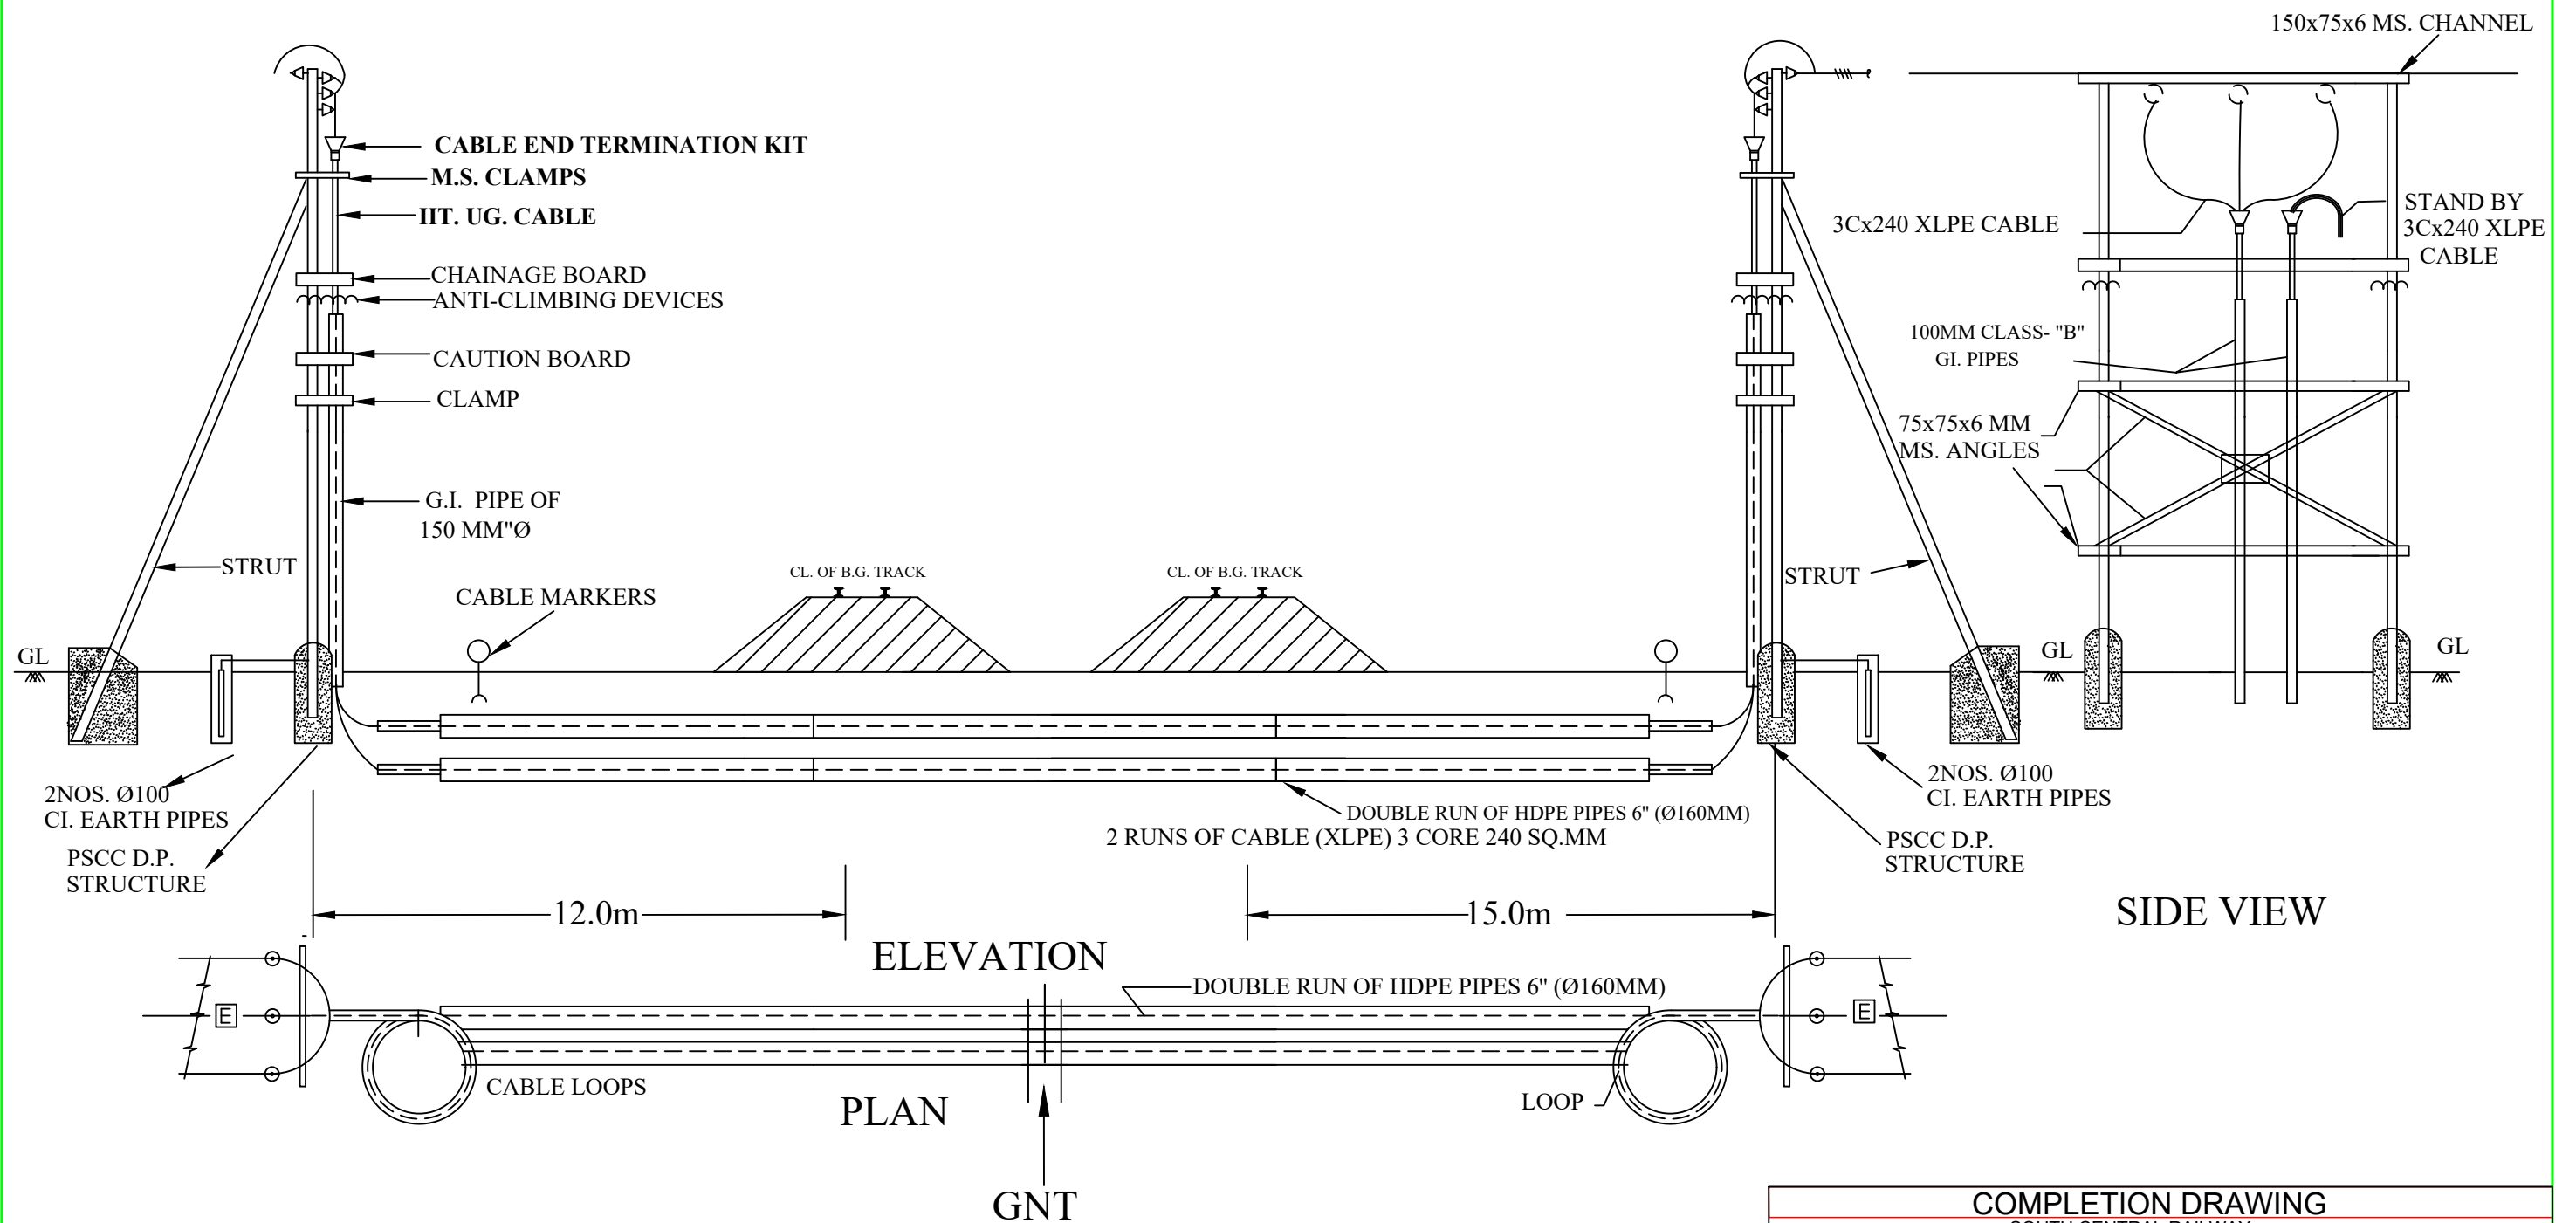


1

DONAKONDA to TARLUPADU SECTION - MODIFICATION OF HT. 11 KV POWER LINE CROSSING AT LC gate, Loc No.158/14

GUTHIMARI
VENKATA RAJA

Digitally signed
by GUTHIMARI
VENKATA RAJA


Signature of the Contrtactor.

MURALI
MOHAN
GANTA

Digitally signed
by MURALI
MOHAN GANTA

SSE/E/C/GTL

Not to scale Drawing.

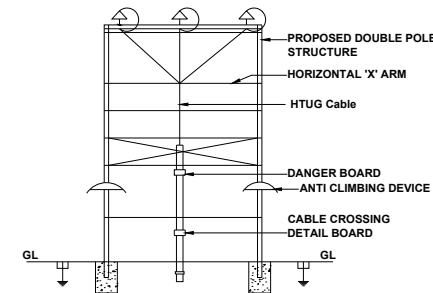

1.	IS : 3043 :	EARTHING ARRANGEMENT
2.	IS : 4091 :	FOUNDATION FOR TRANSMISSION LINE TOWERS & POLES
3.	IS : 398 : (PART -II) 1990	ALUMINUM CONDUCTOR GALVANIZED STEEL REINFORCED
4.	IS : 398 : (PART -V) 1992	ALUMINUM CONDUCTOR FOR EXTRA HIGH VOLTAGE 400KV & ABOVE
5.	IS : 1678 :	PCC POLES
6.	IS : 1255 :	INSTALLATION OF CABLES
7.	IS : 694 :	INSTALLATION OF CABLES UPTO 1.1 KV GRADE
8.	IS : 7098 : (PART -III) 1985	HTUG CABLES
9.	IS : 13573:	CABLE ACCESSORIES FOR TERMINATION
10.	IS : 458 :	REINFORCED CONCRETE PIPES
11.	BS: 105 :	RDSO GUIDELINES ON PIPELINE CROSSING UNDER RAILWAY TRACK

1. The structure on either side of the crossing would be effectively earthed.
2. The crossing arrangement will comply with recruitment of electricity Rules and Regulations off 1987.
3. Danger Board and Anti Climbing device will be provided.
4. The structure, foundations & other materials utilised for the crossing are designed to give factor of safety not less than 2.
5. The cable will run a depth of 3.0m below the ground level in 160 mm internal dia HDPE pipe.
6. The name plate will be fixed on the structure on either end of UG crossing at a height of 3.0 m from the ground level and painted in RED and the following information will be given Electrical Cable (Danger).
7. The laying of the cable shall be carried out in accordance with latest edition IS: 1225-1967, code of practice for installation & Maintenance of power cable.
8. The detail of equipment provided are designed with the object minimizing danger in the event of occurrence of fault & in accordance with recognized modern Electrical Engineering Practice.
9. The crossing will be shifted or modified by the owner of the crossing at the cost of owner as per the agreement whenever Railway authorities sought, the work will be done under the supervision of Railway representative in accordance with the track crossing regulation of the latest edition : 1987.

1. New 33 kv Under Ground cable crossing the track to suit of 25 KV AC Traction and as per Regulation - 1987.
2. All dimension are in meters (Unless otherwise specified).
3. As per the site condition on either side of the track proposed for erection of Double Pole structure with structure with RCC Poles with all accessories as advised by the engineer at site.

G
MURALI
MOHAN

Digitally signed
by G MURALI
MOHAN
Date:
2024.10.27
11:10:22 +05'30'

SSE/E/CN/GTL

NAVEENB Digitally signed
ABU by NAVEENBABU
BONDADA BONDADA
Date: 2024.10.26
19:47:34 +05'30'

SSE/TRD/CN/GTL

Dr. Anand S. Rao
 12N, Gita, Co-SOUTH CENTRAL,
 RAILWAY, Co- Electrical department,
 Postal Code=515801, A N-Ananthapur,
 S-Andhra Pradesh, STREET=SR DEE M,
 Q GUNTAKAL,
 Phone=533989367337,4652615475174,
 705675553601393624297c51eact133
 SERIALNUMBER=51c5058655625019H
 9a5b9d7117a72311b947260653e4dfe1e
 780e4e26, ES=sirivaram.hanu@gmail.com,
 CN=S ANANATHA THE RAO
 Location: I am the author of this document
 Location: your signature location here
 Date: 2024-11-05 12:26:56
 Version: 2.9.6.0

**TADI
SUDHEER
KUMAR
REDDY**

BADUG Digitally signed
U ANIL by BADUGU
KUMAR ANIL KUMAR
Date: 2024.10.30
10:44:48 +05'30'

SSE/Tele/DHNE

Digitally signed
by B V V
HARNADH
Date: 2024.10.28
16:27:54 +05'30'

K LAKSHMI
KANTHA
REDDY

Digitally signed
by K LAKSHMI
KANTHA REDDY
Date: 2024.10.28
12:54:16 +05'30'

SSE/P.Way/P/NDL

KAMBATALA
SRINIBASH
DEE/CN/GTL

SRINIVASU
LU VALLAPI
ADEE/M/GTL

Digitally signed by
SRINIVASULU
VALLAPI
Date: 2024.11.07
13:43:50 +05'30'

ADEE/TRD/HX

M SAI VIJAY
KUMAR
DSTE/M/GTL

by PAPARAO
CHERUKUPALLI
Date: 2024.11.09
13:22:08 +05'30'
ADEN/DHNE

BODD
YE LAH
YE LAH
Sr.DEE/M/GTL

DN. CBN, Q-SOUTH CENTRAL RAILWAY,
 OU-GOVERNMENT,
 Phone: (+) 8360222210733ad08b3d407327f6db8a8b
 b59d9e7f0949802d2afaa3fd1, Postal Code: 515801,
 SrAndhra Pradesh,
 SERIAL NUMBER: 800071136857f7e95adab6c68905f5
 13998ad178ca7a5e2cd9c22f8a0, CN=BOODU
 YELAH
 Reason: I am the author of this document
 Location: your signing location here
 Date: 2004-10-11 13:55:27
 Foxit Reader Version: 9.0.0

K
SUDARSAN
REDDY

Digitally signed by K
SUDARSAN REDDY
Date: 2024.11.13
15:50:02 +05'30'

Sr.DEE/Tr./GTL

**BOMMA CHANDRA
SHEKHAR**

Digitally signed by BOMMA
CHANDRA SHEKHAR
Date: 2024.11.14 17:33:38
+05'30'

Sr.DSTE/M/GTL

**Srinivas
Kantamane
ni**

Digitally signed by
Srinivas Kantamane
Date: 2024.11.15
12:13:37 +05'30'

Sr.DEN/Central/GTL







GADDAM
NARASIMHA RAO


Title of Way Leave proposal: Proposed Laying of 33 KV Electrical (UG) power line crossing at KM No. 267/23-25 & 267/22-26 between Panyam (PNM) & Nandyal (NDL) Railway stations.

Sr.DEE/M/GTL's Reference No.: G/E.31/I/918/2024

Checklist for Joint Proceedings for Way leave proposals (Power line crossings):




S.N.	Description	Proposed Power line crossing location and measurements	
		UP line	DN line (Under
1	Owner of the crossing/Applicant	EE/operation/APSPDCL/Nandyal	
2	Between stations	Panyam - Nandyal	
3	Location and Kms	267/23-25	267/22-26
	a) Existing Crossing Location	267/11-12 (single line)	
	b) Proposed Crossing Location	--	--
	c) Proposed shifting	267/23-25	267/22-26
4	Voltage of the crossing	33 KV	
5	Distance of the Tower/DP structure from nearest Track centre	19 m	19 m
6	Height of the Tower /DP structure	11 m	11 m
7	Distance between both side structures	44 m	
8	Distance between nearest track centre to Railway boundary	14 m	13 m
9	Distance between track centre of UP line to DN line	6 m	
10	Distance between Railway boundary to boundary	36 m	
11	Distance between nearest T.M. to proposed HDD for commissioning of UG cable (North-side)	10 m	10 m
12	Distance between nearest T.M. to proposed HDD for commissioning of UG cable (South-side)	44 m	48.5 m
13	Height of the Track banks	4 m	5 m
14	Height/depth of the footage of Tower/DP structure with respective to Track	4 m	5 m
15	Km Chainage of proposed Horizontal drilling	Km 267.6236	
16	Distance from nearest power line crossing with details viz., voltage, type of crossing, owner of crossing (if any within 100m)	NA	
17	Distance from nearest bridge (with details) to proposed Horizontal drilling, if any within 100m	NA	
18	Distance from nearest LC gate (with details) to proposed Horizontal drilling, if any within 100m	NA	
19	Distance from nearest Signal (with details) to proposed Horizontal drilling, if any within 100m	NA	
	For UG crossings only		
20	Dia of the HDD	160 mm dia	
21	No. of HDD	2	
22	Type of casing pipe inserting in HDD	HDPE pipe	
23	Dia of the casing pipe	160 mm, thickness: 8.6 mm	
24	Size of the cable	3 core 400 sqmm, 33 KV, Dia: 68 mm	
25	No. of cables	1	
26	Depth of existing Telecom/signal cables from surface level	1.5 m	
27	Depth of proposed Horizontal drilling from the lowest ground level (Sectional diagram must be mentioned)	3 m	
	For OH crossings only		
28	Power and traffic block demanded for both UP & DN lines by the applicant	NA	
29	Vertical clearance from Rail level to lower most conductor		
30	Vertical clearance from top of OHE to lower most conductor		
31	Angle of the crossing with respect to Track		
32	Width of the crossing		
33	Power cum traffic integrated block required	NA	

	 S HANUMANTHA RAO	 K LAKSHMI KANTHA REDDY	 BADUGU ANIL KUMAR	 B V V HARNADH	 TADI SUDHEER KUMAR REDDY	 G MURALI MOHAN
Owner of crossing	SSE/E/M/DHNE	SSE/P.way/NDL(P)	SSE/Tele/DHNE	SSE/Sig/DHNE_	SSE/Tr.D/DHNE	SSE/E/Con/GTL



Operation Panyam


Deputy Executive Engineer
OCC Sub-Division:APSPDCL
NANDYAL

Proposed Laying of 11KV underground Power Line Crossing (Double Run) at Km T.P. No.: 266/04-05 Between Panyam [PNM] and Nandyal [NDL] Railway Stations Near Kowluru Vilage.

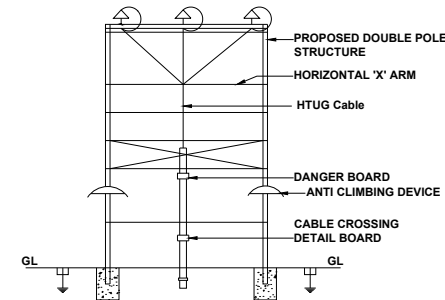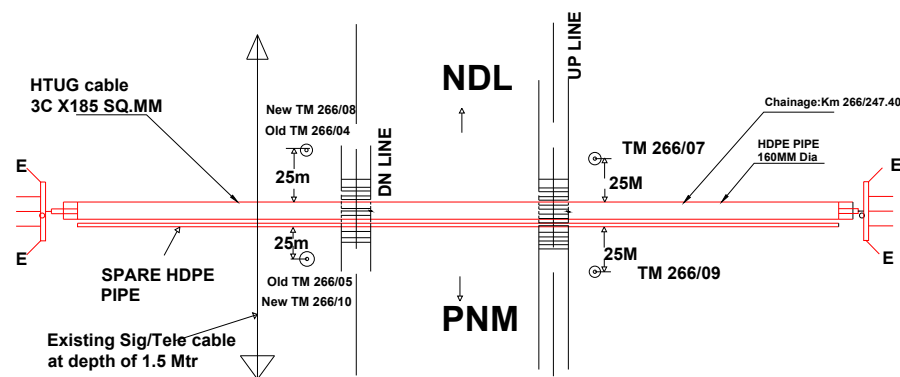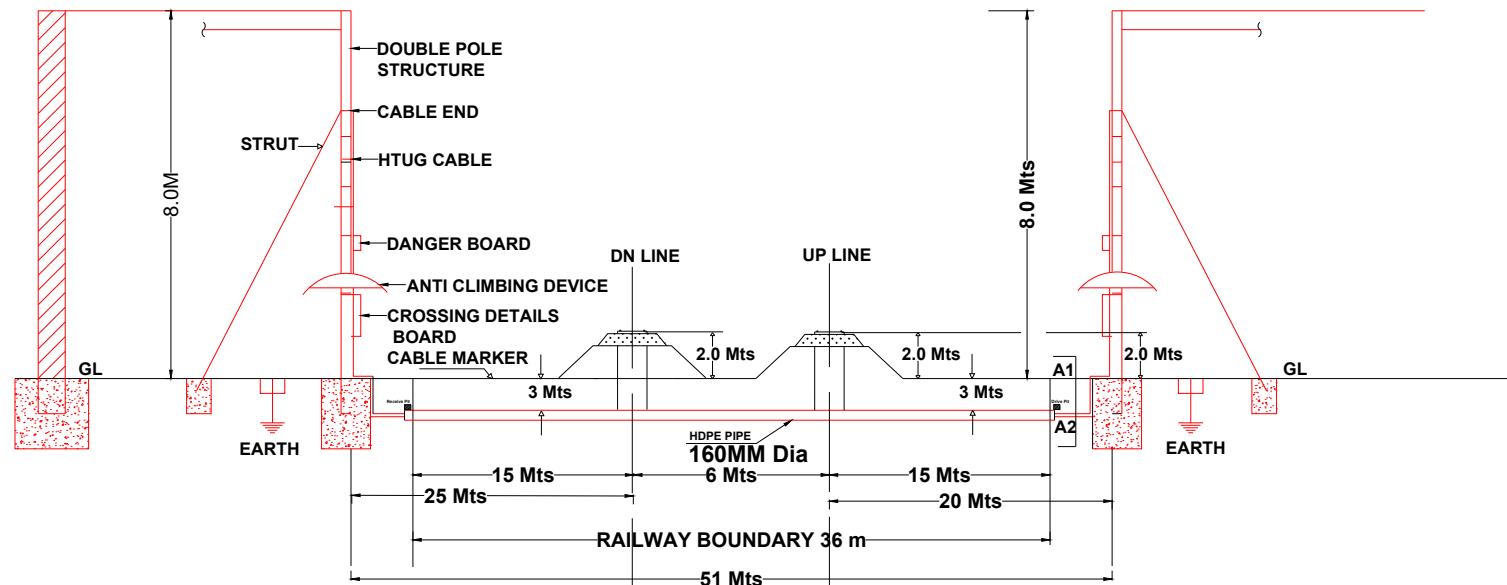

SECTIONAL VIEW A1-A2

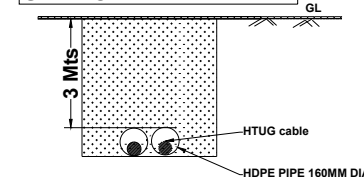

STANDARD SPECIFICATIONS TO BE FOLLOWED FOR RAILWAY POWER LINE CROSSING

- | | |
|---------------------------------------|--|
| 1. IS : 3043 : | EARTHING ARRANGEMENT |
| 2. IS : 4091 : | FOUNDATION FOR
TRANSMISSION LINE
TOWERS & POLES |
| 3. IS : 398 :
(PART -III)
1990 | ALUMINUM CONDUCTOR
GALVANIZED STEEL
REINFORCED |
| 4. IS : 398 :
(PART -V)
1992 | ALUMINUM CONDUCTOR
FOR EXTRA HIGH VOLTAGE
400KV & ABOVE |
| 5. IS : 1678 : | PCC POLES |
| 6. IS : 1255 : | INSTALLATION OF CABLES |
| 7. IS : 694 : | INSTALLATION OF CABLES
UPTO 1.1 KV GRADE |
| 8. IS : 7098 :
(PART -III)
1985 | HTUG CABLES |
| 9. IS : 13573: | CABLE ACCESSORIES FOR
TERMINATION |
| 10. IS : 458 : | REINFORCED CONCRETE PIPES |
| 11. BS: 105 : | RDSO GUIDELINES ON
PIPELINE CROSSING UNDER
RAILWAY TRACK |

CERTIFICATE :

1. The structure on either side of the crossing would be effectively earthed.
2. The crossing arrangement will comply with recruitment of electricity Rules and Regulations of 1987.
3. Danger Board and Anti Climbing device will be provided.
4. The structure, foundations & other materials utilised for the crossing are designed to give factor of safety not less than 2.
5. The cable will run a depth of 3.0m below the ground level in 160 mm internal dia HDPE pipe.
6. The name plate will be fixed on the structure on either end of UG crossing at a height of 3.0 m from the ground level and painted in RED and the following information will be given Electrical Cable (Danger).
7. The laying of the cable shall be carried out in accordance with latest edition IS: 1225-1967, code of practice for installation & Maintenance of power cable.
8. The detail of equipment provided are designed with the object minimizing danger in the event of occurrence of fault & in accordance with recognized modern Electrical Engineering Practice.
9. The crossing will be shifted or modified by the owner of the crossing at the cost of owner as per the agreement whenever Railway authorities sought, the work will be done under the supervision of Railway representative in accordance with the track crossing regulation of the latest edition : 1987.

NOTE:

1. New 11 kv Under Ground cable crossing the track to suit of 25 KV AC Traction and as per Regulation - 1987.
2. All dimension are in meters (Unless otherwise specified).
3. As per the site condition on either side of the track proposed for erection of Double Pole structure with structure with RCC Poles with all accessories as advised by the engineer at site.

AEE/APSPDCL/PNM	<div><div>G MURALI MOHAN</div><div>Digitally signed by G MURALI MOHAN Date: 2024.10.24 17:07:18 +05'30'</div></div> <div><div>NAVEENB ABU BONDADA</div><div>Digitally signed by NAVEENBABU BONDADA Date: 2024.10.24 17:20:30 +05'30'</div></div>	SSE/E/CN/GTL	SSE/TRD/CN/GTL	SSE/M/DHNE	SSE/TRD/DHNE	SSE/Tele/DHNE	SSE/Sig./DHNE	SSE/P.Way/P/NDL	
Dy.EE/APSPDCL/NDL	<div><div>KAMBATALA SRINIBASH</div><div>Digitally signed by KAMBATALA SRINIBASH Date: 2024.10.24 17:28:05 +05'30'</div></div>	DEE/CN/GTL	ADEE/M/GTL	ADEE/TRD/HX	DSTE/M/GTL	ADEN/DHNE			
Sr.DEE/M/GTL					Sr.DEE/Tr./GTL		Sr.DSTE/M/GTL		Sr.DEN/Central/GTL