



दक्षिणमध्यरेलवे  
**SOUTH CENTRAL RAILWAY**  
मुख्यालयकार्यालय, विद्युतशाखा,  
**Headquarters Office, Electrical Branch,**  
सिकंदराबाद, Secunderabad

No.77/2/P/GE/Works(T)

दिनांक/Date: 07/04/2022

**CEE/Con/SC**

**CPD/RE/SC**

**GM/E/RVNL/SC, GGM/E/RITES/New Delhi, GM/Rites/SC.**

**Sr.DEE/M/SC, HYB, BZA, GTL, GNT & NED**

Technical circular No.04/2022

**Sub:** Monitoring of GE works executed by Con/SCR, RITES, CORE, RVNL, Open line and other agencies- Need for stage inspection to ensure qualify-guidelines for taking over of assets-reg.

\*\*\*

General electrical branch (power Maintenance) plays an important role in loading, train operations, passenger satisfaction and internal customer satisfaction.

As you are aware, yardstick for power maintenance is based on energy consumption with use of efficient fittings & other measures, energy consumption is coming down while connected load is increasing. It is necessary that quality of materials and workmanship in new works is as per standards laid down.

During inspections, it is noticed that senior supervisors, ADEE's/DEE /Sr.DEE's are not inspecting works during execution or at the time of taking over for proper quality of materials and workmanship.

In one of the inspections, it is noticed that basic colour coding of wires for phase, neutral & earth wire are not followed. The deviation has major safety consequences to staff.

While taking over of GE assets, proof of purchase from OEM or authorized dealers is not insisted. As a result, the chance of duplicate/low quality materials is high. All Sr.DEE's should realize that duplicate materials are rampant in 'GE' items i.e., Wires, switches, LED tubes/fittings, MCB/MCCB etc.

Similarly, warranty certificate is not ensured while taking over of assets.

Maintenance of GE assets shall be responsibility of executing agencies until they are handed over to divisions as per laid down standards.

To ensure quality in workmanship & materials the following instructions shall be followed without fail.

- (i) Stage inspection of 'GE' works executed by division, construction, RVNL, RITES etc shall be carried out at different levels.
- (ii) Wiring /cabling drawings shall be made available by executing agencies.

- (iii) All cables drawings for CLS panels, PF poles, and incoming cable from DISCOM meter to MDB shall be approved by divisional Engineering, Electrical and S&T branch officers. The drawing should show X, Y dimensions of route of cable for easy identification later. Issue letter to executing agencies that without approved drawings, trench work will not be permitted as safety and reliability is involved.
- (iv) Warranty certificate for all items (Annexure 'A') shall be submitted duly mentioning LOA no & name of executing agency, P.O. No. & contractor/subcontractor who placed order on supplier, period of warranty etc. All equipment supplied on PO or works contract should have Sl.No, and Manufacturer's make in Delivery challan to enforce warranty replacements by divisions in time. In case of PO items, serial number and make and PO details shall be mentioned in Ledger as well as written on item with permanent marker. Without Serial number, ADEE shall not sign M-Book for such works or sign store bill. All executing agencies shall advise their contractors to ensure Sl. No. of items on Delivery challan /inspection certificate of RITES without fail. For items already supplied, sl. no. of item shall be mentioned in DPR or joint measurement sheet. The officer doing test check shall ensure list of items with sl. no. is given by SSE in DPR etc.
- (v) Warranty certificate shall mention that warranty is given for design, materials and workmanship defects for 24 months or 60 months as the case may be from the date of commissioning.

The following warranty clause to be incorporated by all divisions in all future tenders (works/stores). "The item is given warranty for 24 months (IRS condition) or as given in specification whichever is higher from the date of commissioning."

- (vi) Delivery challans from OEM or D.C & authorized dealership certificates from other than OEM shall be submitted for items given in **Annexure 'A'**.
- (vii) Third party inspection at manufacturer place like RITES inspection is must for all major items like Transformers, RMG DG sets, High masts, Control panels, XLPE cables, Lifts , Escalators, light poles, packaged/Centralized A.C. system, Solar power plants, LED tube/flood /Street lights water coolers, BLDC fans. Consignee inspection at manufacturer's place only for above items shall be approved in urgent cases only where work is targeted and with the approval of SAG officer of the executing agency. RITES Inspection is must for store/Contract items for the above items whose value exceeds 5Lakhs. For above items manufacturer test report also to be submitted.  
Consignee inspection at site for above items requires approval of PCEE/SCR.
- (viii) All instruction to executing agencies shall be given by Sr.DEE only to avoid wrong instructions by SSE/ADEE inviting embarrassment later.
- (ix) In case of new station building & PF, latest minimum essential amenities shall be ensured. Towards this, list of amenities shall be advised to executing agency every 6 months with a copy to HQ. PTA/HQ shall compile all divisions and advise concerned executing agency for early provision of minimum amenities at stations. Latest MEA are enclosed as **Annexure 'B'**
- (x) All defects noticed during inspection by SSE/ADEE/Sr.DEE, only Sr.DEE shall issue letter to concerned SAG/JAG officer of executing agency after editing the defects list. A copy to be marked to HQ. Compliance to defects shall be item

wise and jointly signed by open line SSE/ JE and executing agency representative and contractor of works.

- (xi) Works which are not taken up shall be advised to executing agency every 3-6 months before commissioning of the asset/station/section etc. duly marking a copy to HQ to take up with executing agency.

Ex:

- Non provision of water coolers, approach road lighting, solar plant, glow sign boards, substation, DG sets, AC's in relay room etc.,
- Non provision of dedicated 3 phase 11KV/440V power supply at block stations
- Duplicate earth not provided for items as per IE rules
- Separate SDB for AT supply not provided in ASM room as per Railway Board guidelines.
- 30% and 70% segregation cables for PF/COP/FOB lights not provided
- Adequate No. of sockets not given for UTS/TMS system
- Power supply to quarters and street lights not given.

Co- ordination meeting with executing agency at JAG/SAG officer level shall be conducted at least every 3 months and minutes drawn without fail.

- (xii) Pole lighting

- Height of pole = width of road or width of platform from pole to PF edge
- Span between poles =  $4 \times \text{Height of pole}$   
(As per CPWD specification)

On platforms, maximum height of pole to be 6M for ease of maintenance. For platform bracket length to be taken into account while locating pole on platform.

Location of the pole to be in the same line to have good aesthetic look.

Further, Pole implantation = Height of pole + Bracket length.

For PF width upto 7M – Bracket length can vary from 30 cm to 1M depending upon gardenwidth from compound wall. Ex 1M width garden use 1 M bracket, 2M width garden use 30cms bracket.

For platform width above 7M –

7M – 8M – 6M pole with 30cm bracket

8M – 10M – 6M pole with 1M bracket


10M – 12M – use double bracket on 5M poles with lights parallel to track & at 6m from the edge of track.

Angle of Bracket – max  $15^\circ$

For LC gates, Height of pole = width of road.

Where width of road is more than 7M use poles on either side of road. In such cases height of pole = Width of road / 2 = W/2.

At LC gate, poles to be erected diagonally on either side of gate.

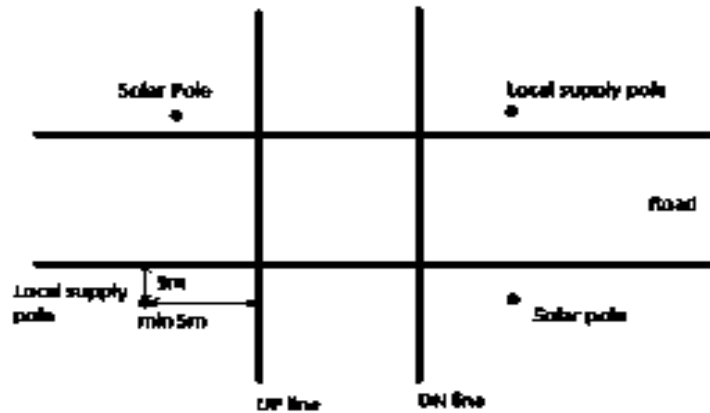

Solar standalone poles with battery are to be provided at all LC gates to improve lighting as safety is involved. The solar pole to be of hybrid type i.e. lights shall work on local A.C. supply as well as solar panels. Poles to be located at minimum of 5M from center of track and about 1M from edge of road.

(xiii) Circulating Area Lighting

In circulating area, pole lighting to be used as far as possible.

Where width of circulating area is more say more than 15M, High mast lighting to be studied. Divisions shall be involved while locating high masts. Engineering officials to be involved to construct garden around High Mast location.

(xiv) All poles at stations and LC gates to be of octagonal type from rugged point of view.

For quarters road lighting where heavy trucks are not expected, tubular poles (G.I) can be used to save cost.

LED street lights shall be purchased preferably from reputed makers like Phillips, Havels, Bajaj, Greaves, Wipro etc. Warranty of 5 years and LM 79/80 reports, purchase from OEM or authorized dealer shall be ensured. Warranty of 5 years for entire luminaries including drivers & not LED alone. Sl.No. of fitting shall be mentioned in delivery challan.

In case of local make of LED fittings, extra care to be taken to ensure quality of LED's and LED drivers used. Executing agencies to be advised to be extra careful to ensure quality as warranty failures are more and response of firms is slow/not satisfactory.

(xv) Power supply to stations

All block stations shall have dedicated 3 phase 11KV/415V supply from DISCOM with a dedicated distribution transformer.

Minimum capacity of Distribution Transformer is 63KVA for all 3/4 line block stations. This will take care of pre cooling needs in case of detention to trains due to strike/flood/accidents etc.

Where stations have Lift/Escalator and high mast for loading platforms, minimum capacity of distribution transformer should be 100KVA or as per connected load with applicable diversity factor.

CMD of station shall be arrived at based on current connected load, Diversity factor and solar plants if any at the station.

At all NSG1, NSG2, NSG3, NSG4 (A1, A, B) stations 4 Nos. of pre cooling points on each platform (2 on either end of PF) to be ensured by all divisions in a phased manner in 2022-23. In case of doubling/tripling works executing agencies to be advised and followed up to provide precooling points.

(xvi) Incoming Cable to MDB from Distribution Transformer

All incoming cables from DISCOM meter to MDB shall be laid in HDPE pipe of 110mm/160mm as per size of cable. The grade of pipe shall be PN4 & PE 80 standby cable.

Cable route drawing to be available. If length of cable is more than 100M, a brick based junction box buried inside ground to be made for every 100M to enable pulling of cable in case of defect for replacement of cable without any need for cable trench which is a tedious work.

(xvii) Junction box near CLS panels


It is noticed that XLPE cable when terminated in CLS panel is found to cause failures due to cable cut or slackness with time. In case of 2×150/185 sq.mm cable all strands cannot be terminated in MCB. From reliability point of view a powder coated MS junction box of 12 terminals with bimetallic bus bar of 150 A to be provided below CLS panel of 10kVA/25kVA as per drawing enclosed.

(xviii) Junction box on AT

All L.T. junction boxes shall have MCB/MCCB and bimetallic bus bar. Incoming copper cable from AT shall be connected to MCB/MCCB. The output of MCB/MCCB to be connected to bus bar by a copper cable of 10 sq.mm/35sq.mm for 10kVA/25kVA A.T. XLPE Aluminum cable to be connected to other side of bus bar.

(xix) Cabling for P.F. Poles

Cable to be laid in the non-concrete area of 1M-2M from wall and to be laid in PN 2.5/PE63 or PE 80 HDPE pipe of 63mm/50mm diameter for easy replacement of defective cables later. At every pole, there shall be brick masonry junction box. Cost of HDPE pipe is nearer to brick and sand. No brick/sand needed as cable is laid in pipe.

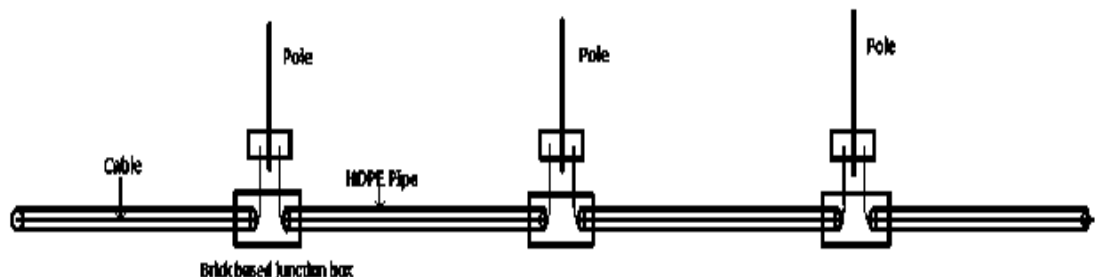

From trench to pole foundation place, HDPE/PVC pipe of 50mm to be laid before PF concrete is laid to avoid chipping at later stage. The pipe can protrude on PF for 30-50 cm.

- (xx) Loop in loop out junction boxes near FOB/MDB/ASM room for termination of XLPE cables

16/32 terminal loop in loop out boxes to be erected at FOB on each platform, inside ASM room (or backside of ASM room etc.). On COP's SDB can be erected so that 30% & 70% circuit cables can be terminated.

Each COP shall have 30% & 70% wiring for lights, 24 hours fan circuit, 24 hours cell phone charging socket circuit, 24 hours commercial loads circuit for stalls/water coolers, 24 hours coach indication boards circuit wherever applicable.

Each column in COP shall have one plug point with a switch for cell phone charging. The socket shall be tamper resistant type so that children cannot insert their fingers and get shock.

- (xxi) Location of fans under COP/rooms etc.

As per IS fan height shall be 2.4M from floor. In COP fans to be located on a truss adjacent to central one below drainage gutter so as to avoid falling of water on fan and damage to BLDC fan circuit. For this longer down rod to be erected whenever needed.

- (xxii) Earth electrode

**B class GI pipe to be used for earth electrode with minimum length of 3M and shall be adopted for locations other than substations as per RDSO drawing no. ETI/OHE/P/7021 & RDSO Spec No. RDSO-TI0LKO(PSI)/38/2020 dated 25.8.21. For substations earth electrode of 4M length confirming to RDSO drawing ETI/PSI/222-1 & RDSO Spec No. RDSO-TI0LKO(PSI)/38/2020 dated 25.8.21 to be adopted. Earth electrodes are to be procured only from CORE approved sources taking into account long term reliability point of view. Executing agencies are advised to include in tender document itself CORE approved drawings and approved sources for earth electrodes. A soft copy of the above is enclosed for reference.**

Earth box stenciling shall be as follows.

GE or EGS	
E.P NO.	:
E.P FOR	:
E.P LOC	:
IER	:
CER	:
DATE	:

Background in black and letters in yellow. Stenciling to be on side wall. However, wherever boxes are concealed at PF /ground levels, stenciling to be on cover.

Earth pit to be executed shall be of 30cm dia and charcoal, [salt + sand] mixture shall be added as alternate layers. Salt to be mixed with river sand on the ground itself. First layer will be charcoal of 30 cm depth followed by [salt + sand] mixture of 30 cm depth and same will be repeated till top of earth. Earth

pipe shall be embedded inside the ground at bottom of pit by 30 cm. As safety is involved earth electrodes shall be erected in the presence of Railway representative only. In case of CN/RVNL/RITES/CORE works supervisor of the executing agency shall be present at the time of earth electrode erection. Open line supervisors/staff can be invited to witness the erection.

In case of open line works, railway staff shall invariably be present at the time of earth electrode erection. Site order shall be issued to contractor at the beginning of work itself to avoid ignorance to contractor.

(xxiii) Solar Roof top power plants

All new station buildings shall be provided with 15 to 25kWp plants at all block stations with Net-metering.

(xxiv) A.T. Supply from CLS panels output (6A/16A MCB) Shall be connected to a separate SDB. Lights & Fan in ASM room to be connected to a separate switch board which is connected to AT/SDB. P.F. COP & poles & FOB 30% light circuit to be taken from AT/SDB to ensure lighting during heavy rain/wind when local supply trips most of the time. No other load shall be connected in 30% light circuit.

(xxv) Taking over& Handing over guidelines

1. Statement of assets with location, make & quantity & Sl.no.
2. Warranty certificates.
3. Manufacturers test certificates in case of major items like cables, Transformers, DG sets, Control panels, Poles, LED items, High masts water coolers, RMU etc.
4. For item/items Value > 5L, RITES inspection certificates/consignee at factory (Consignee at site – approval of PCEE/SCR is must)
5. Completion certificate test format like I.R. value, dimensions etc.


(Ch.S.Reddy)  
CEGE  
for PCEE/SCR

C/- CEDE, CELE, CESE, CEE/OP for information Please.

Items for which warranty certificate to be given

1. All sizes of copper wiring (FRLS insulation, etc).
2. All switches, sockets & switch boards.
3. All sizes of XLPE cables.
4. All types & capacities of pumps.
5. All types of light poles.
6. High mast.
7. All types & capacities of LED lights, street lights, flood lights, waist level lights, pit lights etc.
8. All types & capacities of fans.
9. All types & capacities of Air conditioners.
10. All types & capacities of geysers.
11. All types & capacities of solar power plants, solar geysers etc.
12. Battery chargers, pre cooling sockets, Inverters, UPS etc.
13. All types of switch gear & control panels.
14. Wind power plants.
15. CLS panels.
16. Refrigerators, Deep freezers, water coolers.
17. Earth electrode.
18. Transformers of all capacities & types.
19. All types & capacities of DG sets.
20. All types & capacities of Drives.
21. All types & capacities of RMU.
22. All types & capacities of insulators.
23. All types & capacities of LAs, CTs, PTs.
24. All measuring instruments including panel meters.



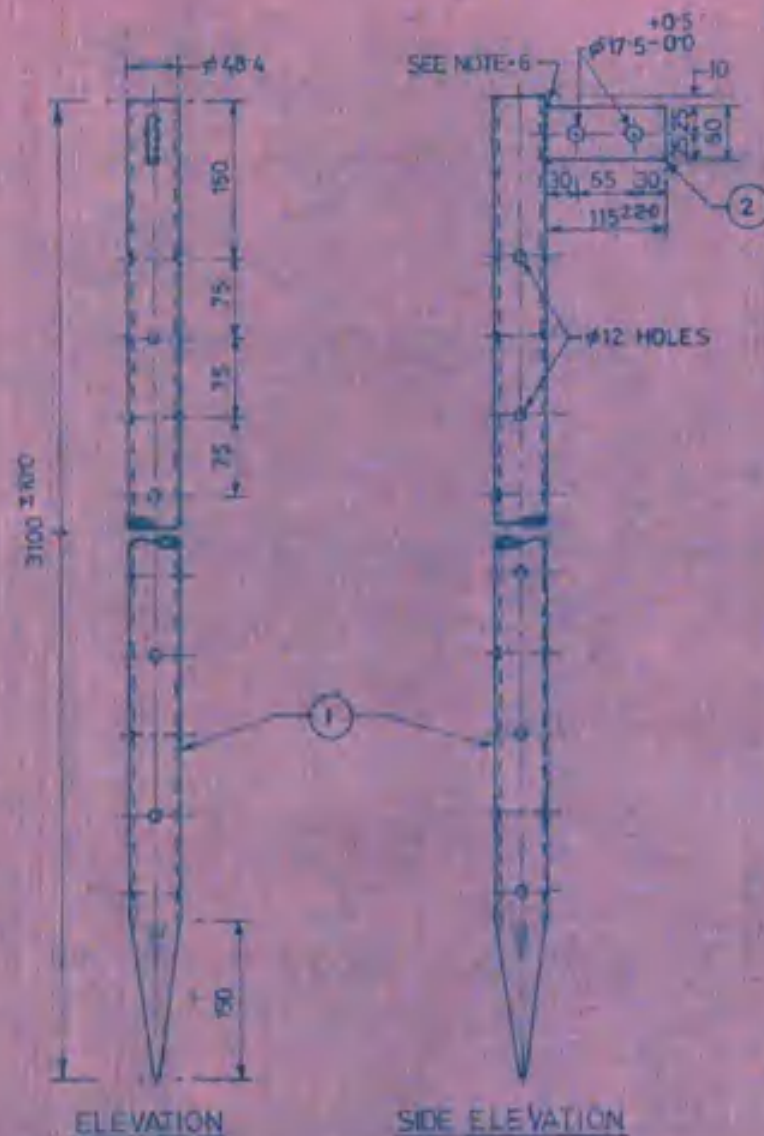

REF. NR	DESCRIPTION	PART NR	MATERIAL	SPECIFICATION	APPROX. WEIGHT (kg)	NUMBER OFF
1	EARTH ELECTRODE	7021	STEEL TUBE GALVANIZED	IS 12002 (GALV) ETI/OHE/13	-	1
2	M.S. FLAT PIECE 50x10 THICK, 115 LONG		MILD STEEL GALVANIZED	IS 12002 (GALV) ETI/OHE/13	-	1

NOTES:-

1. ALL DIMENSIONS ARE IN MILLIMETRES.
2. TUBE DIMENSIONS-40mm NOMINAL BORE, CLASS LIGHT AS PER IS:1239.
3. EARTH ELECTRODE CONFORM TO IS 3043.
4. TO BE GALVANISED AFTER DRILLING AND FABRICATION.
5. LOWER END OF PIPE SHAPED AS SHOWN BY SQUEEZING AND IF NECESSARY BY CUTTING OF DEFORMED MATERIAL.
6. ALL WELDS ARE 6mm FILLET WELDING AND SHOULD BE UNIFORM, CONTINUOUS AND NONPOROUS CONFORM TO IS-816.
7. USAGE:- TO BE USED IN EARTHING STATION.

REFERENCE COPY

THIS DRAWING IS THE PROPERTY OF RESEARCH DESIGNS AND STANDARDS ORGANISATION (MINISTRY OF RAILWAYS), LUCKNOW-226 011, INDIA AND SHALL NOT BE USED, COPIED OR REPRODUCED IN PART OR WHOLE, WITHOUT PRIOR CONSENT IN WRITING.

EARTH ELECTRODE				JD/OHE			
				ADE/OHE		J.C. Brown 10.8.86	
REF: RE/33/P/7021 (MOD 'F)				CROSS REF: ETI/OHE/P/7020			
DATE		MOD.		NATURE OF MOD.		INITIAL	
						R. D. S. O.	
						ETI/OHE/P/7021	
						REV. A	
						SCALE: 1:5	
						SUB-SCALE:	
SPEC. OF SPARE AT REF. 2 CORRECTED		CK		17.8.86			

File No.RDSO-TI0LKO(PSI)/38/2020-O/o PED/TI/RDSO



Government of India,  
Ministry of Railways  
Research Designs & Standards Organisation,  
Manak Nagar, Lucknow- 226 011

Telephone: 2465763 (O).  
42805(OFF.)  
Fax : 91-0522-2465763  
E-mail: dti.psi.rds@gmail.com



File No. RDSO-TI0LKO(PSI)/38/2020

Date: 25.08.2021

To,

1. The Principal Chief Electrical Engineer,

- (i) Central Railway, Station Building, Mumbai CST - 400 001.
- (ii) Eastern Railway, Fairlie Place, Kolkata-700 001.
- (iii) East Central Railway, Hajipur-844 101.
- (iv) East Coast Railway, Bhubaneswar-751 023.
- (v) Northern Railway, Baroda House, New Delhi - 110 001.
- (vi) North Central Railway, Allahabad-211 015.
- (vii) North Eastern Railway, Gorakhpur-273 012.
- (viii) North Frontier Railway, Mailgaon - 781 011.
- (ix) North Western Railway, Jaipur - 302 017.
- (x) Southern Railway, Park Town, Chennai- 600 003.
- (xi) South Central Railway, Railnilayam, Secunderabad-500 371.
- (xii) South Eastern Railway, Garden Reach, Kolkata-700 043.
- (xiii) South East Central, Railway, Bilaspur-495 004.
- (xiv) South West Railway, DRM's Office, Hubli-580 028.
- (xv) Western Railway, Churchgate, Mumbai-400 020.
- (xvi) West Central Railway, Jabalpur- 482 001.
- (xvii) Konkan Railway, Belapur Bhavan, Sector-11, CBD Belapur, Navi Mumbai 400614.

2. Chief Administrative Officer, CORE Allahabad-211001


Sub: Revised Technical Specification for Earthing of Power Supply Installations for 25 & 2X25  
Traction System.

Ref: (i) Final draft uploaded on RDSO website on 22.07.2021.

(ii) Draft of the specification uploaded on RDSO website on 01.04.2021.

In continuation of the above references it is communicated that the revised Technical Specification for Earthing of Power Supply Installations for 25 & 2X25 kV Traction System. i.e. specification no. TI/SPC/PSI/ERTHNG/0210 has been issued by this office. Copy of the same has been uploaded on the [www.railserver.gov.in](http://www.railserver.gov.in) and can be downloaded.

2. The said specification shall supersede the specification no. ETI/PSI/120 (02/91) with A&C slip no. 01.
3. This is issued with approval of the competent authority.

  
(Gyan Prakash Katiyar)  
25/08/21  
Director TI-3  
For Director General (TI)

Encl: NIL

675764/2021/O/o PED/TI/RDSO

Specification No. TI/SPC/PSI/ERTHNG/0210

Page 1 of 36

कर्षण संस्थापन निदेशालय  
TRACTION INSTALLATION DIRECTORATE



भारत सरकार, रेल मंत्रालय

GOVERNMENT OF INDIA  
MINISTRY OF RAILWAYS

Specification No. TI/SPC/PSI/ERTHNG/0210

TECHNICAL SPECIFICATION

FOR

EARTHING OF POWER SUPPLY INSTALLATIONS

FOR 25 &amp; 2X25 kV, AC 50 Hz, Traction System.

{ This specification supersedes the specification no.  
ETI/PSI/120(02/91) with A & C slips no. 1(10/93) }

Effective From: 20.08.2021

ISSUED BY  
TRACTION INSTALLATION DIRECTORATE  
RESEARCH DESIGNS AND STANDARDS ORGANISATION  
LUCKNOW - 226011



675764/2021/O/o PED/TI/RDSO

Specification No. TI/SPC/PSI/ERTHNG/0210





Page 2 of 36

## Specification No. TI/SPC/PSI/ERTHNG/0210

Technical Specification for Earthing of Power Supply Installations for 25 & 2X25 kV, AC 50 Hz, Traction System.

## Revision history

Revision	Specification no.	Total pages (including annexure)	Date of issue
First issue	ETI/PSI/120 (02/91)	18	17.03.1992
Revision -01	Issue of A & C slips no. 1	02	20.10.1993
Revision - 02	TI/SPC/PSI/ERTHNG/0210	36	20.08.2021

	Prepared by	Checked by	Reviewed by	Approved by
Signature				
Date	23.08.21	23/08/21		
Designation	SSE/SCADA	DTI/3	ED/TI	PED/TI

## INDEX

Clause No.	Subject	Page No.
-----	Cover Page	01 & 02
-----	Index	03
1.0	Scope	04
2.0	Terminology	04
3.0	Object of earthing	05
4.0	Governing specifications	05
5.0	Typical Value of Earth Resistance	05
6.0	Earth electrode	05
7.0	Earthing arrangement at Traction Sub Station	06
8.0	Earthing arrangement at Switching Post	09
9.0	Earthing of Neutral of Local Power Supply System	10
10.0	Earthing arrangement at Auxiliary Transformer Station	10
11.0	Method of Jointing	11
12.0	Painting of MS flats	11
13.0	Crushed Rock surface layer	11
14.0	Step and Touch Voltages	11
15.0	Reference Drawings	11
Annexure-I	Formulae for Calculation of Earthing	12
Annexure-II	Typical Earthing Grid (MS Rod)	15
Annexure-III	Typical return current connection of buried rail at traction substation	16
Annexure-IV	Typical earthing layout of sub sectioning and paralleling station	18
Annexure-V	Typical earthing layout of sectioning and paralleling station	19
Annexure-VI	Typical arrangement of an earth electrode	20
Annexure-VII	Typical earthing arrangement of an auxiliary Transformer station	21
Annexure-VIII	Connection arrangement to Buried Rail in TSS of V Connected Transformer	22
Annexure-IX	Connection arrangement to Buried Rail of Autotransformer at Scott	23
Annexure-X	TI/SMI/0032 Revision 02	24
Annexure-XI	Sample Calculation for Design of Earthing Mat Traction Sub Station	30
Annexure-XII	Sample Calculation for Design of Earthing Mat for TSS, SP & SSP of 2X25kV System	33

**1.0 SCOPE**

- 1.1 This specification supersedes the specification no. ETI/PSI/120(02/91) with A&C slip no. 01.
- 1.2 This specification caters for general arrangements of earthing system and equipment earthing at Traction Sub-Stations, Switching stations and Auxiliary transformer stations of 25kV as well as 2X25kV system. Low voltage (LT) electrical power distribution system, 25 kV overhead equipment system as well as signal and telecommunication equipment do not come within the purview of this specification.
- 1.3 It is to be noted that "The Make in India Policy of Government of India shall be applicable."

**2.0 TERMINOLOGY**

The following terms wherever occurring in this specification shall, unless excluded or repugnant to the context, have the meaning attributed thereto as follows:-

- 2.1 Combined Earth resistance: The resistance of an earth electrode (s) with respect to earth, with the earth electrode (s) connected in the metal work of electrical equipment other than parts which are normally live or carry current and the masts/ structures but without connection with the traction rail(s).
- 2.2 Earth: The conductive mass of the earth, whose electrical potential at any point is conventionally taken as zero.
- 2.3 Earth Electrode: A conductor (mild steel (MS) pipe) or group of conductors in intimate contact with and providing an electrical connection to earth.
- 2.4 Earthing Grid: A system of a number of interconnected, horizontal bare conductors buried in the earth, providing a common ground for electrical devices and metallic structures, usually in one specific location.
- 2.5 Equipment Earthing: Earthing of all metal work of electrical equipments other than parts which are normally live or current carrying. This is done to ensure effective operation of the protective gear in the event of leakage through such metal work, the potential of which with respect to neighboring objects may attain a value which would cause danger to life or risk of fire.
- 2.6 Mesh Voltage (E mesh): The maximum touch voltage to be found within a mesh of an earthing grid.
- 2.7 System Earthing: Earthing done to limit the potential of live conductors with respect to earth to values which the insulation of the system is designed to withstand and thus to ensure the security of the system.
- 2.8 Step Voltage (E step): The potential difference between two points on the earth's surface separated by distance of one pace that will be assumed to be one metre in the direction of maximum potential gradient.
- 2.9 Power Supply Installation: The electrical equipments and associated structures provided at a Railway Traction Substation or Switching Station or Auxiliary transformer station on the 25 kV & 2X25kV overhead equipment.
- 2.10 Traction Rail – Traction Rail means a non-track circulated rail of a wired track, not required for signaling purposes and which may be earthed. In non-track circulated sections, both the rails of a wired track are traction rails and in single rail track circulated sections, the traction rail is the non-track circulated rail
- 2.11 Touch Voltage (E touch): The potential difference between a grounded metallic structure and a point on the earth's surface separated by a distance equal to the normal maximum horizontal reach of a person, approximately one metre.

### 3.0 OBJECT OF EARTHING

The object of an earthing system is to provide as nearly as possible a surface under and around a station which shall be at a uniform potential and as nearly zero or absolute earth potential as possible. The purpose is to ensure that generally all parts of the equipment other than live parts are at earth potential and that attending personnel are at earth potential at all times. Also by providing such an earth surface of uniform potential under and surrounding the station, there can exist no difference of potential in a short distance big enough to shock or injure an attendant when short circuits or other abnormal occurrences take place. The primary requirements of a good earthing system are:

- i) It should stabilize circuit potentials with respect to ground and limit the overall potential rise.
- ii) It should protect men and materials from injury or damage due to over voltage.
- iii) It should provide low impedance path to fault current to ensure prompt and consistent operation of protective devices during ground faults.
- iv) It should keep the maximum voltage gradient along the surface inside and around the substation within safe limits during earth faults.

### 4.0 GOVERNING SPECIFICATIONS:

Assistance has been taken from the following standards/specifications in the preparation of this code of practice:

- i) IS: 3043- 2018 code of practice for earthing (latest edition).
- ii) IEEE Guide for safety in AC substation grounding, IEEE standard 80- 2013.

### 5.0 TYPICAL VALUE OF EARTH RESISTANCE

At each power supply installation, an earthing system as specified in this specification shall be provided. The combined resistance of the earthing system (with the connection to the running rail(s) disconnected) shall be not more than the following values:-

SN	Name of the Station	The limit of combined earth resistance in ohms
1.	Traction substation	0.5
2.	Switching station	2.0
4.	Auxiliary transformer station	10.0

### 6.0 EARTH ELECTRODES

- 6.1 The earth electrode shall normally be of mild steel galvanized perforated pipe of not less than 40 mm nominal bore, of about 4 m length provided with a spike at one end and welded lug suitable for taking directly MS flat of required size at the other end. The pipe shall be embedded as far as possible vertically into the ground, except when hard rock is encountered, where it may be buried inclined to the vertical, the inclination being limited to 30 degree from the vertical. The connection of MS flat to each electrode shall be made through MS links by bolted joints to enable isolation of the electrode for testing purposes. A typical arrangement of an earth electrode shall be as per Drawing number ETI/PSI/222-1 (Annexure-VI).
- 6.2 Earth electrodes shall be embedded as far apart as possible from each other. Mutual separation between them shall usually be not less than 8.0 m (which is twice the length of the electrode).
- 6.3 If the value of earth resistance specified in clause 5.0 cannot be achieved with a reasonable number of electrodes connected in parallel such as in rocky soil or soil of high resistivity, the earth surrounding the electrodes shall be chemically treated. The earth electrode shall be surrounded in an earth pit by alternate layers of finely divided coke, crushed coal or charcoal and salt at least 150 mm all round. Though substantial reduction in earth resistance can be achieved by coke treated

electrode, yet as this method results in rapid corrosion not only of electrode but also of steel frame work to which it is bonded, coke treatment shall be used only where absolutely necessary and such electrodes shall not be situated within 8.0 m of other metal work.

6.4 In high embankments, it may be difficult to achieve earth resistance specified in clause 5.0 even after chemical treatment of electrodes. In those locations, use of electrodes longer than 4 m so as to reach the parent soil is recommended. Mutual separation between them shall usually be twice the length of the electrode.

6.5 As far as possible, earth electrodes for Traction Sub-Stations/ Switching Stations shall be installed within and adjacent to perimeter fence. At large sites, apart from securing a sufficiently low resistance and adequate current carrying capacity a reasonable distribution of electrodes is also necessary.

## 7.0 EARTHING ARRANGEMENT AT TRACTION SUBSTATION for 25kV & 2X25kV System (160kmph).

### 7.1 Earthing Grid.

7.1.1 An earthing grid is formed by means of bare mild steel rod of appropriate size as indicated in clause 7.1.2 buried at a depth of about 600 mm below the ground level and connected to earth electrodes. The connection between the earth electrode and the grid shall be by means of two separate and distinct connections made with 75 mm x 8 mm MS flat. The connection between the MS flat and the MS rod shall be made by welding, while that between the earth electrode and the MS flats through MS links by bolted joints. The earth electrodes shall be provided at the outer periphery of the grid as shown in Annexure-II. As far as possible the earthing grid conductors shall not pass through the foundation block of the equipments. All crossings between longitudinal conductors and transverse conductors shall be jointed by welding. The transverse and longitudinal conductors of the earthing grid shall be suitably spaced so as to keep the step and touch potentials within acceptable limits; the overall length of the earthing grid conductors shall not be less than the calculated length (refer Annexure- I & XI).

7.1.2 The size of the earthing grid conductor shall be decided based on the incoming system voltage and fault level (refer Annexure I & XI). The fault level considered shall take into account the anticipated increase in fault current during the lifespan of the station. The size shall be as given below.

SN	System voltage ( kV)	Fault level ( MVA)	Diameter of the grid conductor ( MS rod ) in mm (For 25kV and 2X25kV TSS)
1.	66	Upto 4000 above 4000 upto 5000 above 5000 upto 6000	32 36 40
2.	110	Upto 6000 above 6000 upto 8000 Above 8000 upto 10000	32 36 40
3.	132	Upto 7000 Above 7000 upto 10000	32 36
4.	220	Upto 12000 Above 12000 upto 16000 Above 16000 upto 20000	32 36 40
5.	For earthing grid at SP & SSP of 2X25kV System 32 mm Diameter of the grid conductor (MS rod) is to be used.		



## 7.2 Buried rail.

7.2.1 A steel rail of section 52 kg/m (the one used for the railway track) and length about 13m shall be buried near the track at the traction substation at a depth of about one metre to form part of the earthing system. Two separate and distinct connections shall be made by means of 75 mm x 8 mm MS flat between the earthing grid and the buried rail. The buried rail shall also be connected by means of two separate and distinct connections made with 75mm x 8 mm MS flat to the traction rail(s) in a single - rail track circuited section and to the neutral point (s) of the impedance bond(s) in a double - rail track circuited section.

7.2.2 In cases where the feeding post is located separately away from the traction substation, the buried rail shall be provided at feeding post (where one terminal of the secondary winding of the traction power transformer of the substation is grounded).

## 7.3 System earthing.

### 7.3.1 For Traction Power Transformers

#### (a) In case of 25kV Traction System

One terminal of the secondary winding (25 kV winding) of each traction power transformer shall be earthed directly by connecting it to the earthing grid by means of one 75mmX8mm MS flat, and to the buried rail by means of another 75mmX8mm MS flat in case of 21.6/30.24MVA transformer. In case of 30/42MVA Transformer, two numbers 75mmX8mm MS flat to be directly connected to earthing grid, and to the buried rail by means of another two numbers 75mmX8mm MS flat.

#### (b) In case of 2X25kV Traction System with 38/53/63MVA Single Phase Dual LV Winding Traction Power Transformer at TSS:

In these transformers there are two secondary windings. The inner terminals of these two secondary windings are to be solidly connected to each other. This connection is to be connected with two no. 75X8mm MS Flats. One MS flat is to be connected with Buried Rail & another with the Earthing grid (Annexure-VIII).

#### (c) In case of 2X25kV Traction System with 60/84/100MVA Scott Connected Transformer at TSS:

At these TSSs, the autotransformer has been used. The neutral Bushing of this Autotransformer is to be connected with two no. 75X8mm MS Flats. One MS flat is to be connected with Buried Rail & another with the Earthing grid. (Annexure-IX)

7.3.2 One designated terminal of the secondary of each potential, current and auxiliary transformer shall be connected to the earthing grid by means of two separate and distinct earth connections made with 50 mm x 6 mm MS flat in case of 25kV system and with 75mm X 8mm MS Flat in case of 2X25kV system.

## 7.4 Equipment earthing.

The metallic frame work of all outdoor equipments such as transformers, circuit breakers, interrupters and isolators as well as steel structures shall be connected to the earthing grid by means of two separate and distinct connections made with MS flat of size as indicated below; One connection shall be made with the nearest longitudinal conductor, while the other shall be made to the nearest transverse conductor of the grid.

SN	Equipment	System Voltage and fault level	Size of MS flat	
			For 25kV system	For 2X25kV system
1.	Equipment on the primary side of traction power transformer.	66 kV, upto 3000 MVA 110 kV, upto 5000 MVA 132 kV, upto 6000 MVA 220 kV, upto 10,000 MVA	50 mm x 6 mm	75 mm x 8 mm

		66 kV, above 3000 upto 6000 MVA 110 kV, above 5000 upto 10000 MVA 132 kV, above 6000 upto 12000 MVA 220 kV, above 10000 upto 20000 MVA	75 mm x 8 mm	75 mm x 8 mm
2.	Equipments on the secondary side of traction power transformer.		50 mm x 6 mm	75 mm x 8 mm
3.	Fencing uprights /steel structures		50 mm x 6 mm	75 mm x 8 mm
4.	Door/fencing panels		6 SWG G. I. Wires.	

### 7.5 Earthing inside control room.

An earthing ring shall be provided inside the control room by means of 50 mm x 6 mm MS flat in case of 25kV system and with 75mm X 8mm MS Flat in case of 2X25kV system. This earthing ring shall be run along the wall on teak wood blocks fixed to the wall at a height of about 300 mm from the floor level. The earthing ring shall be connected to the main earthing grid by means of two separate and distinct connections made with 50 mm x 6 mm MS flat in case of 25kV system and with 75mm X 8mm MS Flat in case of 2X25kV system. The earthing ring shall also be connected to an independent earth electrode by means of two separate and distinct connections made with 50 mm x 6 mm MS flat in case of 25kV system and with 75mm X 8mm MS Flat in case of 2X25kV system. The metallic framework of control and relay panels, LT AC and DC distributions boards, battery chargers and such other equipments shall be connected to the earthing ring by means of two separate and distinct connections made with 8 SWG galvanized iron wire. The connections shall be taken along the wall and in recesses in the floor. All recesses shall be covered with cement plaster after finishing the work. Connections between the MS flats shall be made by welding.

### 7.6 Earthing of SCADA/RTU Equipments

A separate earth electrode shall be provided as per clause 6.1 & 6.2 of this specification. The RTU body/frame shall be suitably connected to this earth electrode using two no. 8SWG bare copper wires. The earth Resistance of this electrode shall be between 2 ohm to 10 ohm or better, depending upon the soil resistivity. This earth electrode shall not be connected to any other earthing arrangement.

### 7.7 Earthing of lightning arrester.

In addition to the earth electrodes provided for the main earthing grid, an independent earth electrode shall be provided for each lightning arrester. This earth electrode shall be connected to the ground terminal of the lightning arrester as well as to the main earthing grid by means of two separate and distinct connections made with 50mm x 6mm MS flat in case of 25kV system and with 75mm X 8mm MS Flat in case of 2X25kV system, for the LV side lightning arresters, and with 75 mm x 8 mm MS flat for the HV side lightning arresters. The earth electrode shall be provided as close as possible to the lightning arrester and the connections shall be as short and straight as possible avoiding unnecessary bends. For lightning arresters provided for the traction power transformers, there shall also be a connection as direct as possible from the ground terminal of the lightning arrester to the frame of the transformer being protected; this connection shall also be made by means of two separate and distinct connections made with 50 mm x 6 mm MS flat in case of 25kV system and with 75mm X 8mm MS Flat in case of 2X25kV system, for LV side arresters, and with 75mm x 8mm MS flat for HV side lightning arrester.

### 7.8 Earth Screen.

The area covered by outdoor substation equipments shall be shielded against direct strokes of lightning by an overhead earth screen comprising 19/2.5 mm galvanized steel stranded wire strung across the pinnacles of the metallic structures. The earth screen wires shall be strung at a height as indicated in the approved traction substation layouts (not less than 2.5 m above the live conductors) and shall be solidly connected to the traction substation earthing grid at each termination by means of 50mm x 6mm MS flat in case of 25kV system and with 75mm X 8mm MS Flat in case of 2X25kV system.

#### 7.9 Earthing of fencing uprights and panels

Each metallic fencing upright shall be connected to the traction substation main earthing grid by means of two separate and distinct connections made with 50 mm x 6 mm MS flat in case of 25kV system and with 75mm X 8mm MS Flat in case of 2X25kV system. In addition, all metallic fencing panels shall be connected to the uprights by means of two separate and distinct connections made with 6 SWG G. I. wire. All the metallic door panels shall also be connected to the supporting uprights by means of two separate and distinct connections made with 6 SWG G. I. wire.

#### 7.10 Earthing at the point of 240 V ac 50 Hz supply for oil filtration plant.

The 240 V ac 50 Hz distribution board for power supply to oil filtration plant shall be connected to the main earthing grid by means of two separate and distinct connections made with 50 mm x 6 mm MS flat in case of 25kV system and with 75mm X 8mm MS Flat in case of 2X25kV system.

### 8.0 EARTHING ARRANGEMENT AT SWITCHING POST

#### 8.1 For 25kV System:

- (a) A minimum number of three earth electrodes (excluding the earth electrode provided separately for control room and RTU equipments (refer clause 8.5 & 8.6) shall be provided at each switching station, and they shall be interconnected by means of 50 mm x 6 mm MS flat forming a closed loop main earthing ring. This ring shall be connected by two separate and distinct connections made with 50 mm x 6 mm MS flat, to the traction rail in a single rail track circuited section and to the neutral point of the impedance bond in a double-rail track circuited section of the nearest track, so as to limit the potential gradient developing in the vicinity of the switching station in the event of a fault.
- (b) In addition to above earthing, separate earthing station of Buried Rail, near the switching posts is to be provided as per the SMI No. TI/SMI/0032 Rev.02. (Annexure-X)

#### 8.2 For 2X25kV System (Transformer capacity at TSSs: 38/53/63MVA or 60/84/100MVA):

- (a) Earthing Grid at the SP/SSP is also to be prepared by taking the fault current of 12kA and duration of 3 seconds. The Formula for the calculation is at Annexure-I and sample calculation at annexure-XII. The Buried rail as mentioned in Para 7.2.1, is required to be provided at the SP/SSP.
- (b) Neutral of the Autotransformer installed at the SP/SSP also to be connected with two no. 75X8mm MS Flats. One MS flat is to be connected with Buried Rail & another with the Earthing grid. The reference for the connection arrangement can be taken from Annexure-IX.

#### 8.3 System earthing.

One designated terminal of the secondary of each potential, current and auxiliary transformer shall be connected to the main earthing ring/earthing grid by means of two separate and distinct connections made with 50 mm x 6 mm MS flat in case of 25kV system and with 75mm X 8mm MS Flat in case of 2X25kV System .

#### 8.4 Equipment earthing.

- 8.4.1 All masts, structures, fencing uprights and all outdoor equipment pedestals including auxiliary transformer tank shall be connected to the earthing ring by means of two separate and distinct connections made with 50 mm x 6 mm MS flat in case of 25kV system and with 75mm X 8mm MS Flat in case of 2X25kV system. All fencing panels shall be connected to the supporting uprights by means of two separate and distinct connections made with 6 SWG G. I. wire. All the metallic door panels shall be connected to the supporting uprights by means of two separate and distinct connections made with 6 SWG G. I. wire.
- 8.4.2 The metal casing of potential and current transformers shall be connected to the mast/ structures by means of two separate and distinct connections made with 50 mm x 6 mm MS flat in case of 25kV system and with 75mm X 8mm MS Flat in case of 2X25kV system.
- 8.4.3 The ground terminal of lightning arrester shall be connected directly to the earth electrode by means of two separate and distinct connections made with 50 mm x 6 mm MS flat in case of 25kV system and with 75mm X 8mm MS Flat in case of 2X25kV system. The earth electrode shall be so placed that the earthing leads from the lightning arrester may be brought to the earth electrode by as short and straight a path as possible.

#### 8.5 Earthing inside remote control cubicle.

An earthing ring shall be provided inside the remote control cubicle by means of 50 mm x 6 mm MS flat in case of 25kV system and with 75mm X 8mm MS Flat in case of 2X25kV system. The earthing ring shall be run along the wall on teak wood blocks fixed to the wall at a height of 300 mm from the floor level. The earthing ring shall be connected to an independent earth electrode by means of two separate and distinct connections made with 50 mm x 6 mm MS flat in case of 25kV system and with 75mm X 8mm MS Flat in case of 2X25kV system. The metal casing of LT, AC and DC distribution board, battery chargers, terminal board and other such equipments shall be connected to the earthing ring by means of two separate and distinct connections made with 8 SWG GI wire. The connections shall be taken along the wall and in recesses in the floor. All recesses shall be covered with cement plaster after finishing the work. Connections of earth strips to each other shall be made by welding.

#### 8.6 Earthing of SCADA/RTU Equipments

A separate earth electrode shall be provided as per clause 6.1 & 6.2 of this specification. The RTU body/frame shall be suitably connected to this earth electrode using two no. 8SWG bare copper wires. The earth Resistance of this electrode shall be between 2 ohm to 10 ohm or better, depending upon the soil resistivity. This earth electrode shall not be connected to any other earthing arrangement.

### 9.0 EARTHING OF NEUTRAL OF LOCAL POWER SUPPLY SYSTEM

At traction substations and switching stations where power supply at 415 V/ 240 V, ac 50 Hz is taken from the local supply authority and having neutral earth at some distant point in the premises of the supply authority, the neutral of such supply shall also be earthed by means of two separate and distinct connections made with 6 SWG GI wire by connecting to an independent earth electrode.

### 10.0 EARTHING ARRANGEMENT AT AUXILIARY TRANSFORMER STATION

- 10.1 The combined earth resistance at an auxiliary transformer station shall not be more than 10.0 ohms. Normally, one earth electrode is sufficient at each auxiliary transformer station. The earth electrode shall be connected to the mast on which the auxiliary transformer is mounted by means of two separate and distinct connections made with 50 mm x 6 mm MS flat in case of 25kV system

and with 75mm X 8mm MS Flat in case of 2X25kV system. In addition, the mast shall be connected to the nearest traction rail or to the neutral point of the impedance bond in a double rail track circuited section by means of 50 mm x 6 mm MS flat in case of 25kV system and with 75mm X 8mm MS Flat in case of 2X25kV system.

- 10.2 The earthing terminal on the transformer tank shall be connected to the mast on which the transformer is mounted by means of two separate and distinct connections made with 50 mm x 6 mm MS flat in case of 25kV system and with 75mm X 8mm MS Flat in case of 2X25kV system. One terminal of the secondary winding of the auxiliary transformer shall be connected to the earthing terminal on the transformer tank and as well as to the mast by means of 50 mm x 6 mm MS flat in case of 25kV system and with 75mm X 8mm MS Flat in case of 2X25kV system. These connections shall be as short and straight as possible and avoiding unnecessary bends.

#### 11.0 METHOD OF JOINTING

All the joints between the MS flats, MS rods or between MS flat and MS rod shall be made by welding only. No soldering shall be permitted. For protection against corrosion. All the welded joints shall be treated with red lead and afterwards thickly coated with bitumen compound.

#### 12.0 PAINTING OF MS FLATS.

For protection against corrosion, all the exposed surface of earthing connections (MS flats) above ground level shall be given all around two coats of painting to colour grass green, shade 218 of IS:5.

#### 13.0 CRUSHED ROCK SURFACE LAYER.

At the traction substations and switching stations, a surface layer of crushed rock shall be provided to a thickness of about 100mm. If considered necessary from the point of view of containing the step and touch voltages within the acceptable limits, higher thicknesses may be provided depending on calculation based on site conditions.

#### 14.0 STEP AND TOUCH VOLTAGES

- 14.1 The formulae for calculating the tolerable touch and step voltages, estimated mesh and step voltages, earth resistance, earth potential rise, size of earthing grid conductor and length of buried grid conductor are given in Annexure-I & XI.
- 14.2 The design for earthing grid shall be done separately for each location depending on the conditions obtaining and those foreseen.

#### 15.0 REFERENCE DRAWINGS

The following drawings (latest versions) issued by RDSO in connection with this specification may be used for reference:

SN	Description	Drawing No.	Enclosed at
1.	Typical return current connection of buried rail at traction substation	ETI/PSI/0212-1	ANNEXURE-III
2.	Typical earthing layout of sub sectioning and paralleling station	ETI/PSI/201-1	ANNEXURE-IV
3.	Typical earthing layout of sectioning and paralleling station	ETI/PSI/202-1	ANNEXURE-V
4.	Typical arrangement of an earth electrode	ETI/PSI/222-1	ANNEXURE-VI
5.	Typical earthing arrangement of an auxiliary Transformer station	ETI/PSI/708	ANNEXURE-VII

Note: Drawings as per the revision at the time of issue of specification are enclosed. The latest version of the drawings should be followed.

## ANNEXURE-I

**FORMULAE FOR CALCULATION OF EARTHING GRID BASED ON IEEE GUIDE FOR SAFETY IN AC SUBSTATION GROUNDING, NO. IEEE 80-2013 & IS: 3043-2018****1.0 Tolerable Touch and Step Voltage**

$$1.1 \quad E_{touch} = (1000 + 1.5C_s \rho_s) \frac{0.116}{\sqrt{t_s}} \quad \text{V (for 50 kg body)}$$

$$1.2 \quad E_{step} = (1000 + 6C_s \rho_s) \frac{0.116}{\sqrt{t_s}} \quad \text{V (for 50 kg body)}$$

Where,

Symbol	Representation
$C_s$	$0.09 \times \left( 1 - \frac{\rho}{\rho_s} \right) \div \left( 1 - \frac{0.09}{2 \times h_s + 0.09} \right)$
$\rho_s$	Resistivity of surface material (crushed rock) in $\Omega$ -m
$\rho$	Resistivity of earth (Soil) in $\Omega$ -m
$t_s$	Duration of shock current in seconds (to be taken as 0.5 seconds)
$h_s$	Thickness of the crushed rock surface layer in m

**2.0 Estimated mesh and step voltage**

$$2.1 \quad E_{\text{mesh}} = \frac{\rho \cdot K_m \cdot K_i \cdot I_G}{L} \quad \text{Volt}$$

$$2.2 \quad E_{\text{step}} = \frac{\rho \cdot K_s \cdot K_i \cdot I_G}{L} \quad \text{Volt}$$

Where,

Symbol	Representation
$K_i$	Correction factor for grid geometry, which accounts for the increase in current density in the grid extremities, = $0.644 + 0.148 \times n$
$I_G/L$	Average current per unit length of buried conductor in amperes / metre
$K_m$	$K_m = \frac{1}{2\pi} \left[ \ln \left( \frac{D^2}{16hd} + \frac{(D+2h)^2}{8Dd} - \frac{h}{4d} \right) + \frac{K_{ii}}{K_h} \ln \frac{8}{\pi(2n-1)} \right]$
$K_{ii}$	1, for grids with earth electrodes along the perimeter, or for grids with earth electrodes in the grid corners, as well as both along the perimeter and throughout the grid area. 1/ {(2n) <sup>(2/n)</sup> }, for grids without earth electrodes or grids with only a few earth electrodes, none located in the corners or on the perimeter.
$K_h$	$\sqrt{1 + h/h_o}$

$K_s$	$\frac{1}{\pi} \left[ \frac{1}{2h} + \frac{1}{D+h} + \frac{1}{D} (1 - 0.5^{n-2}) \right]$ for values of h between 0.25 and 2.5m
ho	1 metre (reference depth of grid)
D	Spacing between parallel conductors of grid in m (same spacing in both directions)
$n$	$n_a \times n_b \times n_c \times n_d$ $n_a = \frac{2.L_c}{L_p}$ $n_b = 1$ for square grids $n_c = 1$ for square and rectangular grids $n_d = 1$ for square, rectangular and L-shaped grids Otherwise $n_b = \sqrt{\frac{L_p}{4 \times \sqrt{A}}}$ (Since in Indian Railways, there are square or rectangular grids, other formulas of IEEE-80 are not mentioned here)
h	Depth of earthing grid conductors in metres
d	Diameter of earthing grid conductor in metres
L	Total length of earthing system conductor Lc + Lr for grids without earth electrodes or with only a few electrodes located within the grid but away from perimeter Lc + 1.15 Lr for grids with earth electrodes along the perimeter
Lc	Total grid conductor length in m
Lr	Total earth electrode length in m
Lp	Peripheral length of grid in m
$\rho$	Resistivity of earth in $\Omega$ -m
A	Area of the grid in $m^2$
$I_G$	As defined in para 4.1 below.

Note: The estimated values of mesh and step voltage should be less than the tolerable touch and step voltages respectively.

### 3.0 Earth resistance:

$$R_g = 0.443 \frac{\rho}{\sqrt{A}} + \frac{\rho}{L}$$

Where,

Symbol	Representation
L	Total length of buried conductors in m
A	Area occupied by the earthing grid in $m^2$
$R_g$	Station ground resistance in ohms
$\rho$	Resistivity of earth (soil) in $\Omega$ -m

**4.0 Earth Potential rise:**

$$4.1 \text{ Earth potential rise} = R_g \times I_g$$

Where,

Symbol	Representation
$R_g$	Station earth resistances in ohms
$I_g$	$C_p \times D_f \times I_g$
$C_p$	Corrective projection factors accounting for the relative increase of fault currents during the station lifespan: for a zero future system growth $C_p = 1$
$I_g$	r.m.s. value of symmetrical grid fault current in amperes.
$D_f$	Decrement factor for the entire duration of faults (to allow for the effects of asymmetry of the fault current wave).
	1.0 for fault current duration of 0.5 second or more.

**5.0 Size of earthing grid conductor**

$$A = \frac{I\sqrt{t}}{80}$$

Where

Symbol	Representation
A	Cross sectional area of earthing grid conductor in square millimeters.
I	r.m.s value of fault current in amperes.
t	Duration of fault current in second <ul style="list-style-type: none"> <li>To be taken as 01 second for the calculation of grid conductor size on the basis of HV side Fault MVA.</li> <li>To be taken as 03 second for the calculation of grid conductor size on the basis of LV side fault current, which is 6kA for 25kV System and 12kA for 2X25kV System.</li> </ul>

Note: -

- To allow for the effects of corrosion, the size of the grid conductor selected shall be such that its cross section area is nearly twice that calculated above.
- The earthing grid conductor size to be calculated on the basis of both primary and secondary side fault current and the higher between them should be selected for designing the grid.

**6.0 Minimum length of buried grid conductor**

$$L > \frac{K_m \times K_i \times \rho \times I_g \sqrt{t_s}}{\{116 + 0.174 C_s \times \rho_s\}} \quad \text{for } E_{\text{mesh}} < E_{\text{touch}}$$


Where,

Symbol	Representation
L	Minimum length of buried grid conductor including earth electrodes in metres.
$t_s$	0.5 second (assumed maximum duration of shock).
Cs, Km, Ki, $\rho$ , $I_g$ and $\rho_s$ have been defined earlier.	





## Annexure –II

TYPICAL EARTHING GRID (MS ROD)

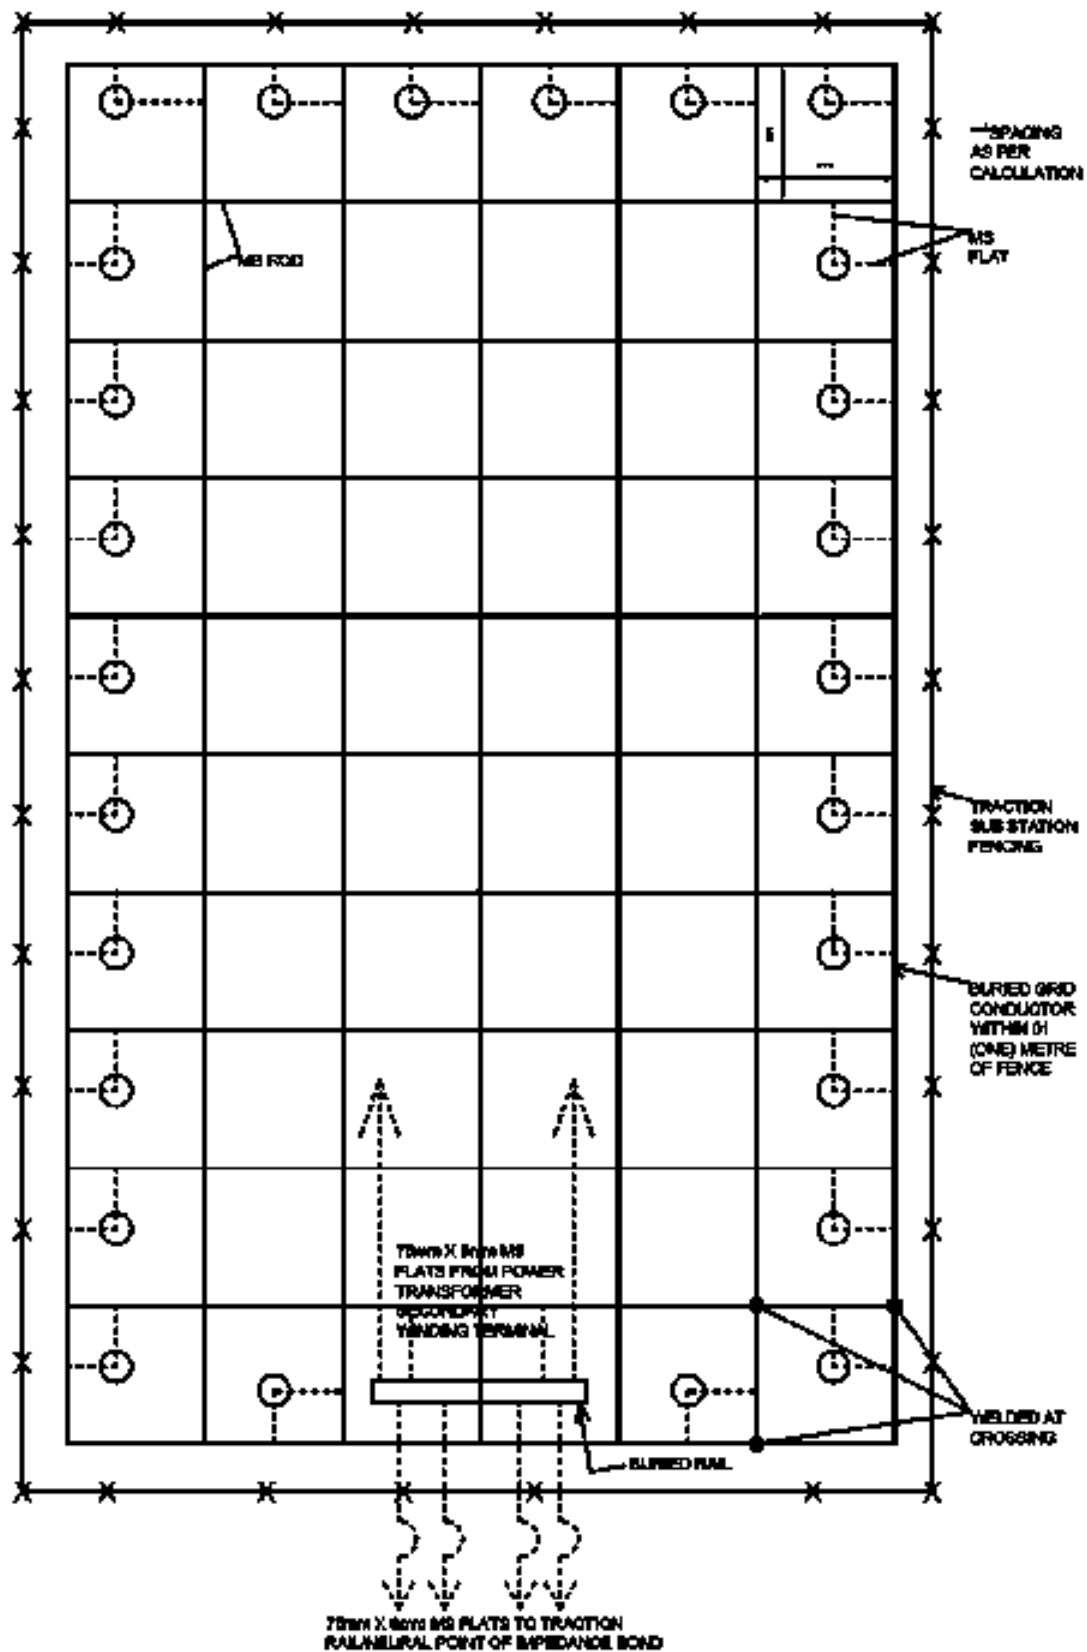

TYPICAL EARTHING GRID (MS ROD)

## Annexure- III

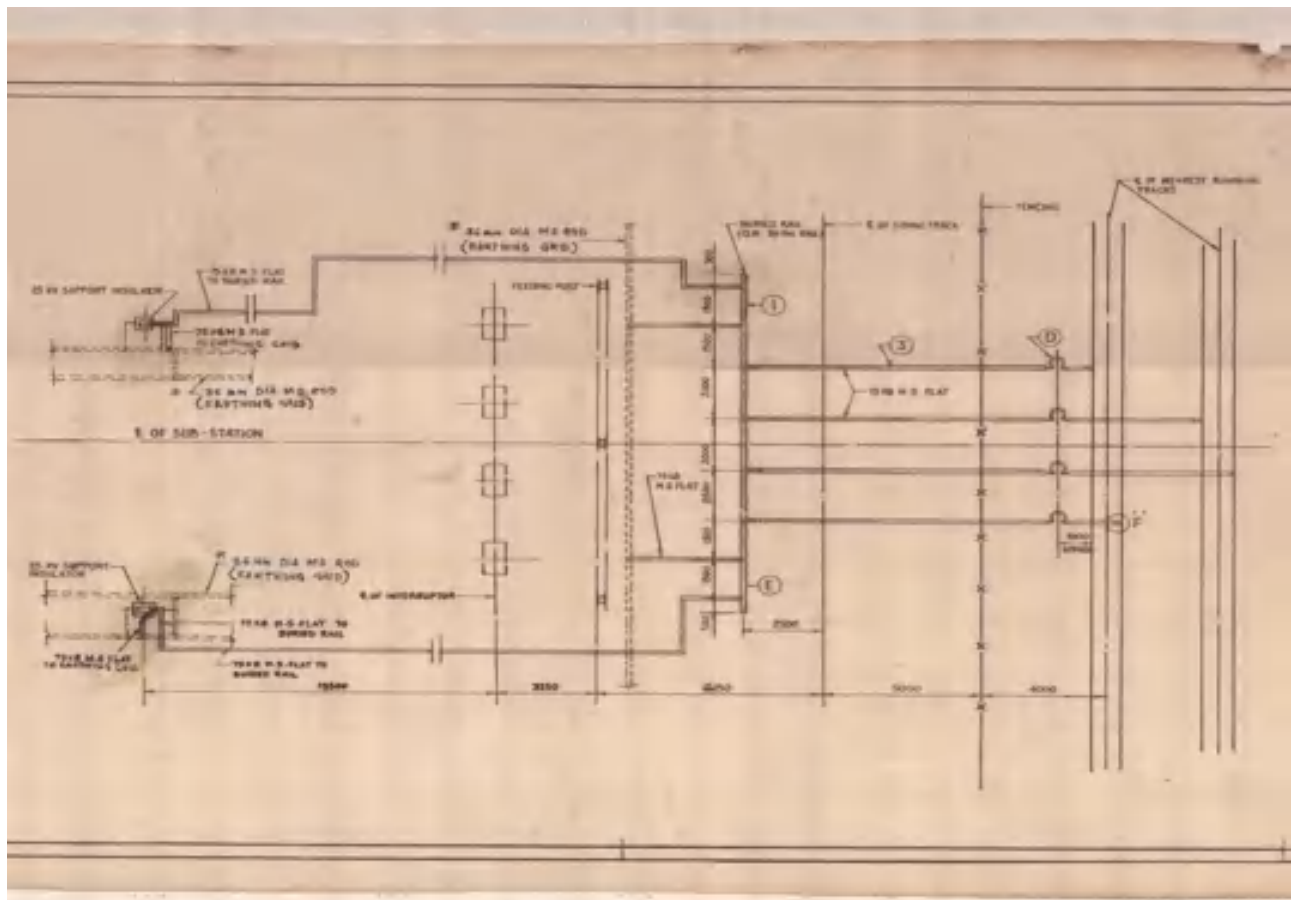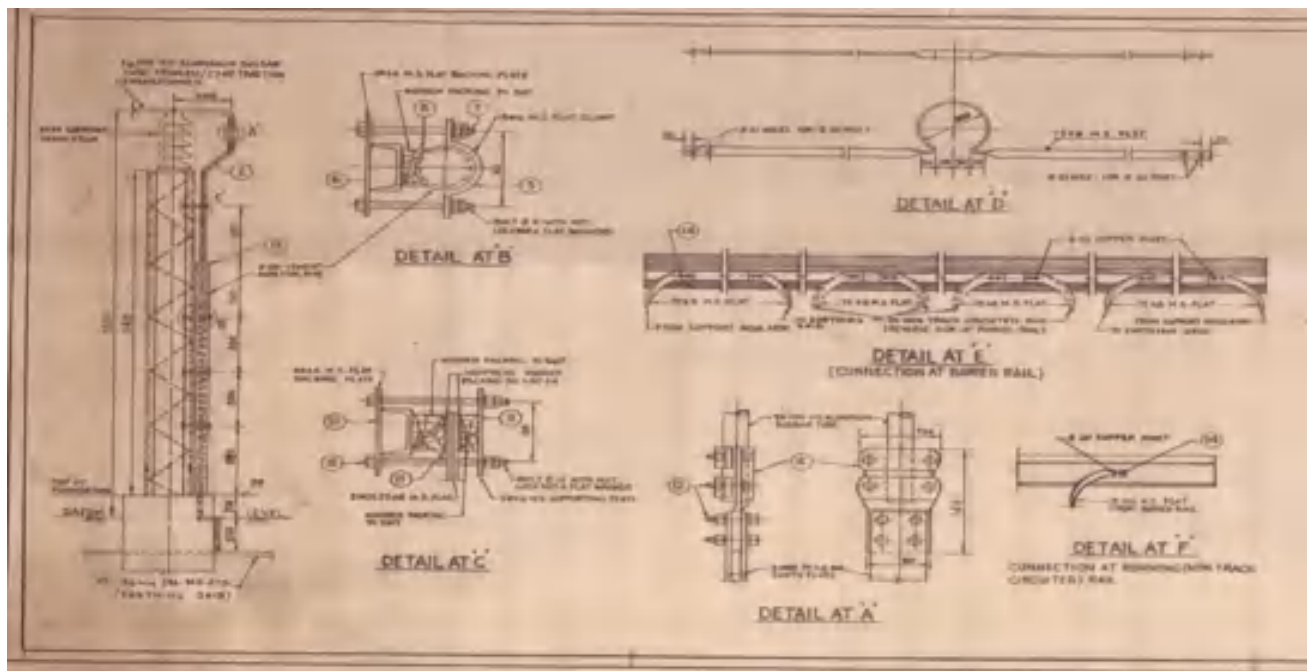Typical return current connection of buried rail at traction substation, drawing no. ETI/PSI/0212-1

SCHEDULE OF QUANTITIES				
ITEM	DESCRIPTION	QTY/UNIT	NO. OF	REMARKS
1	50% RAIL (5000 MM LONG)	-	1	
2	1/4" H.S. PLATE (1/8" THICK) SUPPORT INSULATOR	-	AS REQUIRED	
3	1/4" H.S. PLATE (1/8" THICK) BURIED RAIL IN RAILING	-	AS REQUIRED	
4	50 MM ALUMINUM SUB STATION CONNECTOR	1	2	
5	50% H.S. PLATE CLAMP	-	3	
6	RAILING PLATE (1/8")	-	6	
7	WATER TIGHT JOINTS COMPLETE WITH GROUT	-	12	
8	WOODEN TRACKING	-	AS REQUIRED	
9	SUPPORTING PLATE	-	2	
10	BRACING PLATE (SMALL)	-	2	
11	INSULANT RUBBER TRACKING	-	4	
12	1/4" H.S. PLATE (1/8" THICK) RAILING PLATE WITH	-	10	
13	INSULANT RUBBER TRACKING	-	2	
14	50% RAIL (5000 MM LONG)	-	24	
15	50% RAIL (5000 MM LONG) COMPLETE WITH GROUT	-	4	

**NOTE:**

- ALL DIMENSIONS ARE IN MM.
- THE RAIL PLATE SHALL BE FASTENED WITH TWO CORNER AND ONE CLAMP. THE CLAMP IS TO BE USED TO BURIED RAIL IN RAILING PLATE. THE CLAMP IS TO BE USED TO BURIED RAIL IN RAILING PLATE. THE CLAMP IS TO BE USED TO BURIED RAIL IN RAILING PLATE.
- A VERTICAL CLEARANCE OF 750 MM SHALL BE MAINTAINED BETWEEN THE TWO EARTH STAYS. THE STAYS SHALL BE MADE OF 1/4" H.S. PLATE.
- FOR TYPICAL EARTHING DETAIL OF THE SUBSTATION SEE DETAIL OF THE SUBSTATION.
- THE LOCATION OF BURIED RAIL MUST BE INDICATED BY TYPING LABEL PLAIN IN EACH SUBSTATION.
- THE LENGTH OF BURIED RAIL IS 5000 MM.
- DEPTH OF BURIED RAIL FROM GROUND LEVEL SHALL BE 300 MM.
- CONNECTIONS FROM ONE EARTHING TERMINAL OF THE TRANSFORMER TO ANOTHER IS MADE WITH THE 1/4" H.S. PLATE CLAMPED TO IT BY 1/4" H.S. PLATE CLAMP. THE CLAMP IS TO BE USED TO BURIED RAIL IN RAILING PLATE. THE CLAMP IS TO BE USED TO BURIED RAIL IN RAILING PLATE.
- THE RAIL PLATE SHALL BE FASTENED WITH TWO CORNER AND ONE CLAMP. THE CLAMP IS TO BE USED TO BURIED RAIL IN RAILING PLATE. THE CLAMP IS TO BE USED TO BURIED RAIL IN RAILING PLATE.

THIS DRAWING IS THE PROPERTY OF THE ENGINEERING DEPARTMENT, BANGKOK METRO RAILWAY AUTHORITY. IT IS TO BE USED FOR THE PURPOSES OF THE PROJECT ONLY. IT IS NOT TO BE REPRODUCED OR COPIED IN ANY FORM OR BY ANY MEANS WITHOUT THE WRITTEN PERMISSION OF THE ENGINEERING DEPARTMENT.

**TYPICAL RETURN CURRENT CONNECTION TO BURIED RAIL AT 132 KV/25 KV TRACTION SUB-STATION**

DTI-1

ADE/11

REF:

R. D. S. O.

DATE: / /

TIME: / /

BY: /

TC: /


CR: /

ETI/PSI/0212-1

SCALE: 1:100

Typical return current connection of buried rail at traction substation, drawing no. ETI/PSI/0212-1

## Annexure-IV

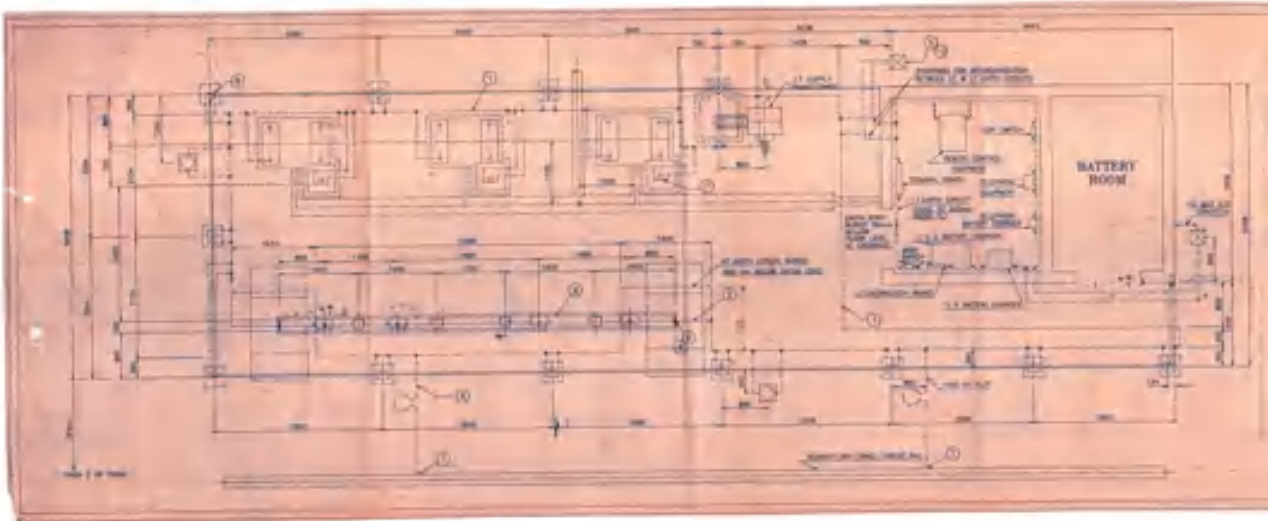Typical Earthing layout of sub sectioning and paralleling station Drawing No. ETI/PSI/201-1

SCHEDULE OF MATERIALS						
NO.	DESCRIPTION	QTY/PCOR NO.	QUANTITY	LENGTH IN M.		REMARKS
				EACH	TOTAL	
1	25x4 MS FLAT FOR HT & LT EARTH CIRCUIT & EACH CONNECTION		1004 MTR			
2	25x4 MS STRUCTURE TO EARTH CIRCUIT BOND		4	1.25	5	
3	NO. 8 SWS GI WIRE		24			
4	25x4 MS EARTH CIRCUIT TO RAIL BOND		2	3.5	10	
5	EARTH STATION	725 (1 OF CODE NO. ETI/PSI/2002/981)	4			
6	16 x 16mm BOLT 15/16 COMPLETE WITH NUT, LOCKWASHER & WASHER		2			
7	16 x 16mm BOLT 15/16 COMPLETE WITH NUT, LOCKWASHER & WASHER		15			
8	12 x 12mm BOLT 15/16 COMPLETE WITH NUT, LOCKWASHER & WASHER FOR FENCING MS FLAT TO RAIL BOND		30			
9	8 x 8mm BOLT 15/16 COMPLETE WITH NUT, LOCKWASHER & WASHER FOR FENCING MS FLAT TO STEEL WORK		12			
10	12 x 12mm BOLT WITH NUT, LOCKWASHER & WASHER		6			

**LEGEND:-**

- 25x4 MS FLAT FOR EARTH CIRCUITS AND EARTH CONNECTIONS
- NO. 8 SWS GI WIRE FOR EARTHING OF LT EQUIPMENT
- 25 KV LIGHTNING ARRESTOR
- CONNECTION OF 25x4 MS FLATS BY WELDING
- POTENTIAL TRANSFORMER TYPE-L
- CONNECTION TO THE NEAREST NON-DRIVE CIRCUIT RAIL
- REPAIRING OF FENCING PANELS BY 8 SWS GI WIRE
- STRUCTURE TO RAIL BOND FOR MS FLAT
- LT EARTHING STATION
- HT EARTHING STATION
- LT SUPPLY TRANSFORMER

**NOTES:**

- ALL DIMENSIONS ARE IN mm.
- WHEREVER DOUBLE EARTHING FLATS ARE WELDED, THE MS SURFACES OF JUNCTIONS SHALL BE SCRAPPED OUT BEFORE WELDING & SHALL BE TREATED FOR ANTICORROSION AS PER STANDARD PRACTICE.
- RESISTANCE OF HT EARTH CIRCUIT SHALL BE LESS THAN 2 OHMS.
- THE MS FLATS FORMING THE HT EARTH BUS SHALL BE BURNED AT A DEPTH OF 300mm BELOW GROUND LEVEL AND LT EARTH BUS SHALL BE FIXED TO RAIL INSIDE THE CURBULE AT THE HEIGHT OF 300mm FROM FLOOR LEVEL.
- RESISTANCE OF LT EARTH CIRCUIT SHALL BE LESS THAN 2 OHMS.
- FOR ARRANGEMENT OF EARTHING STATION REFER FIG. 1 OF THE CODE OF PRACTICE FOR EARTHING OF POWER SUPPLY INSTALLATIONS FOR 25 KV AC, 50 HZ, SINGLE PHASE TRACTION SYSTEM CODE NO. ETI/PSI/120 (2/91).
- FENCING PANEL TO FENCING UPRIGHT BONDING SHALL BE DONE BY RAILWAYS.
- IF NECESSARY EARTHING STATIONS SHALL BE ADDED IN PARALLEL TO BRING DOWN THE TOTAL EARTH RESISTANCE LESS THAN 2 OHMS.
- THE MS FLATS SHALL BE PAINTED WITH TWO COATS OF RED OXIDE ZINC CHROMATE PRIMER AND FINISHED WITH TWO COATS OF BITUMEN.
- PAINTED MS FLAT AND 8 SWS GI WIRE SHALL BE USED IN PLACE OF GALV. ANNEALED MS FLAT AND 8 SWS COPPER WIRE.
- THE EARTHING ARRANGEMENT SHALL BE IN LINE WITH THE CODE OF PRACTICE FOR EARTHING OF POWER SUPPLY INSTALLATIONS FOR 25 KV AC, 50 HZ, SINGLE PHASE TRACTION SYSTEM CODE NO. ETI/PSI/120 (2/91) WITH ADDENDUM AND CORRIGENDUM SUP. NO. 1 (10/93).


**TYPICAL EARTHING LAYOUT OF 25 KV AC SUB-SECTIONING AND PARALLELING STATION**

DTI-1  
R.D.S.O.  
ETI/PSI/201-1  
SCALE: 1:30  
SHEET NO.

Typical Earthing layout of sub sectioning and paralleling station Drawing No. ETI/PSI/201-1



## Annexure-V

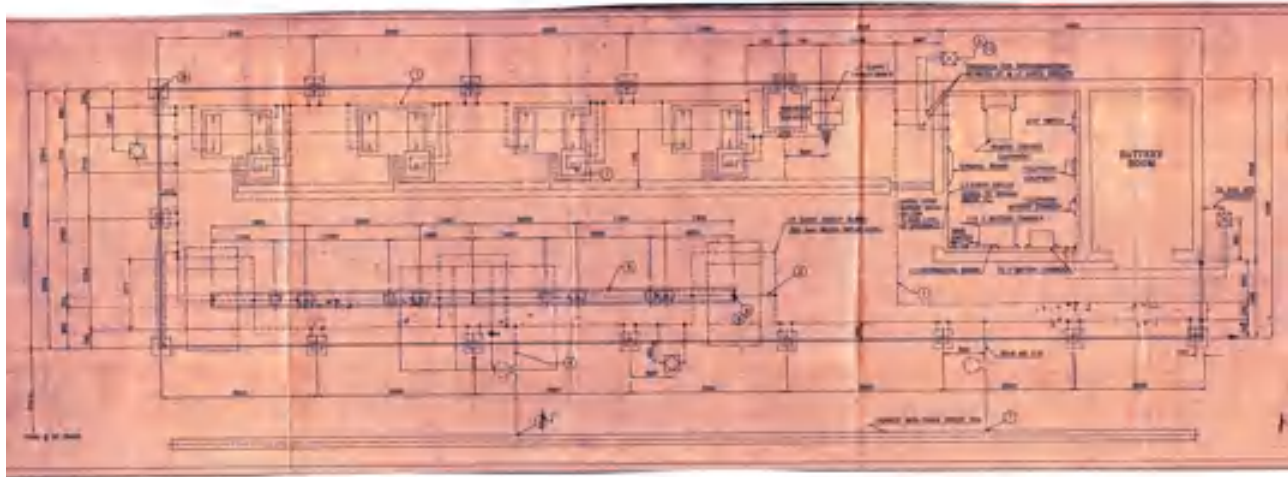Typical Earthing layout of sectioning and paralleling station, drawing No. ETI/PSI/202-1

SCHEDULE OF MATERIALS					
REF.	DESCRIPTION	QMS/FORM NO.	QUANTITY	LENGTH IN M. EACH TOTAL	REMARKS
1	35x6 MS FLAT FOR HT & LT EARTH CIRCUIT & EACH CONNECTION		105m APPROX.		
2	35x6 MS STRUCTURE TO EARTH CIRCUIT BOND		6	125 75	
3	NO. 8 SVS 32 WIRE		5m		
4	35x6 MS EARTH CIRCUIT TO RAIL BOND		2	50 11	
5	EARTH STATION	FIG. 1 OF CODE NO. ETI/PSI/1002/10	4		
6	16 Ø 10mm BOLT 75/45, COMPLETE WITH NUTLOCKNUT & WASHER		2		
7	16 Ø 10mm BOLT 50/37, COMPLETE WITH NUTLOCKNUT & WASHER		10		
8	12 Ø BOLT 50/33, COMPLETE WITH NUTLOCKNUT & WASHER FOR FIXING MS FLAT TO RAIL BOND		30		
9	8 Ø 12 BOLT 45/30, COMPLETE WITH NUTLOCKNUT & WASHER FOR FIXING MS FLAT TO STEEL WORK		13		
10	12 Ø BOLT WITH NUT LOCKNUT & WASHER		8		

LEGEND :-	
35x6 MS FLAT FOR EARTH CIRCUITS AND EARTH CONNECTIONS	READING OF FENCING PANELS BY 6 SVS 32 WIRE
NO. 8 SVS 32 WIRE FOR EARTHING OF LT EQUIPMENT	STRUCTURE TO RAIL BOND FOR RSL MAST
25 KV LIGHTNING ARRESTER	LT EARTHING STATION
CONNECTIONS OF 35x6 MS FLAT BY WELDING	HT EARTHING STATION
POTENTIAL TRANSFORMER TYPE-1	LT SUPPLY TRANSFORMER
CONNECTION TO THE NEAREST NON-TRACK CIRCUIT RAIL	



NOTES:	
1.	ALL DIMENSIONS ARE IN mm.
2.	WHEREVER 35x6 EARTHING PLATS ARE WELDED, THE MS SURFACES OF JUNCTIONS SHALL BE SCRAPPED OUT BEFORE WELDING & SHALL BE TREATED FOR ANTI-CORROSION AS PER STANDARD PRACTICE.
3.	RESISTANCE OF HT EARTH CIRCUIT SHALL BE LESS THAN 0 OHMS.
4.	THE MS PLATS FORMING THE HT EARTH BUS SHALL BE BURIED AT A DEPTH OF 300mm FROM GROUND LEVEL AND LT EARTH BUS SHALL BE FIXED TO 300mm FROM FLOOR LEVEL.
5.	RESISTANCE OF LT EARTH CIRCUIT SHALL BE LESS THAN 1 OHMS.
6.	FOR ARRANGEMENT OF EARTHING STATION REFER FIG. 1 OF THE CODE OF PRACTICE FOR EARTHING OF POWER SUPPLY INSTALLATIONS FOR 25 KV AC, 50 HZ SINGLE PHASE TRACTION SYSTEM CODE NO. ETI/PSI/120 (2/81).
7.	FENCING PANEL TO FENCING UPRIGHT BONDING SHALL BE DONE BY RAILWAYS.
8.	IF NECESSARY (ANYWHERE) GROUNDING SHALL BE ADDED IN PARALLEL TO BRING DOWN THE TOTAL EARTH RESISTANCE LESS THAN 2 OHMS.
9.	THE MS PLATS SHALL BE PAINTED WITH TWO COATS OF RED OXIDE ZINC CHROMATE (PRIMER) AND FINISHED WITH TWO COATS OF BITUMEN.
10.	PAINTED MS PLAT (AND) 12 Ø WIRE SHALL BE USED IN PLACE OF GALVANIZED MS PLAT (AND) 12 Ø WIRE.
11.	THE EARTHING ARRANGEMENT SHALL BE IN LINE WITH THE CODE OF PRACTICE FOR EARTHING OF POWER SUPPLY INSTALLATIONS FOR 25 KV AC, 50 HZ SINGLE PHASE TRACTION SYSTEM CODE NO. ETI/PSI/120 (2/81) WITH ADDENDUM (ANTI-CORROSION) PART NO. 1 (10/84).


THIS DRAWING IS THE PROPERTY OF RESEARCH, DESIGN & STANDARD ORGANISATION (MINISTRY OF RAILWAYS) (INDIAN RAILWAYS). IT SHALL NOT BE USED, COPIED OR REPRODUCED IN ANY MANNER WITHOUT THEIR CONSENT IN WRITING.	
TYPICAL EARTHING LAYOUT OF A 25KV AC SECTIONING AND PARALLELING STATION	DTI-1
REF:-	ADD/TL
DATE: 10/11/2021	CROSS REF:-
BY: 10/11/2021	R.D.S.O.
10/11/2021	ETI/PSI/202-1
10/11/2021	SCALE: 1:30
10/11/2021	SHEET NO.

Typical Earthing layout of sectioning and paralleling station, drawing No. ETI/PSI/202-1

## Annexure-VI


Typical arrangement of an earth electrode Drawing No. ETI/PSI/222-1Typical arrangement of an earth electrode Drawing No. ETI/PSI/222-1

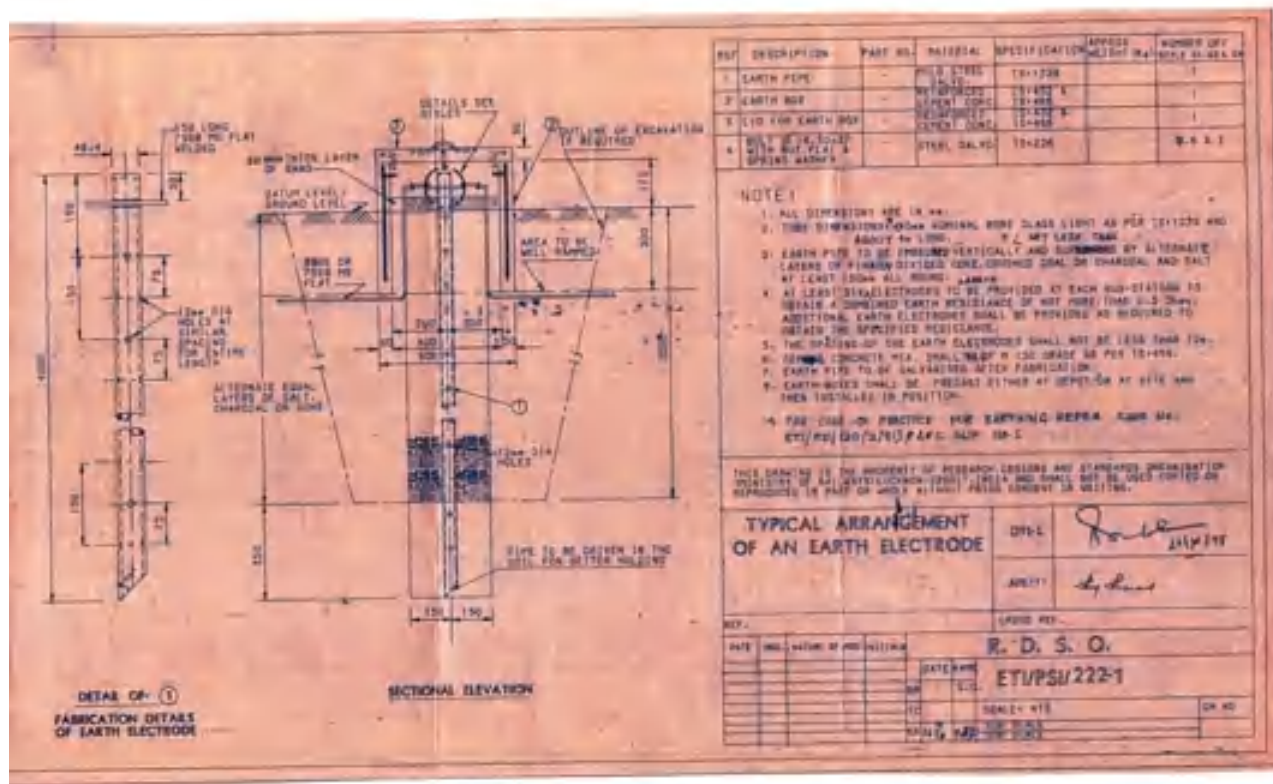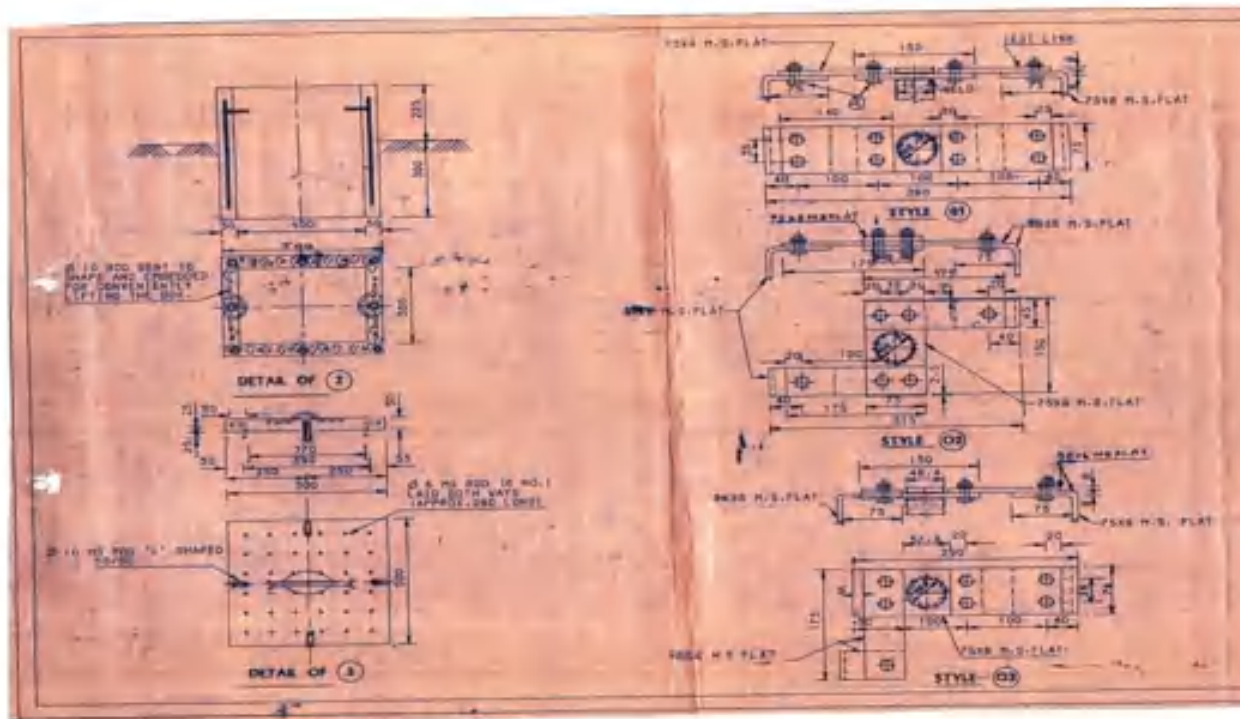

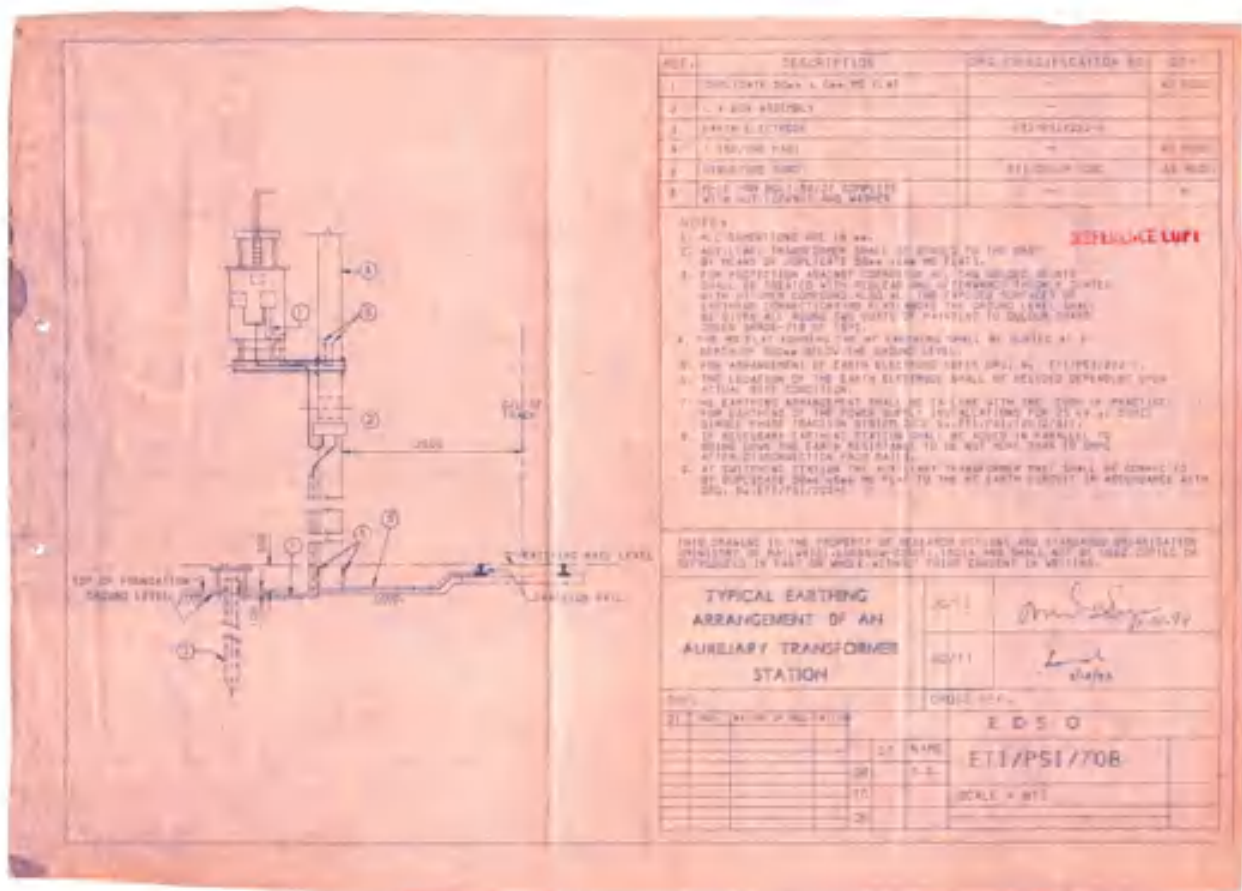**Typical Earthing arrangement of an Auxiliary Transformer station, Drawing No. ETI/PSI/708****Typical Earthing arrangement of an Auxiliary Transformer station, Drawing No. ETI/PSI/708**

## Annexure-VIII


### Connection arrangement to Buried Rail in TSS of V Connected Transformer

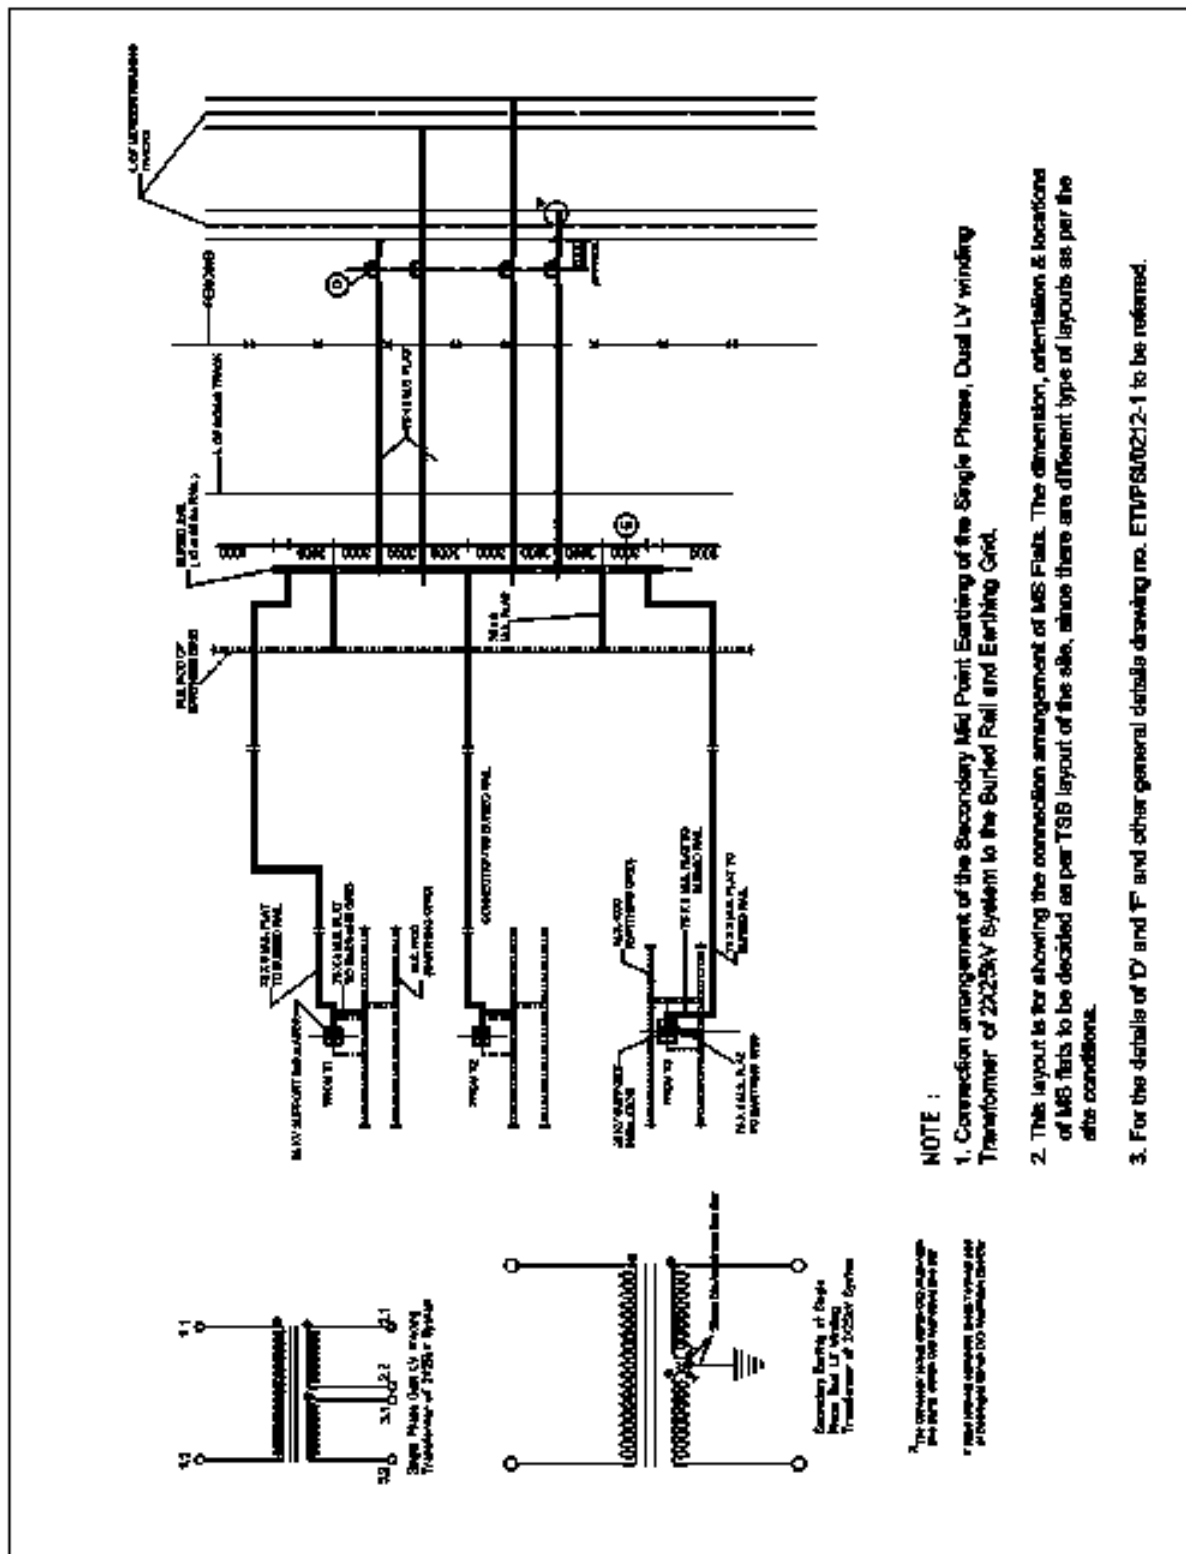



## Annexure-IX

**Connection arrangement to Buried Rail of Autotransformer at Scott Connected TSS and at SP/SSP of  
2X25kV system**

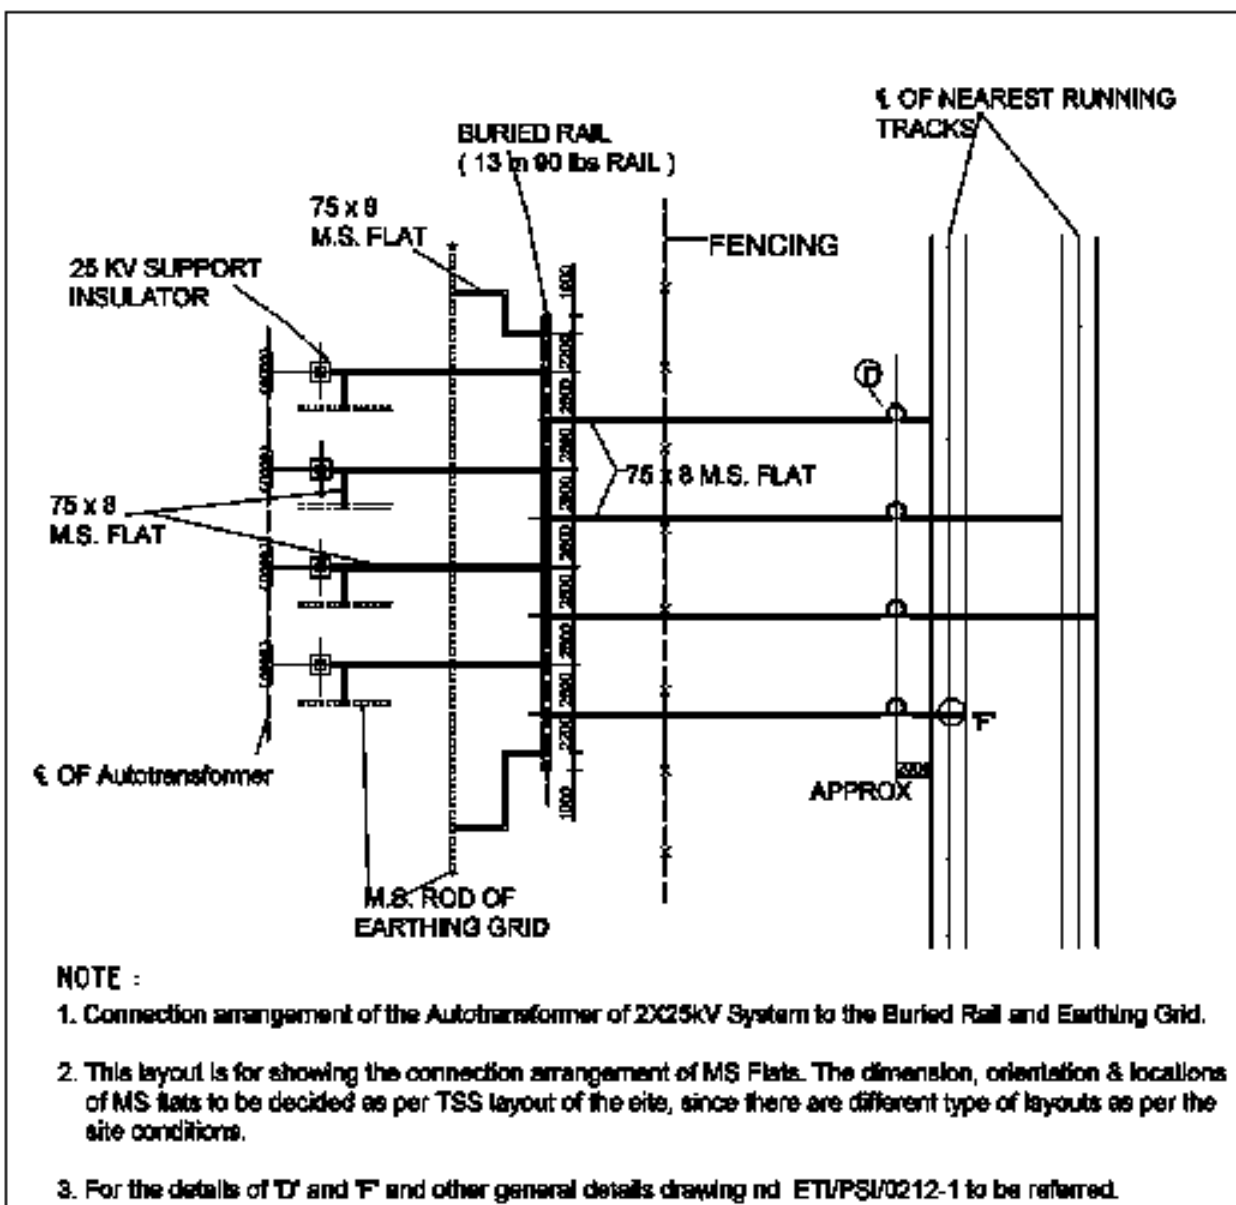

Annexure-X

141



Government of India,  
Ministry of Railways  
Research Designs & Standards Organisation,  
Manak Nagar, Lucknow- 226 011

Telephone: 2465763 (O).  
42805(Off.)  
Fax : 91-0522-2465763  
E-mail: dti.rdsso@gmail.com



पत्रांक: टीआई/पीएसआई/अर्थिंग/पॉलिसी/14

दिनांक: 26.02.2020

To,

The Principal Chief Electrical Engineer,

- (i) Central Railway, Station Building, Mumbai CST – 400 001.
- (ii) Eastern Railway, Fairlie Place, Kolkata-700 001.
- (iii) East Central Railway, Hajipur-844 101.
- (iv) East Coast Railway, Bhubaneshwar-751 023.
- (v) Northern Railway, Baroda House, New Delhi - 110 001.
- (vi) North Central Railway, Allahabad-211 015.
- (vii) North Eastern Railway, Gorakhpur-273 012.
- (viii) North Frontier Railway, Mailgaon - 781 011.
- (ix) North Western Railway, Jaipur – 302 017.
- (x) Southern Railway, Park Town, Chennai- 600 003.
- (xi) South Central Railway, Railnilayam, Secunderabad-500 371.
- (xii) South Eastern Railway, Garden Reach, Kolkata-700 043.
- (xiii) South East Central, Railway, Bilaspur-495 004.
- (xiv) South West Railway, DRM's Office, Hubli-580 028.
- (xv) Western Railway, Churchgate, Mumbai-400 020.
- (xvi) West Central Railway, Jabalpur- 482 001.
- (xvii) Konkan Railway, Belapur Bhavan, Sector-11, CBD Belapur, Navi Mumbai 400614.
- (xviii) CAO, CORE Allahabad-211001.

विषय: विशेष रखरखाव निर्देश (SMI) सं. TI / SMI / 0032 Rev.02.

(Special Maintenance Instruction (SMI) no. TI/SMI/0032 Rev.02)

संदर्भ: (i) This office letter no. TI/PSI/EARTHING/POLICY/14 dated 26.11.2019.

(ii) Railway Board letter no. 2013/RE/161/122 dated 30.09.2019.

The draft the SMI No. TI/SMI/0032 Rev.02 was circulated to Zonal Railways vide this office letter referred (i) above. Based on the comments received, Special Maintenance Instruction (SMI) no. TI/SMI/0032 Rev.02 (Provision of Buried Rail at Switching Posts with Conventional Earthing System) has been finalised by this office and same is enclosed herewith for necessary action please.

This is issued with approval of the competent authority.

*आशीष*  
26-02-2020  
(ड. आशीष अग्रवाल)  
निदेशक टी आई - 3  
ऊर्जा महानिदेशक (टी आई)

संलग्नक: SMI No. TI/SMI/0032 Rev.02

प्रतिलिपि: ED/RE, Railway Board, Rail Bhavan, New Delhi – 110 001

TI/SMI/0032 Rev.02	Effective from 19.02.2020	Special Maintenance Instruction for Setting up Earthing station at switching Post	Page 1 of 5
-----------------------	------------------------------	--	-------------



Government of India  
Ministry of Railways

SPECIAL MAINTENANCE INSTRUCTION No.

TI/SMI/0032 Rev- 02

For

SETTING UP EARTHING STATION AT SWITCHING  
POSTS (SSP & SP)

WITH CONVENTIONAL EARTHING SYSTEM

Issued By  
Traction Installation Directorate  
Research Designs & Standards Organisation  
Lucknow – 226011.

February, 2020

139

TI/SMI/0032 Rev.02	Effective from 19.02.2020.	Special Maintenance Instruction for Setting up Earthing station at switching Post	Page 2 of 5
-----------------------	-------------------------------	--	-------------

**1.0 INTRODUCTION**

- 1.1 This SMI supersedes the SMI No. TI/SMI/0032 Rev.01 issued by RDSO vide letter no. TI/PSI/Earthing/Policy/14 dated 01.04.2014.
- 1.2 With advances in track technology the Rail is no longer at ground potential which has been the assumption of existing Earthing Code ETI/PSI/120 & ETI/OHE/71. The structures have been conventionally bonded to the Rail with belief that the structure would be grounded through the Rail. Whereas, now Rail sees earth through the structures many-a-times with increasing rail-formation insulation.
- 1.3 The immediate concerns which arise are the rising of Rail potentials, affect on the efficacy of existing protection scheme and safety of Rail vehicles. Thus, it is decided to create Earthing stations at a place near the Switching Posts (SP/SSP). Idea is to create a positive, strong and deliberate earth connection to improve system resilience.
- 1.4 The SMI No. TI/SMI/0031 Rev.01 was discussed in the 30<sup>th</sup> MSG (TRD) held at Mount Abu on 13<sup>th</sup> & 14<sup>th</sup> April 2018 and 31<sup>st</sup> MSG (TRD) held at Somnath on 08<sup>th</sup> & 09<sup>th</sup> November 2019. The group deliberated for the revision of SMI.

**2.0 REFERRED DOCUMENTS**

SN	Document	Description	Number
1.	Specification	Code for Bonding and Earthing for 25 kV, a.c., 50 Hz Single Phase Traction System.	ETI/OHE/71
2.	Specification	Code of Practice for Earthing of Power Supply Installations for 25 kV, ac, 50Hz, Single Phase traction System.	ETI/PSI/120
3.	Specification	Specification for Exothermic Welding (Connection for Bonding, Earthing /Grounding)	TI/SPC/OHE/EXOTHER MBOND/0100 (04/10)
4.	Specification	Specification for Stainless Steel fasteners for 25kV AC Traction Overhead equipment	TI/SPC/OHE/FASTNER/0120 rev.01
5.	Drawing	Earthing Station	ETI/OHE/P/7020
6.	Drawing	Typical Earthing Layout at Feeding Station	ETI/PSI/203
7.	Drawing	Typical return Current connection to Buried Rail at 132/25 kV Traction Sub Station	ETI/PSI/0212-1
8.	Drawing	Return Current Connection to the Sub Sectioning and Paralleling Post.	ETI/PSI/0201-1
9.	Drawing	Return Current Connection to the Sectioning and Paralleling Post.	ETI/PSI/0202-1

- 3.0 It may be noted that in conventional electrification which uses a running Rail for return circuit, one end of Transformer's secondary is connected to this Earthing system, thereby making full traction current flow through this system. It may be further noted that full load current would not necessarily take: Running Rail>Buried Rail>Transformer. Some current can as well get to the transformer from Earth Electrode>Earth Grid>Transformer.

**4.0 Existing Arrangement for Earthing the Tracks**

There are no direct earth connections except at the Feeding posts. The design philosophy assumes that the Rails are naturally at ground potential and the structures get earthed by connection to the Rails.

Present connection at Feeding Post has been described in RDSO Drawing No. ETI/PSI/203. The following are main components of the present Feeding Post Earthing Station:-

138

TVSML/0212 Rev.02	Effective from 19.02.2020	Special Maintenance Instruction for Setting up Earthing station at switching Post	Page 3 of 5
----------------------	------------------------------	--	-------------

- 4.1 **BURIED RAIL:** Acts as maintenance free Earth Bus.
- 4.2 **EARTH GRID:** Connects various ground Electrodes and reduces the possibility of Higher Step Potential.
- 4.2 **EARTH ELECTRODES:** Couples the Buried Rail to parent earth and hence bringing down the Earth potential.

## 5.0 **DESIGN OF THE EARTHING STATION**

Two Earthing Stations near the Switching Station, one on either side of the UP and DN track, shall be provided. For multi track system (i.e. Block Sections having more than two tracks (UP & DN track)), separate Earthing Station for each track shall be provided.

### 5.1 **GENERAL ARRANGEMENT**

Preferably Rail or TRD mast (all type) of length more than 9 m shall be used to create an Earth station. The released Rails/TRD Masts should always be preferred. Two Earth Electrodes shall be provided at each end of the Buried Rail as per RDSO Drawing No. ETI/ONE/P/7020. Thus the Buried Rail would be configured as Earth Bus.

### 5.2 **DESIGN**

A trench, of size about 0.6 m x 'X' m, with a depth of about 1 m from the ground level shall be dug on the track side. ('X' should be more than 2 m of the length of the Rail/TRD mast used)

- 5.2.1 At a distance of about 1.5m  $\pm$  0.5 m, from either ends of the Buried Rail, two 19 mm  $\phi$  holes are drilled for connection to earth pits. 02 more holes at 1.5m  $\pm$  0.5 m from the above holes to be drilled for connection to track.
- 5.2.2 Two electrodes shall be provided as per RDSO Drawing No. ETI/ONE/P/7020 at a distance of 1.5m  $\pm$  1.0m on both ends. Earthing shall be provided as described in RDSO Drawing No. ETI/PSI/0212-1 and mentioned at page no. 4 & 5 of this SML. GI flats are preferably to be used for earthing, in view of longer life, but in case of non-availability of GI Flats, standard MS Flats can be used after painting them with two coats of Aluminium paint. Subsequently the word GI Flat will mean both the above methods.

#### 5.2.3 **Preparation of Earth Bus (Buried Rail)**

- 5.2.3.1 The Rail (this nomenclature includes masts as mentioned in Para 5.1), duly prepared, shall be lowered in to the trench.
- 5.2.3.2 The connection between the Buried Rail and Earth Electrodes of respective Earth Pits on both sides shall be done through 75 x 8 mm GI Flats, by using 20 mm  $\phi$  Stainless Steel bolts as mentioned at page no. 4&5 of this SML.

#### 5.2.4 **Preparation of Running Rail**

Holes are drilled on the web of running Rail and connection to be made as mentioned on page no. 4&5 of this SML.

#### 5.2.5 **Connection between the Running Rail and Buried Rail**

Connections between the Running Rail and the Buried Rail are made with two GI Flats of size 75 x 8 mm, connected with Buried Rail with 20 mm Stainless steel bolts, as per RDSO Drawing No. ETI/PSI/0212-1 and to the Running Rail with M-12 Bolt, as mentioned at page no. 4&5 of this SML.


(37)

TI/SMI/0032  
Rev.02Effective from  
19.02.2020.Special Maintenance Instruction for Setting up  
Earthing station at switching Post

Page 4 of 5


**6.0 Connection arrangement of the Running Rail – Buried Rail – Earth Electrodes**

- \* For detail of 'X' refer page no. 05 of this SMI.
- \* For detail of 'F' refer RDSO Drawing no. ETI/PSI/0212-1

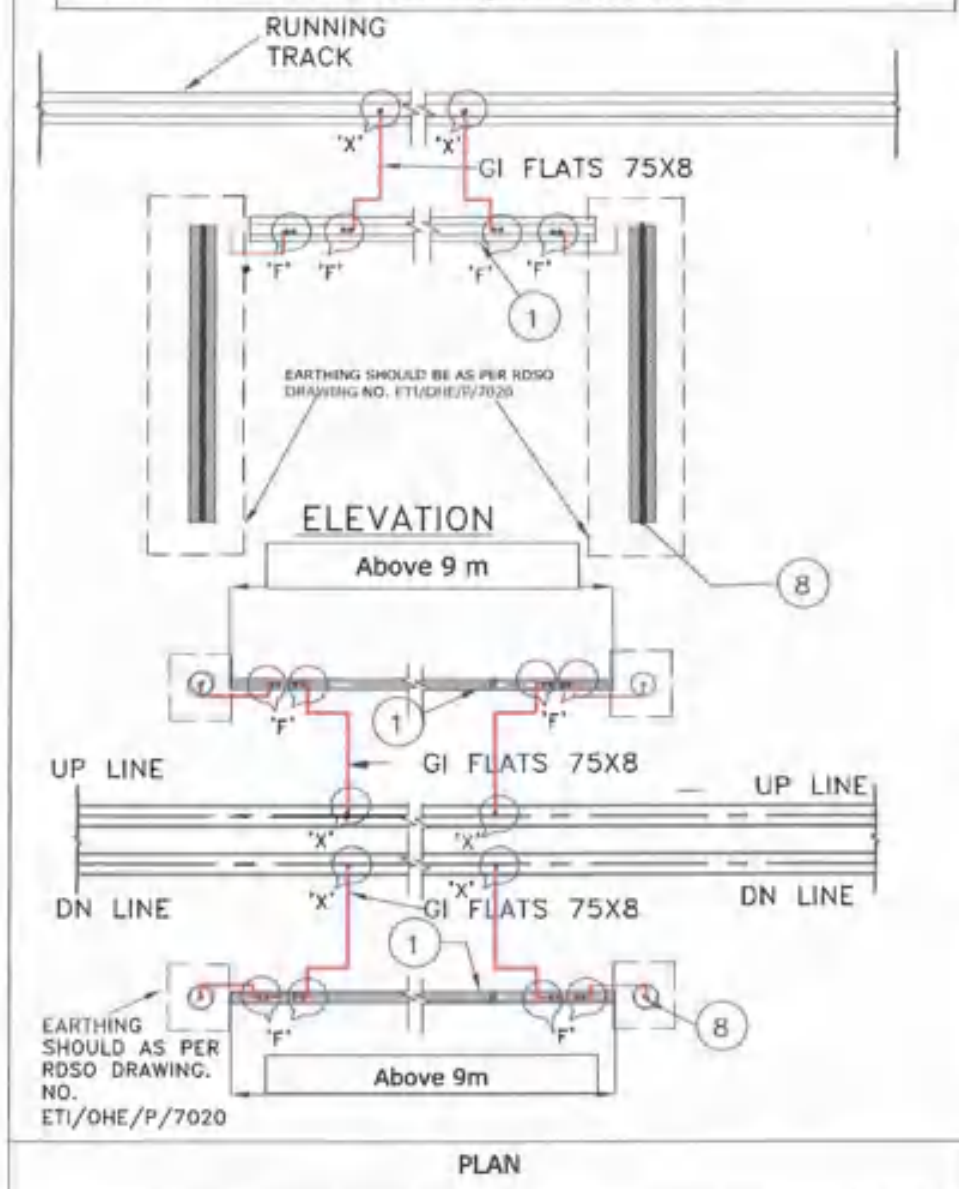

(136)

TI/SMI/0032 Rev.02	Effective from 19.02.2020.	Special Maintenance instruction for Setting up Earthing station at switching Post.	Page 5 of 5
-----------------------	-------------------------------	---	-------------

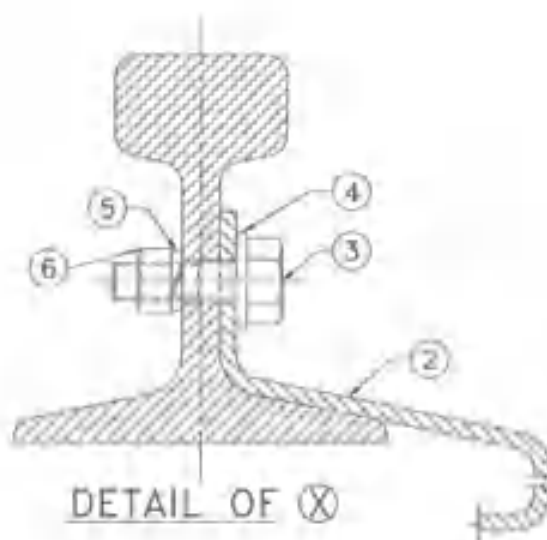

7.0 The Earth electrode shall be made as per Drawing No. ETI/OHE/P/7020.

8.0 For Buried Rail Drawing No. ETI/PSI/D212-1 to be referred.

9.0 Schedule of materials:

Ref:	Description	Quantity
1.	Above 9 m long rails or TRD masts.	02 Nos.
2.	Galvanised Iron Flats of 75mm X8 mm	as required
3.	M-12 Bolts (Stainless steel)	04 Nos.
4.	Plain washer	04 Nos.
5.	Lock washer (Spring steel)	04 Nos.
6.	Nuts	04 Nos.
7.	M-20 Bolts (Stainless steel) (for connection of GI flat to buried rail)	16 Nos.
8.	Earth electrode as per RDSO Drawing no. ETI/OHE/P/7020	04 Nos.

\*\*\*\*\*

**Sample Calculation for the Design of Earthing Mat for a TSS**

(Note: This calculations is for example with assumed values, actual site values are to be taken for the actual calculations)

Data assumed for calculations:

a.	Resistivity of earth (Soil) in ( $\rho$ )	40 $\Omega$ -m
b.	Incoming Voltage	132kV
c.	Fault Level at incoming side (i.e. 132kV side)	7000 MVA
d.	Fault Current on primary side, $I_g$	$(7000)/(\sqrt{3} \times 132) = 30618A$
e.	Grid Dimensions	100m X 50m, Area = 5000m <sup>2</sup>
f.	Resistivity of surface material (crushed rock), $\rho_s$	3000 $\Omega$ -m
g.	Thickness of the crushed rock surface layer, $h_s$	0.1 m
h.	Depth of Earth mat, h	0.6 m
i.	Reference depth of grid, $h_o$	1.0m

Standard Values to be taken:

a.	Duration of Fault current, t	<ul style="list-style-type: none"> <li>To be taken as 01 second for the calculation of grid conductor size on the basis of HV side fault current.</li> <li>To be taken as 03 second for the calculation of grid conductor size on the basis of LV side fault current.</li> </ul>
		0.5 second for determining the Tolerable touch and step potential
b.	Resistance of the Main Earthing Mat	0.5 $\Omega$ (maximum) for TSS

**Step 1:** Diameter of the grid MS rod size calculation (d):

(i) On the basis of HV side fault current i.e. 30618A for 01 second,

$$A = \frac{I\sqrt{t}}{80} = (30618 \times \sqrt{1}) / 80 = 382.724 \text{ mm}^2$$

By taking 100% margin factor due to corrosion, required area = 2 x 382.724 = 765.44 mm<sup>2</sup>  
So, required conductor dia=  $\sqrt{(765.44/3.14)} \times 2 = 31.22\text{mm}$

(ii) On the basis of LV side fault current i.e. 6kA for 3 seconds,

$$A = \frac{I\sqrt{t}}{80} = (6000 \times \sqrt{3}) / 80 = 129.9 \text{ mm}^2$$

By taking 100% margin factor due to corrosion, required area = 2 x 129.9 = 259.8 mm<sup>2</sup>  
So, required conductor dia=  $\sqrt{(259.8/3.14)} \times 2 = 18.19\text{mm}$

Higher between (i) & (ii) above is 31.22 mm. Now, considering the Para 7.1.2 of the specification, 32mm Diameter grid conductor is to be used.

**Step 2:** Tolerable Step & Touch Potential

$$E_{touch} = (1000 + 1.5C_s\rho_s) \frac{0.116}{\sqrt{t_s}}$$



$$\text{Where, } C_s = \frac{0.09 \times \left(1 - \frac{\rho}{\rho_s}\right)}{1 - \frac{0.09}{2 \times h_s + 0.09}} = 0.694$$

$$E_{touch} = \{(1000 + 1.5 \times 0.694 \times 3000)\} \times \{(0.116) / (\sqrt{0.5})\}$$

$$= 676.220V$$

$$E_{step} = (1000 + 6C_s\rho_s) \frac{0.116}{\sqrt{t_s}}$$

$$E_{step} = \{(1000 + 6 \times 0.694 \times 3000)\} \times \{(0.116) / (\sqrt{0.5})\}$$

$$= 2212.735V$$

**Step 3:** Design of Grid

Grid layout = 100m X 50m

Assumed spacing between earth grid conductors (D) = 5m

So, No. of Vertical rods in earth mat  $N_x = (100/5) =$  taken as 20 and No. of Horizontal rods in earth mat  $N_y = (50/5) =$  Taken as 10

Total length of earthing system conductor (L)

=  $L_c + 1.15 L_r$  for grids with earth electrodes along the perimeter

$$L_c = 100 \times 10 + 50 \times 20 = 2000m$$

Assuming no. of earth electrodes = 70

So,  $L_r = 4 \times 70 = 280m$  (4m length of earth electrode)

Total length of Earth conductor =  $2000 + 1.15 \times 280 = 2320m$

**Step 4:** Grid resistance:

$$R_g = 0.443 \frac{\rho}{\sqrt{A}} + \frac{\rho}{L}$$

$$R_g = \{0.443 \times (40/\sqrt{5000})\} + (40/2320)$$

$$= 0.268 \Omega$$

**Step 5:** Maximum Grid Current ( $I_G$ )

$$I_G = C_p \times D_f \times I_g$$

$$= 1 \times 1 \times 30618 = 30618A$$

**Step 6:** Earth Potential rise

$$= R_g \times I_G$$

$$= 0.268 \times 30618 = 8200V$$

**Step 7:** Estimated mesh and step voltage

Estimated mesh voltage

$$E_{\text{mesh}} = \frac{\rho \cdot K_m \cdot K_i \cdot I_G}{L}$$

$$K_i = 0.644 + (0.148 \times n)$$

$$n = n_a \times n_b \times n_c \times n_d$$

$$= 13.33 \times 1.02 \times 1 \times 1 = 13.73$$

$$K_i = 0.644 + (0.148 \times 13.73)$$

$$K_i = 2.676$$

$$K_m = \frac{1}{2\pi} \left[ \ln \left( \frac{D^2}{16hd} + \frac{(D+2h)^2}{8Dd} - \frac{h}{4d} \right) + \frac{K_{ii}}{Kh} \ln \frac{8}{\pi(2n-1)} \right]$$

$$Kh = \sqrt{1 + \frac{h}{ho}} = 1.2649, K_{ii} = 1, n = 13.73, D = 5m, d = .032m, h = 0.6m$$

$$\text{Thus, } K_m = 0.409607$$

$$\text{Now, } E_{\text{mesh}} = (40 \times 0.409607 \times 2.676 \times 30618) / (2320)$$

$$= 578 \text{ V (Which is less than 676.22 V, tolerable mesh voltage)}$$

Estimated step voltage

$$E_{\text{step}} = \frac{\rho \cdot K_s \cdot K_i \cdot I_G}{L} \text{ V}$$

$$K_s = \frac{1}{\pi} \left[ \frac{1}{2h} + \frac{1}{D+h} + \frac{1}{D} (1 - 0.5^{n-2}) \right] = 0.385938$$

$$E_{\text{step}} = (40 \times 0.3859 \times 2.676 \times 30618) / (2320)$$

$$= 545V \text{ (Which is less than 2212.735 V, tolerable step voltage)}$$

**Estimated Touch Voltage is less than Tolerable Touch Voltage and Estimated Step Potential is less than Tolerable Step Potential, Thus design is safe.**

## Annexure-XII

**Sample Calculation for the Design of Earthing Mat for TSS, SP & SSP of 2X25kV System**

**(Note:** This calculations is for example with assumed values, actual site values are to be taken for the actual calculations)

Data assumed for calculations for TSS:

a.	Resistivity of earth (Soil) in ( $\rho$ )	40 $\Omega$ -m
b.	Incoming Voltage	132kV
c.	Fault Level at incoming side (i.e. 132kV side)	7000 MVA
d.	Fault Current on primary side, $I_g$	$(7000)/(\sqrt{3} \times 132) = 30618A$
e.	Grid Dimensions	100m X 50m, Area = 5000m <sup>2</sup>
f.	Resistivity of surface material (crushed rock), $\rho_s$	3000 $\Omega$ -m
g.	Thickness of the crushed rock surface layer, $h_s$	0.1 m
h.	Depth of Earth mat, h	0.6 m
i.	Reference depth of grid, $h_o$	1.0m

Data assumed for calculations for SP & SSP:

a.	Resistivity of earth (Soil) in ( $\rho$ )	40 $\Omega$ -m
b.	Fault Current to be taken	12000A
c.	Grid Dimensions	50m X 30m, Area = 1500m <sup>2</sup>
d.	Resistivity of surface material (crushed rock), $\rho_s$	3000 $\Omega$ -m
e.	Thickness of the crushed rock surface layer, $h_s$	0.1 m
f.	Depth of Earth mat, h	0.6 m
g.	Reference depth of grid, $h_o$	1.0m

Standard Values to be taken:

a.	Duration of Fault current, t	<ul style="list-style-type: none"> <li>To be taken as 01 second for the calculation of grid conductor size on the basis of HV side fault current.</li> <li>To be taken as 03 second for the calculation of grid conductor size on the basis of LV side fault current.</li> </ul>
		0.5 second for determining the Tolerable touch and step potential
b.	Resistance of the Main Earthing Mat	0.5 $\Omega$ (maximum) for TSS 2.0 $\Omega$ (maximum) for SP & SSP

**Step 1 :** Diameter of the grid MS rod size calculation (d):

- (i) On the basis of HV side fault current i.e. 30618A for 01 second, (by assuming Fault MVA 7000MVA at primary side)

$$A = \frac{I\sqrt{t}}{80} = (30618 \times \sqrt{1}) / 80 = 382.72 \text{ mm}^2$$

By taking 100% margin factor due to corrosion, required area = 2 x 382.72 = 765.44 mm<sup>2</sup>  
So, required conductor dia=  $\sqrt{(765.44/3.14)} \times 2 = 31.22\text{mm}$

- (ii) On the basis of LV side fault current i.e. 12kA for 3 seconds,

Diameter of the grid MS rod size calculation (d):

$$A = \frac{I\sqrt{t}}{80} = (12000 \times \sqrt{3})/80 = 259.8 \text{ mm}^2$$

By taking 100% margin factor due to corrosion, required area = 2 x 259.8 = 519.6 mm<sup>2</sup>

So, required conductor Dia=  $\sqrt{(903.68/3.14) \times 2} = 25.73\text{mm}$

Higher between (i) & (ii) above is 31.22 mm. Now, considering the Para 7.1.2 of the specification, 32mm Diameter grid conductor is to be used at the TSS. Considering the uniformity in the size of the buried grid conductor, at the SP & SSP of 2X25kV system also 32mm Diameter grid conductor is to be used.

A Sample calculation for the TSS is already given at Annexure-XII. Therefore, for the SP & SSP the calculation is mentioned below:

Sample calculation for SP & SSP of 2X25kV is given as below:

### **Step 2:** Tolerable Step & Touch Potential

$$E_{touch} = (1000 + 1.5C_s\rho_s) \frac{0.116}{\sqrt{t_s}}$$

$$\text{Where, } C_s = 1 - \frac{0.09 \times \left(1 - \frac{\rho}{\rho_s}\right)}{2 \times h_s + 0.09} = 0.694$$

$$E_{touch} = \{(1000 + 1.5 \times 0.694 \times 3000)\} \times \{(0.116) / (\sqrt{0.5})\}$$

$$= 676.220\text{V}$$

$$E_{step} = (1000 + 6C_s\rho_s) \frac{0.116}{\sqrt{t_s}}$$

$$E_{step} = \{(1000 + 6 \times 0.694 \times 3000)\} \times \{(0.116) / (\sqrt{0.5})\}$$

$$= 2212.735\text{V}$$

### **Step 3:** Design of Earthing Grid

Grid layout = 50m X 30m

Assumed spacing between earth grid conductors (D) = 5m

So, No. of Vertical rods in earth mat  $N_x = (50/5) = 10$  and No. of Horizontal rods in earth mat  $N_y = (30/5) = 6$

Total length of earthing system conductor (L)

=  $L_c + 1.15 L_r$  for grids with earth electrodes along the perimeter

Now,  $L_c = 50 \times 6 + 30 \times 10 = 600\text{m}$

Assuming no. of earth electrodes = 10

So,  $L_r = 4 \times 10 = 40\text{m}$  (4m length of earth electrode)

Total length of Earth conductor =  $600 + 1.15 \times 40 = 646\text{m}$

**Step 4:** Grid resistance

$$R_g = 0.443 \frac{\rho}{\sqrt{A}} + \frac{\rho}{L}$$

$$R_g = \{0.443 \times (40/\sqrt{1500})\} + (40/637)$$

$$= 0.52\Omega$$

**Step 5:** Maximum Grid Current ( $I_G$ )

$$I_G = C_p \times D_f \times I_g$$

$$= 1 \times 1 \times 12000 = 12000\text{A}$$

**Step 6:** Earth Potential rise

$$= R_g \times I_G$$

$$= 0.52 \times 12000 = 6240 \text{ V}$$

**Step 7:** Estimated mesh and step voltage

Estimated mesh voltage

$$E_{\text{mesh}} = \frac{\rho \cdot K_m \cdot K_i \cdot I_G}{L}$$

$$K_i = 0.644 + (0.148 \times n)$$

$$n = n_a \times n_b \times n_c \times n_d$$

$$= 7.5 \times 1.01 \times 1 \times 1 = 7.6$$

$$K_i = 0.644 + (0.148 \times 7.6) = 1.77$$

$$K_m = \frac{1}{2\pi} \left[ \ln \left( \frac{D^2}{16hd} + \frac{(D+2h)^2}{8Dd} - \frac{h}{4d} \right) + \frac{K_{ii}}{Kh} \ln \frac{8}{\pi(2n-1)} \right]$$

$$K_h = \sqrt{1 + \frac{h}{D}} = 1.2649, \quad K_{ii} = 1, \quad n = 7.6, \quad D = 5\text{m}, \quad d = .032\text{m}, \quad h = 0.6\text{m}$$

Thus,  $K_m = 0.49$

$$\text{Now, } E_{\text{mesh}} = (40 \times 0.49 \times 1.77 \times 12000)/(646)$$

$$= 644\text{V (Which is less than 676.22 V, tolerable mesh voltage)}$$

Estimated step voltage

$$E_{\text{step}} = \frac{\rho \cdot K_s \cdot K_i \cdot I_G}{L} \text{ V}$$

$$K_s = \frac{1}{\pi} \left[ \frac{1}{2h} + \frac{1}{D+h} + \frac{1}{D} (1 - 0.5^{n-2}) \right] = 0.38$$

$$\text{Now } E_{\text{step}} = (40 \times 0.38 \times 1.77 \times 12000)/(646)$$

$$= 500\text{V (Which is less than 2212.735 V, tolerable step voltage)}$$

**Estimated Touch Voltage is less than Tolerable Touch Voltage and Estimated Step Potential is less than Tolerable Step Potential, Thus design is safe.**

INDUSTRY PVT. LTD. VADODARA  
(ID- 35315)

E-76, GIDC Manjusar, Taluka Savli  
Vadodara, Gujarat - 391770, India  
Current status since - 13/02/2020

Regd Add. : E-76, GIDC Industrial  
Area, Manjusar, Vadodara, Gujarat -  
390001, India

M/s JAINCO TRANSMISSION  
LIMITED KOLKATA  
(ID- 1028544)

JAINCO  
Jalan Complex, Gate No-1,  
Lane No-7, Jangalpur, Bombay  
Road (NH-6) Howrah, West Bengal -  
711411, India

Regd Add. : Dhanshree Tower, 70,  
Diamond Harbour Road, Room No.  
3B & 3C, 3rd Floor Kolkata, West  
Bengal - 700023, India

Current status since - 21/01/2022

M/s JHR Overseas  
(ID- 1051914)

JHR  
Back Side New Era Machines, New  
Model Town, Sahnewal  
Ludhiana, Punjab - 141120, India

Regd Add. : Back Side New Era  
Machines, New Model Town,  
Sahnewal Ludhiana, Punjab -  
141120, India

Current status since - before  
01/01/2020

M/s MOSDORFER INDIA PVT. LTD.-  
MUMBAI  
(ID- 125222)

MIPL  
Plot No. 196/1 and 2 Village -  
Gonde Dhumla MIDC Gonde, Taluka  
- Igatpuri Nashik, Maharashtra -  
422403, India

Regd Add. : -403C, Wing B1,  
Marathon Innova, Opp. Peninsula  
Corporate Park, Lower Parel,  
Mumbai Mumbai, Maharashtra -  
400013, India

Current status since - before  
01/01/2020

M/s NSS STORES SUPPLY AGENCY  
PRIVATE LIMITED-HOWRAH  
(ID- 35966)

NSSA  
P-280, Banaras Road, Belgachia,  
P.O. Netajigarh Howrah, West  
Bengal - 711108, India

Regd Add. : P-280, Banaras Road,  
Belgachia, PO-Netajigarh undefined  
Howrah, West Bengal - 711108, India

Current status since - before  
01/01/2020

M/s SHRI ASHUTOSH  
ENGINEERING INDUSTRIES UNIT II-  
RAIPUR  
(ID- 97354)

SAEI/II  
(Unit-II), Plot No. 156/1, 157/1, 160  
& 161, New Patharidih, Urla  
Raipur, Chhattisgarh - 492001, India

Regd Add. : Plot No. 156/1,  
157/1, 160 and 161, PH- 101, New  
Patharidih, Urla, Raipur  
Raipur, Chhattisgarh - 492001, India

Current status since - before  
01/01/2020

Sub Item ID: 4200025048,  
Spec: 11 SPC Core Fittings (EEL) with A C Slip, No. 1, 100-001 11 (4 354)  
may 2008/Drw: 111 DHE P 2021, STR: CORE STR 20, ( Total Vendor  
Count: 16 ) Lorkesh

Earth Electrode (7021)

Appr. and Vendor ( Vendor Count: 16 )

M/s AUMNI TRANSMISSION  
INDUSTRY PVT. LTD.-VADODARA  
(ID- 35315)

AUMNI  
E-76, GIDC Manjusar, Taluka Savli  
Vadodara, Gujarat - 391770, India  
Current status since - 13/02/2020

Regd Add. : E-76, GIDC Industrial

For buildings,  
manholes, CIS panels,  
transformers, poles, water  
coolers, lift/exhaustion  
control panels, ①  
DC sets and other L.T.  
equipment & earthings.

Area, Manjusr Vadodra Gujarat  
390001, India

2

M/s KHATRI STEEL INDUSTRIES  
CO., KOLKATA  
(ID- 17706)

CEC

Plot - Chhatrabhag Bhawan Road  
Kolkata West Bengal - 700011 India

**Regd Add.** : 216 A 12 ROSE ROAD  
FLAT 2A KOLKATA, West Bengal  
700017, India

**Current status since** - before  
01/01/2020

3

M/s Chhatrabhag Co. Construction  
Pvt Ltd  
(ID- 1051029)

CCC

142/143/2 Madhusudan P.S.  
Chowdhury Lane Howrah West  
Bengal - 711101 India

**Regd Add.** : 216 A J.C. Bose Road  
Flat-2A Kolkata West Bengal  
700017, India

**Current status since** - before  
01/01/2020

4

M/s DYNAMIC STEEL FORGE  
RAJKOT  
(ID- 91949)

DSF

Plot No G-2521, Near Bhumi  
Cement Almighty Gate GIDC  
Metoda Taluka-Lodhika, Rajkot  
Rajkot, Gujarat - 360021, India

**Regd Add.** : PLOT NO G-2521,  
ALMIGHTY GATE NEAR BHUMI  
CEMENT GIDC METODA RAJKOT  
RAJKOT, Gujarat - 360021, India

**Current status since** - 26/11/2020

5

M/s JAINCO TRANSMISSION  
LIMITED-KOLKATA  
(ID- 1028544)

JAINCO

Jalan Complex, Gate No-7,  
Lane No-7, Jangalpur, Bombay  
Road (NH-6) Howrah, West Bengal -  
711411, India

**Regd Add.** : Dhanshree Tower, 70,  
Diamond Harbour Road, Room No.  
3B & 3C, 3rd Floor Kolkata, West  
Bengal - 700023, India

**Current status since** - before  
01/01/2020

6

M/s JHR Overseas  
(ID- 1051914)

JHR/IL

Village- Chhandra, chd Road  
Ludhiana, Punjab - 141113, India

**Regd Add.** : Back Side New Era  
Machines, New Model Town,  
Sahnewal Ludhiana, Punjab -  
141120, India

**Current status since** - before  
01/01/2020

JHR

Back Side New Era Machines, New  
Model Town, Sahnewal  
Ludhiana, Punjab - 141120, India

**Current status since** - before  
01/01/2020

7

M/s KHATRI CASTINGS PRIVATE  
LIMITED MUMBAI  
(ID- 3601)

KHATRI

At Valvada, Near Karambele Railway  
Station, NH-8, Taluka Umargao,  
Opp. Maruti Depot Valsad Gujarat -  
396001, India

**Regd Add.** : 144 Naman Plaza  
Shoppers Stop Bldg SV Road  
Kandivali (West), Mumbai  
MUMBAI, Maharashtra - 400067,  
India

**Current status since** - before  
01/01/2020

8

M/s KSE ELECTRICALS PVT LTD  
KOLKATA  
(ID- 6285)

KSE

Jalan Industrial Complex 3rd Main  
Road, 4th Left Lane, NH-6, P.O.-  
Begri Howrah, West Bengal -  
711411, India

**Regd Add.** : hatterjee International



Centre, 33A, Chowringhee Road, 7th Floor Kolkata, West Bengal - 700071, India

**Current status since** - before 01/01/2020

M/s KUMAR FASTENERS MATHURA (ID- 3905)

**KF Mathura**  
S-15, Building Material Complex Site-A, Industrial Area Mathura, Uttar Pradesh - 281004, India

**Regd Add. :** S-15, Building Material Complex, Industrial Area, Site-A, Mathura, Uttar Pradesh - 281004, India

**Current status since** - before 01/01/2020

M/s MOSDORFER INDIA PVT. LTD - MUMBAI (ID- 125222)

**MIPL**  
Plot No. 196/1 and 2 Village - Gonde Dhumla MIDC Gonde, Taluka - Igatpuri Nashik, Maharashtra - 422403, India

**Regd Add. :** 403C, Wing B1, Marathon Innova, Opp. Peninsula Corporate Park, Lower Parel, Mumbai Mumbai, Maharashtra - 400013, India

**Current status since** - before 01/01/2020

M/s NIKE ENERGY MANUFACTURING PRIVATE LIMITED-VARANASI (ID- 23941)

**NIKE**  
Plot No. 279/2 Ganeshpur Tarna Varanasi, Uttar Pradesh - 221003, India

**Current status since** - 18/11/2021

**Regd Add. :** 279/2 GANESHPUR, TARNA SHIVPUR, VARANASI, Uttar Pradesh - 221003, India

M/s NSS STORES SUPPLY AGENCY PRIVATE LIMITED-HOWRAH (ID- 35966)

**NSSA**  
P-280, Banaras Road, Belgachia, P.O. Netajigarh Howrah, West Bengal - 711108, India

**Regd Add. :** P-280, Banaras Road, Belgachia, P.O.-Netajigarh undefined Howrah, West Bengal - 711108, India

**Current status since** - before 01/01/2020

M/s ROYAL BALAJI ENGINEERING PVT LTD-KOLKATA (ID- 23501)

**Royal**  
NH-6, Bombay Road, Dhulagari, Sankrail Howrah, West Bengal - 711302, India

**Regd Add. :** 153/2B, Sumukh Apartment, APC Road KOLKATA, West Bengal - 700006, India

**Current status since** - before 01/01/2020

M/s SHRI ASHUTOSH ENGINEERING INDUSTRIES UNIT II- RAIPUR (ID- 97354)

**SAEI/II**  
(Unit-II), Plot No. 156/1, 157/1, 160 & 161, New Patharidih, Urla Raipur, Chhattisgarh - 492001, India

**Regd Add. :** Plot No. 156/1, 157/1, 160 and 161, PH- 101, New Patharidih, Urla, Raipur Raipur, Chhattisgarh - 492001, India

**Current status since** - before 01/01/2020

M/s TAG CORPORATION-CHENNAI (ID- 1033964)

**TAG**  
Shed No. 4 & 5, SIDCO Industrial Estate, Thirumudivakkam Chennai, Tamil Nadu - 600044, India

**Regd Add. :** No: 91, Thiruneermalai

4

Road, Chromepet undefined  
Chennai,Tamil Nadu - 600044, India **Current status since** - 01/02/2022

M/s TRANSMISSION LINE **TLP-H**  
PRODUCTS-KOLKATA  
(ID- 5692) NH-6, Sankrail Industrial Park P.O.  
Dhulagarh, PS- Sankrail  
Howrah,West Bengal - 711302, India

**Regd Add.** : 102 Central Plaza 2/6  
Sarat Bose Road Kolkata,West Bengal - 700020, India **Current status since** - 23/09/2020

**Sub** **Item** **ID:** 4200025049, **Earth** **Electrode**  
**Spec:** TL-PC\_OHE\_Fittings\_0130 with A.C\_Slip\_No.1, ETI-OHE-13 (4-B4)  
may 2018, **Drw:** ETI PSI 222, **STR:** CORE-STR-20, ( Total Vendor Count:  
8)

**Appointed from:** ( Vendor Count: 8 )

M/s AUMNI TRANSMISSION **AUMNI**  
INDUSTRY PVT. LTD.-VADODARA E-76, GIDC Manjusar, Taluka Savli  
(ID- 35315) Vadodara,Gujarat - 391770, India  
**Current status since** - 18/11/2021

**Regd Add.** : E-76, GIDC Industrial  
Area, Manjusar Vadodara,Gujarat -  
390001, India

M/s Chatterjee & Co. (Construction) **CCC**  
Pvt. Ltd. 142/143/2, Madhusudan Paul  
(ID- 1051029) Chowdhury Lane Howrah,West  
Bengal - 711101, India

**Regd Add.** : 216, A.J.C. Bose Road,  
Flat-2A Kolkata,West Bengal - 700017, India **Current status since** - before  
01/01/2020

M/s JAINCO TRANSMISSION **JAINCO**  
LIMITED-KOLKATA Jalan Complex, Gate No.-1,  
(ID- 1028544) LaneNo.-7, Jangalpur, Bombay  
Road(NH-6) Howrah,West Bengal -  
711411, India

**Regd Add.** : Dhanshree Tower, 70,  
Diamond Harbour Road, Room No.  
3B & 3C, 3rd Floor Kolkata,West Bengal - 700023, India **Current status since** - before  
01/01/2020

M/s KUMAR FASTENERS- **KF Mathura**  
MATHURA S-15, Building Material Complex  
(ID- 3905) Site-A, Industrial Area  
Mathura,Uttar Pradesh - 281004,  
India

**Regd Add.** : S-15, Building  
Material Complex, Industrial Area,  
Site-A, Mathura,Uttar Pradesh - 281004, India **Current status since** - before  
01/01/2020

M/s NSS STORES SUPPLY AGENCY **NSSA**  
PRIVATE LIMITED-HOWRAH P-280, Banaras Road, Belgachia,  
(ID- 35966) P.O. Netajigarh Howrah,West  
Bengal - 711108, India

**Regd Add.** : P-280, Banaras Road,  
Belgachia,PO-Netajigarh undefined  
Howrah,West Bengal - 711108, India **Current status since** - before  
01/01/2020

M/s ROYAL BALAJI ENGINEERING **Royal**  
PVT LTD-KOLKATA NH-6, Bombay Road, Dhulagarh,  
(ID- 23501) Sankrail Howrah,West Bengal -  
711302, India

for F.S.S.  
Substation  
0.250 kVA &  
mbap

5

**Regd Add. :** 153/2B, Sumukh Apartment, APC Road, KOLKATA, West Bengal - 700006, India  
**Current status since** - before 01/01/2020

M/s. TARI ASHUTOSH SAEIJI  
 ENGINEERING INDUSTRIES UNIT II (Unit-II), Plot No. 156/1, 157/1, 160/1 & 161, New Pathardih, Urla Raipur, Chhattisgarh - 492001, India  
 (ID- 97354)

**Regd Add. :** Plot No. 156/1, 157/1, 160 and 161, PII- 101, New Pathardih, Urla, Raipur Raipur, Chhattisgarh - 492001, India  
**Current status since** - before 01/01/2020

M/s. TRANSMISSION LINE PRODUCTS-KOLKATA (ID- 5692) **TLP-H**  
 NH-6, Sankrail Industrial Park P.O. Dhulagarh, PS- Sankrail Howrah, West Bengal - 711302, India

**Regd Add. :** 102 Central Plaza 2/6 Sarat Bose Road Kolkata, West Bengal - 700020, India  
**Current status since** - 23/09/2020

**Sub Item ID:** 4200025051, Strain Clamp suitable for ACSR Zebra Conductor (with Minimum Ultimate Tensile Strength of 7000 kg and Slip strength of 4000 kg) **Spec:** TLP-CHE\_Fittings\_0130\_with A.C\_Slip\_No.1, ITI-CHE-13 (4-84) may 2018, **STR:** CORE-STR-20, ( Total Vendor Count: 1 )

Approved Vendor ( Vendor Count: 1 )

M/s. TRANSMISSION LINE PRODUCTS-KOLKATA (ID- 5692) **TLP-H**  
 NH-6, Sankrail Industrial Park P.O. Dhulagarh, PS- Sankrail Howrah, West Bengal - 711302, India

**Regd Add. :** 102 Central Plaza 2/6 Sarat Bose Road Kolkata, West Bengal - 700020, India  
**Current status since** - 23/09/2020

**Sub Item ID:** 4200025052, Arcing Rings **Spec:** TLP-CHE\_Fittings\_0130\_with A.C\_Slip\_No.1, ITI-CHE-13 (4-84) may 2018, **STR:** CORE-STR-20, ( Total Vendor Count: 1 )

Approved Vendor ( Vendor Count: 1 )

M/s. TRANSMISSION LINE PRODUCTS-KOLKATA (ID- 5692) **TLP-H**  
 NH-6, Sankrail Industrial Park P.O. Dhulagarh, PS- Sankrail Howrah, West Bengal - 711302, India



**Regd Add. :** 102 Central Plaza 2/6 Sarat Bose Road Kolkata, West Bengal - 700020, India  
**Current status since** - 23/09/2020

**Sub Item ID:** 4200025053, Socket Eye (20 mm) **Spec:** TLP-CHE\_Fittings\_0130\_with A.C\_Slip\_No.1, ITI-CHE-13 (4-84) may 2018, **STR:** CORE-STR-20, ( Total Vendor Count: 1 )

Approved Vendor ( Vendor Count: 1 )

M/s. TRANSMISSION LINE PRODUCTS-KOLKATA (ID- 5692) **TLP-H**  
 NH-6, Sankrail Industrial Park P.O. Dhulagarh, PS- Sankrail Howrah, West Bengal - 711302, India


## Annexure 'D'

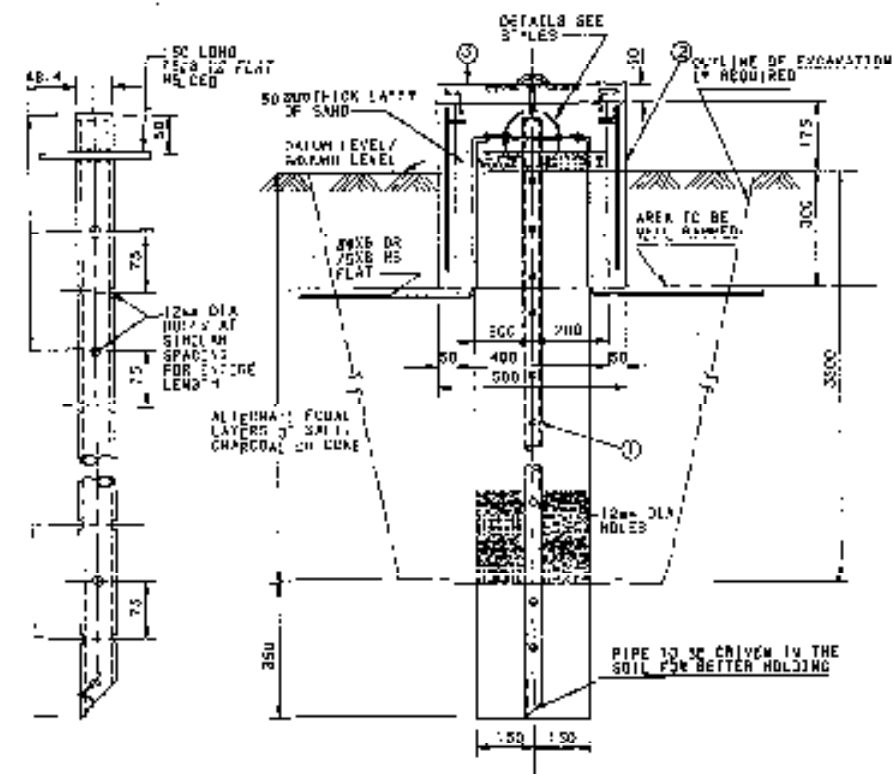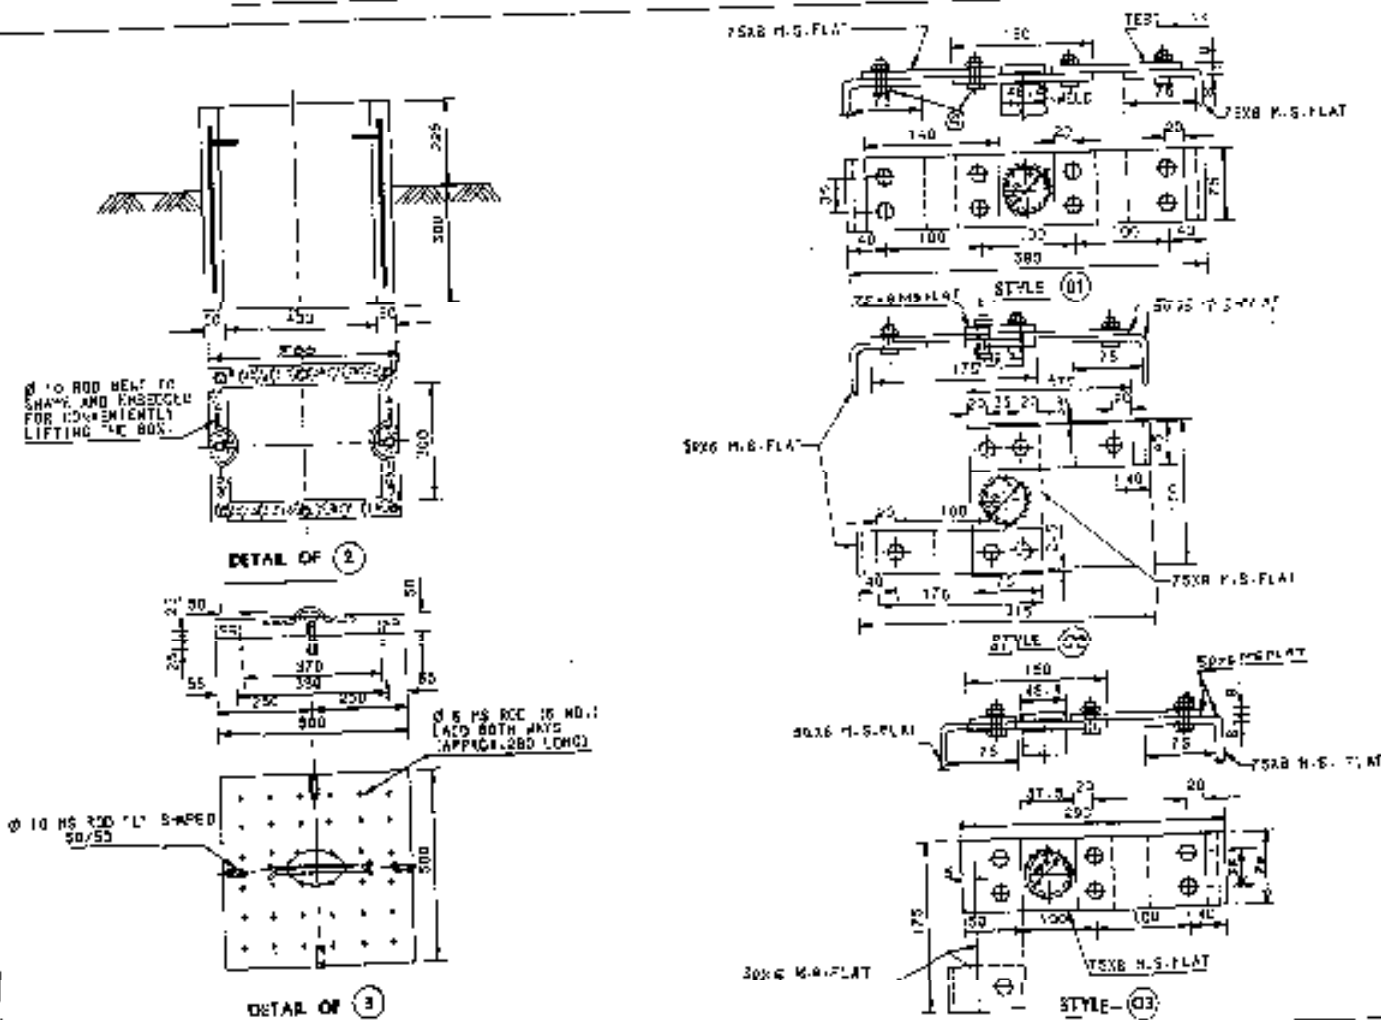

DETAIL OF ①  
LOCATION DETAILS  
ARTH ELECTRODE

SECTIONAL ELEVATION

REF.	DESCRIPTION	PART NO.	MATERIAL	SPECIFICATION	APPROX. WEIGHT (KG)	NUMBER OF ITEMS REQUIRED
1	EARTH PIPE	-	STEEL	IS:1239	-	1
2	EARTH BOX	-	REINFORCED CONCRETE	IS:1455 & IS:1456	-	1
3	LID FOR EARTH BOX	-	REINFORCED CONCRETE	IS:1455 & IS:1456	-	1
4	80/100/150/200/250/300/350/400/450/500/550/600/650/700/750/800/850/900/950/1000/1050/1100/1150/1200/1250/1300/1350/1400/1450/1500/1550/1600/1650/1700/1750/1800/1850/1900/1950/2000/2050/2100/2150/2200/2250/2300/2350/2400/2450/2500/2550/2600/2650/2700/2750/2800/2850/2900/2950/3000/3050/3100/3150/3200/3250/3300/3350/3400/3450/3500/3550/3600/3650/3700/3750/3800/3850/3900/3950/4000/4050/4100/4150/4200/4250/4300/4350/4400/4450/4500/4550/4600/4650/4700/4750/4800/4850/4900/4950/5000/5050/5100/5150/5200/5250/5300/5350/5400/5450/5500/5550/5600/5650/5700/5750/5800/5850/5900/5950/6000/6050/6100/6150/6200/6250/6300/6350/6400/6450/6500/6550/6600/6650/6700/6750/6800/6850/6900/6950/7000/7050/7100/7150/7200/7250/7300/7350/7400/7450/7500/7550/7600/7650/7700/7750/7800/7850/7900/7950/8000/8050/8100/8150/8200/8250/8300/8350/8400/8450/8500/8550/8600/8650/8700/8750/8800/8850/8900/8950/9000/9050/9100/9150/9200/9250/9300/9350/9400/9450/9500/9550/9600/9650/9700/9750/9800/9850/9900/9950/10000/10050/10100/10150/10200/10250/10300/10350/10400/10450/10500/10550/10600/10650/10700/10750/10800/10850/10900/10950/11000/11050/11100/11150/11200/11250/11300/11350/11400/11450/11500/11550/11600/11650/11700/11750/11800/11850/11900/11950/12000/12050/12100/12150/12200/12250/12300/12350/12400/12450/12500/12550/12600/12650/12700/12750/12800/12850/12900/12950/13000/13050/13100/13150/13200/13250/13300/13350/13400/13450/13500/13550/13600/13650/13700/13750/13800/13850/13900/13950/14000/14050/14100/14150/14200/14250/14300/14350/14400/14450/14500/14550/14600/14650/14700/14750/14800/14850/14900/14950/15000/15050/15100/15150/15200/15250/15300/15350/15400/15450/15500/15550/15600/15650/15700/15750/15800/15850/15900/15950/16000/16050/16100/16150/16200/16250/16300/16350/16400/16450/16500/16550/16600/16650/16700/16750/16800/16850/16900/16950/17000/17050/17100/17150/17200/17250/17300/17350/17400/17450/17500/17550/17600/17650/17700/17750/17800/17850/17900/17950/18000/18050/18100/18150/18200/18250/18300/18350/18400/18450/18500/18550/18600/18650/18700/18750/18800/18850/18900/18950/19000/19050/19100/19150/19200/19250/19300/19350/19400/19450/19500/19550/19600/19650/19700/19750/19800/19850/19900/19950/20000/20050/20100/20150/20200/20250/20300/20350/20400/20450/20500/20550/20600/20650/20700/20750/20800/20850/20900/20950/21000/21050/21100/21150/21200/21250/21300/21350/21400/21450/21500/21550/21600/21650/21700/21750/21800/21850/21900/21950/22000/22050/22100/22150/22200/22250/22300/22350/22400/22450/22500/22550/22600/22650/22700/22750/22800/22850/22900/22950/23000/23050/23100/23150/23200/23250/23300/23350/23400/23450/23500/23550/23600/23650/23700/23750/23800/23850/23900/23950/24000/24050/24100/24150/24200/24250/24300/24350/24400/24450/24500/24550/24600/24650/24700/24750/24800/24850/24900/24950/25000/25050/25100/25150/25200/25250/25300/25350/25400/25450/25500/25550/25600/25650/25700/25750/25800/25850/25900/25950/26000/26050/26100/26150/26200/26250/26300/26350/26400/26450/26500/26550/26600/26650/26700/26750/26800/26850/26900/26950/27000/27050/27100/27150/27200/27250/27300/27350/27400/27450/27500/27550/27600/27650/27700/27750/27800/27850/27900/27950/28000/28050/28100/28150/28200/28250/28300/28350/28400/28450/28500/28550/28600/28650/28700/28750/28800/28850/28900/28950/29000/29050/29100/29150/29200/29250/29300/29350/29400/29450/29500/29550/29600/29650/29700/29750/29800/29850/29900/29950/30000/30050/30100/30150/30200/30250/30300/30350/30400/30450/30500/30550/30600/30650/30700/30750/30800/30850/30900/30950/31000/31050/31100/31150/31200/31250/31300/31350/31400/31450/31500/31550/31600/31650/31700/31750/31800/31850/31900/31950/32000/32050/32100/32150/32200/32250/32300/32350/32400/32450/32500/32550/32600/32650/32700/32750/32800/32850/32900/32950/33000/33050/33100/33150/33200/33250/33300/33350/33400/33450/33500/33550/33600/33650/33700/33750/33800/33850/33900/33950/34000/34050/34100/34150/34200/34250/34300/34350/34400/34450/34500/34550/34600/34650/34700/34750/34800/34850/34900/34950/35000/35050/35100/35150/35200/35250/35300/35350/35400/35450/35500/35550/35600/35650/35700/35750/35800/35850/35900/35950/36000/36050/36100/36150/36200/36250/36300/36350/36400/36450/36500/36550/36600/36650/36700/36750/36800/36850/36900/36950/37000/37050/37100/37150/37200/37250/37300/37350/37400/37450/37500/37550/37600/37650/37700/37750/37800/37850/37900/37950/38000/38050/38100/38150/38200/38250/38300/38350/38400/38450/38500/38550/38600/38650/38700/38750/38800/38850/38900/38950/39000/39050/39100/39150/39200/39250/39300/39350/39400/39450/39500/39550/39600/39650/39700/39750/39800/39850/39900/39950/40000/40050/40100/40150/40200/40250/40300/40350/40400/40450/40500/40550/40600/40650/40700/40750/40800/40850/40900/40950/41000/41050/41100/41150/41200/41250/41300/41350/41400/41450/41500/41550/41600/41650/41700/41750/41800/41850/41900/41950/42000/42050/42100/42150/42200/42250/42300/42350/42400/42450/42500/42550/42600/42650/42700/42750/42800/42850/42900/42950/43000/43050/43100/43150/43200/43250/43300/43350/43400/43450/43500/43550/43600/43650/43700/43750/43800/43850/43900/43950/44000/44050/44100/44150/44200/44250/44300/44350/44400/44450/44500/44550/44600/44650/44700/44750/44800/44850/44900/44950/45000/45050/45100/45150/45200/45250/45300/45350/45400/45450/45500/45550/45600/45650/45700/45750/45800/45850/45900/45950/46000/46050/46100/46150/46200/46250/46300/46350/46400/46450/46500/46550/46600/46650/46700/46750/46800/46850/46900/46950/47000/47050/47100/47150/47200/47250/47300/47350/47400/47450/47500/47550/47600/47650/47700/47750/47800/47850/47900/47950/48000/48050/48100/48150/48200/48250/48300/48350/48400/48450/48500/48550/48600/48650/48700/48750/48800/48850/48900/48950/49000/49050/49100/49150/49200/49250/49300/49350/49400/49450/49500/49550/49600/49650/49700/49750/49800/49850/49900/49950/50000/50050/50100/50150/50200/50250/50300/50350/50400/50450/50500/50550/50600/50650/50700/50750/50800/50850/50900/50950/51000/51050/51100/51150/51200/51250/51300/51350/51400/51450/51500/51550/51600/51650/51700/51750/51800/51850/51900/51950/52000/52050/52100/52150/52200/52250/52300/52350/52400/52450/52500/52550/52600/52650/52700/52750/52800/52850/52900/52950/53000/53050/53100/53150/53200/53250/53300/53350/53400/53450/53500/53550/53600/53650/53700/53750/53800/53850/53900/53950/54000/54050/54100/54150/54200/54250/54300/54350/54400/54450/54500/54550/54600/54650/54700/54750/54800/54850/54900/54950/55000/55050/55100/55150/55200/55250/55300/55350/55400/55450/55500/55550/55600/55650/55700/55750/55800/55850/55900/55950/56000/56050/56100/56150/56200/56250/56300/56350/56400/56450/56500/56550/56600/56650/56700/56750/56800/56850/56900/56950/57000/57050/57100/57150/57200/57250/57300/57350/57400/57450/57500/57550/57600/57650/57700/57750/57800/57850/57900/57950/58000/58050/58100/58150/58200/58250/58300/58350/58400/58450/58500/58550/58600/58650/58700/58750/58800/58850/58900/58950/59000/59050/59100/59150/59200/59250/59300/59350/59400/59450/59500/59550/59600/59650/59700/59750/59800/59850/59900/59950/60000/60050/60100/60150/60200/60250/60300/60350/60400/60450/60500/60550/60600/60650/60700/60750/60800/60850/60900/60950/61000/61050/61100/61150/61200/61250/61300/61350/61400/61450/61500/61550/61600/61650/61700/61750/61800/61850/61900/61950/62000/62050/62100/62150/62200/62250/62300/62350/62400/62450/62500/62550/62600/62650/62700/62750/62800/62850/62900/62950/63000/63050/63100/63150/63200/63250/63300/63350/63400/63450/63500/63550/63600/63650/63700/63750/63800/63850/63900/63950/64000/64050/64100/64150/64200/64250/64300/64350/64400/64450/64500/64550/64600/64650/64700/64750/64800/64850/64900/64950/65000/65050/65100/65150/65200/65250/65300/65350/65400/65450/65500/65550/65600/65650/65700/65750/65800/65850/65900/65950/66000/66050/66100/66150/66200/66250/66300/66350/66400/66450/66500/66550/66600/66650/66700/66750/66800/66850/66900/66950/67000/67050/67100/67150/67200/67250/67300/67350/67400/67450/67500/67550/67600/67650/67700/67750/67800/67850/67900/67950/68000/68050/68100/68150/68200/68250/68300/68350/68400/68450/68500/68550/68600/68650/68700/68750/68800/68850/68900/68950/69000/69050/69100/69150/69200/69250/69300/69350/69400/69450/69500/69550/69600/69650/69700/69750/69800/69850/69900/69950/70000/70050/70100/70150/70200/70250/70300/70350/70400/70450/70500/70550/70600/70650/70700/70750/70800/70850/70900/70950/71000/71050/71100/71150/71200/71250/71300/71350/71400/71450/71500/71550/71600/71650/71700/71750/71800/71850/71900/71950/72000/72050/72100/72150/72200/72250/72300/72350/72400/72450/72500/72550/72600/72650/72700/72750/72800/72850/72900/72950/73000/73050/73100/73150/73200/73250/73300/73350/73400/73450/73500/73550/73600/73650/73700/73750/73800/73850/73900/73950/74000/74050/74100/74150/74200/74250/74300/74350/74400/74450/74500/74550/74600/74650/74700/74750/74800/74850/74900/74950/75000/75050/75100/75150/75200/75250/75300/75350/75400/75450/75500/75550/75600/75650/75700/75750/75800/75850/75900/75950/76000/76050/76100/76150/76200/76250/76300/76350/76400/76450/76500/76550/76600/76650/76700/76750/76800/76850/76900/76950/77000/77050/77100/77150/77200/77250/77300/77350/77400/77450/77500/77550/77600/77650/77700/77750/77800/77850/77900/77950/78000/78050/78100/78150/78200/78250/78300/78350/78400/78450/78500/78550/78600/78650/78700/78750/78800/78850/78900/78950/79000/79050/79100/79150/79200/79250/79300/79350/79400/79450/79500/79550/79600/79650/79700/79750/79800/79850/79900/79950/80000/80050/80100/80150/80200/80250/80300/80350/80400/80450/80500/80550/80600/80650/80700/80750/80800/80850/80900/80950/81000/81050/81100/81150/81200/81250/81300/81350/81400/81450/81500/81550/81600/81650/81700/81750/81800/81850/81900/81950/82000/82050/82100/82150/82200/82250/82300/82350/82400/82450/82500/82550/82600/82650/82700/82750/82800/82850/82900/82950/83000/83050/83100/83150/83200/83250/83300/83350/83400/83450/83500/83550/83600/83650/83700/83750/83800/83850/83900/83950/84000/84050/84100/84150/84200/84250/84300/84350/84400/84450/84500/84550/84600/84650/84700/84750/84800/84850/84900/84950/85000/85050/85100/85150/85200/85250/85300/85350/85400/85450/85500/85550/85600/85650/85700/85750/85800/85850/85900/85950/86000/86050/86100/86150/86200/86250/86300/86350/86400/86450/86500/86550/86600/86650/86700/86750/86800/86850/86900/86950/87000/87050/87100/87150/87200/87250/87300/87350/87400/87450/87500/87550/87600/87650/87700/87750/87800/87850/87900/87950/88000/88050/88100/88150/88200/88250/88300/88350/88400/88450/88500/88550/88600/88650/88700/88750/88800/88850/88900/88950/89000/89050/89100/89150/89200/89250/89300/89350/89400/89450/89500/89550/89600/89650/89700/89750/89800/89850/89900/89950/90000/90050/90100/90150/90200/90250/90300/90350/90400/90450/90500/90550/90600/90650/90700/90750/90800/90850/90900/90950/91000/91050/91100/91150/91200/91250/91300/91350/91400/91450/91500/91550/91600/91650/91700/91750/91800/91850/91900/91950/92000/92050/92100/92150/92200/92250/92300/92350/92400/92450/92500/92550/92600/92650/92700/92750/92800/92850/92900/92950/93000/93050/93100/93150/93200/93250/93300/93350/93400/93450/93500/93550/93600/93650/93700/93750/93800/93850/93900/93950/94000/94050/94100/94150/94200/94250/94300/94350/94400/94450/94500/94550/94600/94650/94700/94750/94800/94850/94900/94950/95000/95050/95100/95150/95200/95250/95300/95350/95400/95450/95500/95550/95600/95650/95700/95750/95800/95850/95900/95950/96000/96050/96100/96150/96200/96250/96300/96350/96400/96450/96500/96550/96600/96650/96700/96750/96800/96850/96900/96950/97000/97050/97100/97150/97200/97250/97300/97350/97400/97450/97500/97550/97600/97650/97700/97750/97800/97850/97900/97950/98000/98050/98100/98150/98200/98250/98300/98350/98400/98450/98500/98550/98600/98650/98700/98750/98800/98850/98900/98950/99000/99050/99100/99150/99200/99250/99300/99350/99400/99450/99500/99550/99600/99650/99700/99750/99800/99850/99900/99950/100000					

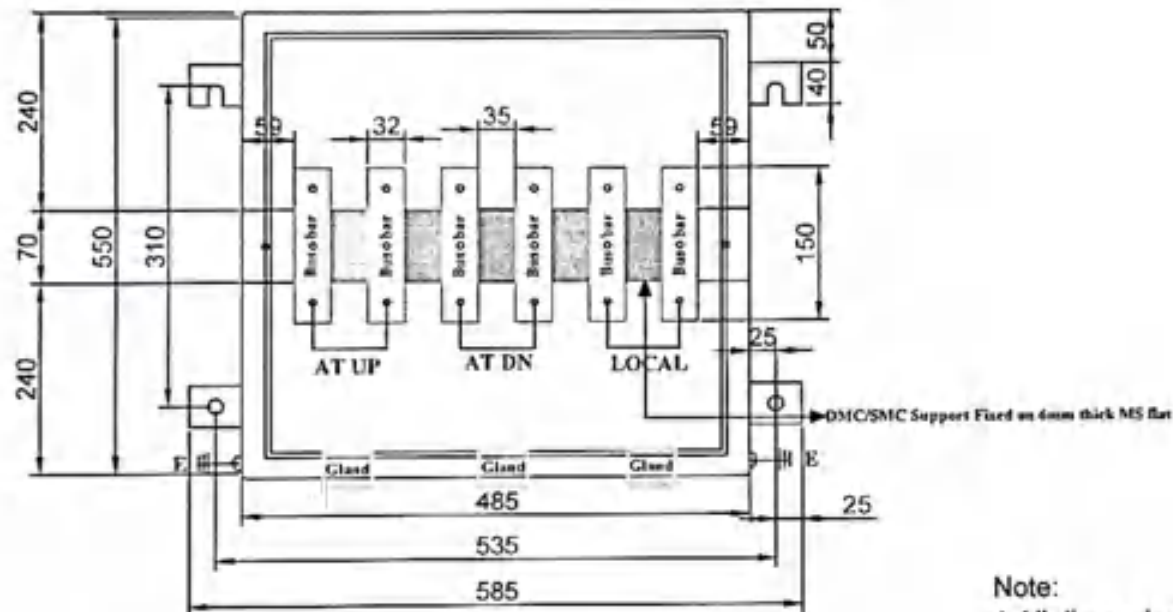**CLS JUNCTION BOX to SUIT 10kVA/25kVA CLS PANELS****CLS JUNCTION BOX (Indoor type)**

Note:

1.All dimensions are in mm

2.Painting:Siemens Grey RAL7032 Powder Coated

NOTES		
1.	Busbar:	150x32x6mm Bimetallic Tinned Copper Busbar
2.	Size of the Box:	485x550x225mm
3.	Sheet Thickness	Box-14SWG; Cover-16SWG
4.	Box & Cover to be connected for Equipotential Bonding	
5.	Suitable Earthing provision for the CLS junction box	
6.	Suitable FRP Insulating material base for mounting Busbar	



SOUTH CENTRAL RAILWAY

HEADQUARTERS

Drawn by (JE/P)

K. S. Reddy

-Ch S Reddy

SSE/Tech.

K. S. Reddy 11/3/22

CEGE

11/3

DRG. No. : 01/2022-4/2/AT

Rev. 0



