

SOUTH CENTRAL RAILWAY
ELECTRICAL DEPARTMENT
NANDED DIVISION

Tender No. NED-E-07-2026-27


Name of the Work: Improvement to availability of Water in Nanded Division by providing Borewells, pipeline connection, tanks etc. in Sr. DEN/W/NED Section- Electrical Arrangements.

TENDER VALUE: ₹. 1,19,68,836.00/-

BID SECURITY DEPOSIT: ₹.2,39,400.00/-

Contents

TENDER FORM (First Sheet).....	2
TENDER FORM (Second Sheet).....	4
TERMS & CONDITIONS	7
SCHEDULE OF RATES	40
GENERAL CONDITIONS OF CONTRACT	48
INSPECTION OF ITEMS	49
SCOPE OF WORK & SPECIFICATIONS	51
ANNEXURE “V(A)”	73

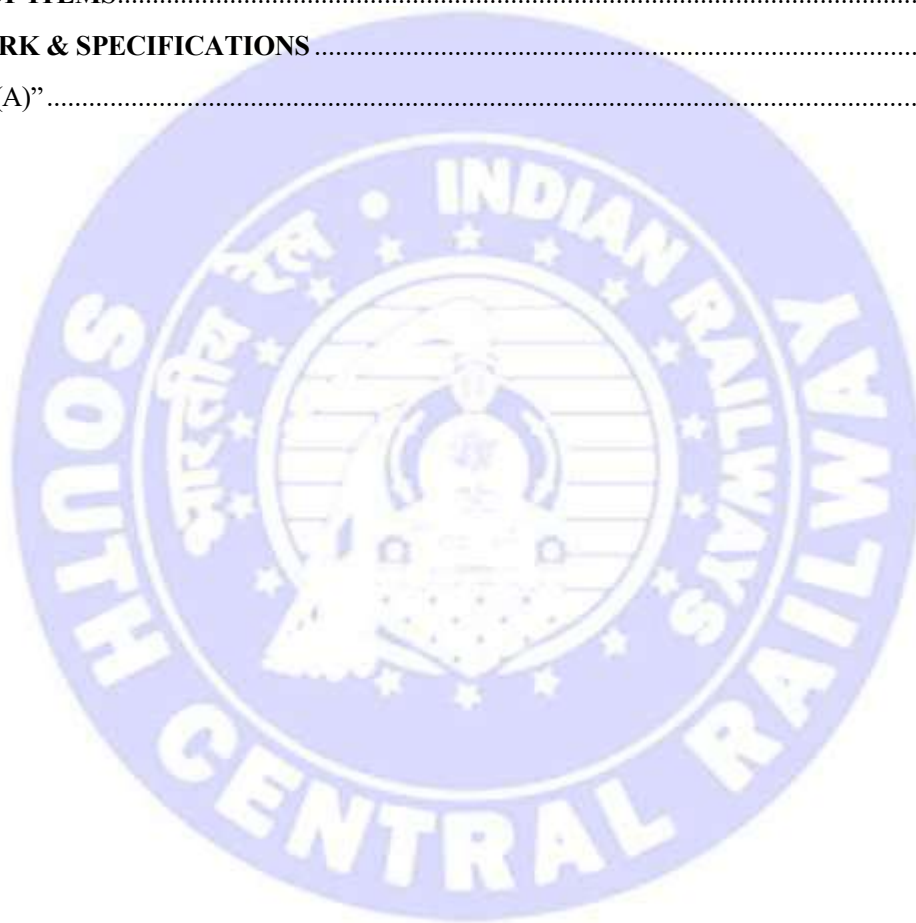

SOUTH CENTRAL RAILWAY
TENDER FORM (First Sheet)

Tender No. **NED-E-07-2026-27**

Name of Work: Improvement to availability of Water in Nanded Division by providing Borewells, pipeline connection, tanks etc. in Sr. DEN/W/NED Section- Electrical Arrangements.

THE PRESIDENT OF INDIA
ACTING THROUGH THE SENIOR DIVISIONAL ELECTRICAL ENGINEER,
DIVISIONAL RAILWAY MANAGER COMPLEX, NANDED DIVISION,
SOUTH CENTRAL RAILWAY, NANDED – 431 605

I/We _____ have read the various conditions to tender attached hereto and agree to abide by the said conditions. I/We also agree to keep this tender open for acceptance for a period of 60 days from the date fixed for opening the same and in default thereof, I/We will be liable forfeiture of my/our Bid Security. I/We offer to do the work for **Nanded Division**, S.C. Railway, at the rates quoted in the attached bill(s) of quantities and hereby bind myself/ourselves to complete the work in all respects within **12 months** from the date of issue of letter of acceptance of the tender.

2. I/We also hereby agree to abide by the Indian Railways Standard General Conditions of Contract, with all correction slips up-to-date and to carry out the work according to the Special Conditions of Contract and Specifications of materials and works as laid down by Railway in the annexed Special Conditions/Specifications, Standard Schedule of Rates with all correction slips up to date for the present contract.
3. A Bid Security of **Rs. 2,39,400/-** has already been deposited online/submitted as Bank Guarantee bond. Full value of the Bid Security shall stand forfeited without prejudice to any other rights or remedies in case my/our Tender is accepted and if
 - (a) I/We do not submit the Performance Guarantee within the time specified in the Tender document,
 - (b) I/We do not execute the contract documents within seven days after receipt of notice issued by the Railway that such documents are ready and
 - (c) I/We do not commence the work within fifteen days after receipt of orders to that effect.
4. (a) I/We am/are a Startup firm registered by.....Department of Industrial Policy and Promotion (DIPP) and my registration number is valid up to.....(Copy enclosed) and hence exempted from submission of Bid Security.
5. We are a Labor Cooperative Society, and our Registration No. is withand hence required to deposit only 50% of Bid Security.
6. Until a formal agreement is prepared and executed, acceptance of this tender shall constitute a binding contract between us subject to modifications, as may be mutually agreed to between us and indicated in the letter of acceptance of my/our offer for this work.

Signature of Bidder(s)

Date

Address of the Bidder(s)



1. **Instructions to Bidders and Conditions of Tender:** The following documents form part of Tender / Contract:
 - (a) Tender Forms – First Sheet and Second Sheet
 - (b) Special Conditions/Specifications (enclosed if any)
 - (c) Bill(s) quantities (enclosed)
 - (d) Standard General Conditions of Contract and Standard Specifications (Works and Materials) of Indian Railways as amended/corrected up to latest correction slips, copies of which can be seen in the office of Sr.DEE/M/NED or obtained from the office of the Chief Electrical Engineer, _____ South Central Railway on payment of prescribed charges.
 - (e) Schedule of Rates as amended / corrected up to latest correction slips, copies of which can be seen in the office of Sr.DEE/M/NED or obtained from the office of the Chief Electrical Engineer, _____ South Central Railway on payment of prescribed charges.
 - (f) All general and detailed drawings pertaining to this work which will be issued by the Engineer or his representatives (from time to time) with all changes and modifications.
2. **Drawings for the Work:** The Drawing for the work can be seen in the office of the Sr. DEE/M/NED and or the Chief Electrical Engineer, South Central Railway at any time during the office hours. The drawings are only for the guidance of Bidder(s). Detailed working drawings (if required) based generally on the drawing mentioned above, will be given by the Engineer or his representative from time to time.
3. The Bidder(s) shall quote his / their rates as a percentage above or below the Schedule of Rates of South-Central Railway as applicable to Nanded Division except where he/they are required to quote item rates and must tender for all the items shown in the Schedule of approximate quantities attached. The quantities shown in the attached Schedule are given as a guide and are approximate only and are subject to variation according to the needs of the Railway. The Railway does not guarantee work under each item of the Schedule. The Bidder(s) shall quote rates / rebates only at specified place in Tender Form supplied by Railway. Any revision of rates / rebates submitted (quoted) through a separate letter whether enclosed with the bid (Tender Form) or submitted separately or mentioned elsewhere in the document other than specified place shall be summarily ignored and will not be considered.
4. Tenders containing erasures and / or alterations of tender documents are liable to be rejected. Any correction made by tender(s) in his/their entries must be attested by him / them.
5. The works are required to be completed within a period of **12 months** from the date of issue of acceptance letter.

6. Bid Security:

- (a) Subject to exemptions provided under para 9 (a) of this document, the tender must be accompanied by a Bid Security as mentioned in tender documents, failing which the tender shall be summarily rejected.
- (b) The Tenderer(s) shall keep the offer open for a minimum period of 60 days (in case of two packet system of tendering 90 days) from the date of closing of the Tender. It is understood that the tender documents have been issued to the Tenderer(s) and the Tenderer(s), is / are permitted to tender in consideration of the stipulation on his / their part that after submitting his / their tender subject to the period being extended further, if required by mutual agreement from time to time, he will not resile from his offer or modify the terms and conditions thereof in a manner not acceptable to _____ Railway. Should the tenderer fail to observe or comply with the foregoing stipulation, the amount deposited, or Bank guarantee bond submitted as Bid Security for the due performance of the above stipulation, shall be forfeited to the Railway.

(c) If his tender is accepted,

- i) the Bid Security mentioned in sub para(a) above deposited in cash through e-payment gateway will be retained as part security for the due and faithful fulfillment of the contract in terms of Clause 16 of the Standard General Conditions of Contract.
- ii) the Bid Security mentioned in sub para(a) above submitted as Bank guarantee bond, will be en-cashed as part security for the due and faithful fulfillment of the contract in terms of Clause 16 of the Standard General Conditions of Contract.

The Bid Security of other Tenderers shall, save as herein before provided, be returned to them, but the Railway shall not be responsible for any loss or depreciation to the Bid Security that may happen thereto while in their possession, nor be liable to pay interest thereon.

- (d) In case Contractor submits the Term Deposit Receipt/Bank Guarantee Bond towards either the Full Security Depositor the Part Security Deposit equal to or more than Bid Security, the Railway shall return the Bid Security so retained as per sub para(c) above, to the Contractor.

- 7. Rights of the Railway to deal with Tender:** The authority for the acceptance of the tender will rest with the Railway. It shall not be obligatory on the said authority to accept the lowest tender or any other tender, and Bidder(s) shall neither demand any explanation for the cause of rejection of his/ their tender nor the Railway to assign reasons for declining to consider or reject any tender or tenders.
8. If the Bidder(s) deliberately gives / give wrong information in his / their tender or creates / create circumstances for the acceptance of his / their tender, the Railway reserves the right to reject such tender at any stage.

9. If any partner(s) of a partnership firm expires after the submission of its tender or after the acceptance of its tender, the Railway shall deem such tender as cancelled/contract as terminated under clause 61 of the Standard General Conditions of Contract, unless the firm retains its character as per partnership agreement. If a sole proprietor expires after the submission of tender or after the acceptance of tender, the Railway shall deem such tender as cancelled / contract as terminated under clause 61 of the Standard General Conditions of Contract.



TERMS & CONDITIONS

Tender No. NED-E-07-2026-27

Name of the work: Improvement to availability of Water in Nanded Division by providing Borewells, pipeline connection, tanks etc. in Sr.DEN/W/NED Section- Electrical Arrangements.

1.0 The following terms & conditions supplement the "Regulations for Tenders and Contracts, conditions of tender and General Conditions of Contract" and should be considered as part of the contract papers. Where the provision or the terms & conditions are at variance with the General conditions and other documents mentioned above, the Special conditions shall prevail.

1.1 It must be clearly understood that all the terms and conditions stipulated under special conditions are binding on the contractor. In all matters of dispute, the decision of the **Senior Divisional Electrical Engineer, Nanded Division, S.C. Railway, Nanded** shall be firm and binding.

2.0 Scope of work: The detailed scope of work & Specification is given in page no. **51-61** of this tender booklet.

3.0 Every effort has been made by the Railways to cover all the items required for executing the work. These items might have either been covered explicitly or implicitly in the specification and the Bidder shall, however, provide free of cost all such items that may be required for proper execution. Commissioning and performance of the equipment supplied and installed by them whether they are mentioned explicitly or implicitly in the specification or not. No extra claim whatsoever will be entertained by the Railways for such items provided by the installations provided by them under this contract.

4.0 OMISSIONS/DISCREPANCIES:

Should a Bidder find discrepancies in or omissions from the drawings or any of the Tender Forms or should he be in doubt as to their meaning, he should at once notify the authority inviting tenders. The tender inviting authority may, if deemed necessary, clarify the same to all Bidders. It shall be understood that every endeavor has been made to avoid any error which can materially affect the basis of tender and successful Bidder shall take upon himself and provide for the risk of any error which may subsequently be discovered and shall make no subsequent claim on account thereof.

5.0 GUARANTEE:

- (a) The Contractor shall guarantee for satisfactory working of the installations erected by him, for a period of **Thirty-Six (36) months** from the date of physical completion of all works. ***If for any item guarantee/warranty period is more than 36 months as per specification for that item, the guarantee/warranty period laid down for such item will hold good.*** S.D. for the value of such items will be

released after expiry of guarantee/warranty PERIOD LAID DOWN IN the SPECIFICATION. S.D. FOR THE REMAINING VALUE OF THE work will be released after 36 months of physical completion of all works.

- (b) For supply portion of works contract, the warranty/guarantee period should be covered for a minimum period of 36/42 months i.e., 36 months from date of commissioning/42 months from date of supply whichever is earlier or the period as per approved specification or OEM's warranty whichever is higher than the above.
- (c) During the period of Guarantee, the Contractor shall be liable for the replacement at site of any parts which may be found defective in the equipment whether such equipment be of his own manufacture or those of his sub-Contractor, whether arising from faulty design, materials, workmanship or negligence in any manner on the part of the Contractor provided always that such defective parts as are not repairable at site, are promptly returned to the Contractor if so required by him at his (Contractor's) own expenses. In case of type defects in Contractor's equipment and components detected during guarantee period, Contractor should replace all such items irrespective of the fact whether all such items have failed or not. The Contractor shall bear the cost or repairs carried out on his behalf by the Purchaser at site. In such a case, the Contractor shall be informed in advance of the works proposed to be carried out by the Purchaser.
- (d) If it becomes necessary for the Contractor to replace or renew any defective portion of the equipment under the Para aforesaid then the provision of the said Para shall also apply to the portions of the equipment on replaced or renamed until the expiration of six months from the date of such replacement or renewal or until the end of the above-mentioned period whichever is late. Such extension shall not apply in case of defects of a minor nature, the decision of the General Manager or his successor/nominee being final in the matter. If any defect be not remedied within a reasonable time during the aforesaid period the Purchaser may proceed to do work at the Contractor's risk and expense, but without prejudice to any other rights and remedies which the purchase may have against the Contractor in respect of such defects or faults.
- (e) The repaired or renewed parts shall be delivered and erected on site free of charge to the Purchaser.

6.0 LIQUIDITATED DAMAGES:

- a) If the contractor fails to carry out, execute and complete the work under this contract within the time prescribed as per the original acceptance letter and agreement, penalty in terms of clause 17 of General conditions of contract will apply. In unforeseen circumstance if found justified, the time of completion can be extended with or without LD or with lump sum penalty by the Senior Divisional

Electrical Engineer NANDED division, S.C. Railway, without any prejudice the L.D. clause mentioned herein.

- b) The competent authority while granting extension to the currency of the contract under clause 17(B) of GCC will also consider levy of token penalty as deemed fit based on the merit of the case.
- c) Time is essence of the work if the contractor to restore within the stipulated time, the penalty will be levied.

7.0 GENERAL CONDITIONS OF TENDER:

- a) **TENDER IS CONFIDENTIAL:** The Bidder (Whether his/her Tender be accepted or not) shall treat the contents of his Tender as private and confidential. He / She shall treat the prices quoted by him / her as strictly confidential till the Tenders are opened.
- b) Non-fulfillment of the requirements is liable for rejection of the offer of such Bidder summarily.
- c) All the required supporting documents should be scanned and uploaded.
- d) E-Tenders will be opened online using the “IREPS” portal. No representative is required to be present for the opening of the tender and taking notes of the rates quoted and ranking as complete details of the rates etc. of all the bidders shall be available to bidders on the website after opening of the tender. Opening of the tenders will be on any convenient date after closing date & time of the tender.
- e) It shall be the duty of Bidder that they ensure to see any corrigendum of the tender and to check the corrigendum on the web site from time to time.

8.0 CARE IN SUBMISSION OF TENDER:

- (a) (i) Before submitting a tender, the Bidder will be deemed to have satisfied himself by actual inspection of the site and locality of the works, that all conditions liable to be encountered during the execution of the works are taken into account and that the rates he enters in the tender forms are adequate and all-inclusive to accord with the provisions in Clause-37 of the Standard General Conditions of Contract for the completion of works to the entire satisfaction of the Engineer.
- (ii) Bidders will examine the various provisions of The Central Goods and Services Tax Act, 2017(CGST)/ Integrated Goods and Services Tax Act, 2017(IGST)/ Union Territory Goods and Services Tax Act, 2017(UTGST)/ respective state's State Goods and Services Tax Act (SGST) also, as notified by Central/State Govt. & as amended from time to time and applicable taxes before

bidding. Bidders will ensure that full benefit of Input Tax Credit (ITC) likely to be availed by them is duly considered while quoting rates.

(iii) The successful Bidder who is liable to be registered under CGST/IGST/UTGST/SGST Act shall submit GSTIN along with other details required under CGST/IGST/UTGST/SGST Act to railway immediately after the award of contract, without which no payment shall be released to the Contractor. The Contractor shall be responsible for deposition of applicable GST to the concerned authority.

(iv) In case the successful Bidder is not liable to be registered under CGST/IGST/UTGST/SGST Act, the railway shall deduct the applicable GST from his/their bills under reverse charge mechanism (RCM) and deposit the same to the concerned authority.

(v) Contractor shall be liable to pay/refund the amount collected as GST to the Indian Railways along with interest and penalties, if any imposed by the authorities, in case GST input tax credit of Indian Railways is denied/rejected by the tax authorities due to reasons mentioned below but not limited to:

Wrong/incorrect invoices issued by Contractor;

No-filing of GST returns;

Non-payment of GST collected from Indian Railways to the authorities;

Any other non-compliance done by Contractor;

General Indemnity: Contractor hereby agrees to indemnify and hold harmless the Indian Railways from and against any and all losses, including loss on account of Input Tax Credit and all losses incurred by the Indian Railways relating to or arising out of or in connection with any actual or threatened claim, legal action, proceedings, prosecution or inquiry by or against the Indian Railways arising out, directly or indirectly, of failure by the contractor to comply with the provisions of GST and related laws, or based upon or arising from any failure by the Contractor.

Retention Money: Any payment liable to be paid by Indian Railways to contractor against the goods or services or both supplied by such contractor to Indian Railways shall be kept on hold in case supplier makes any non-compliance of any of the GST law provisions including non-reporting of invoices in GST returns. Such payment shall be released after proper verification of records and availability of ITC to Indian Railways as per provisions of GST Law.

- (b) When work is tendered for by a firm or company, the tender shall be signed by the individual legally authorized to enter into commitments on their behalf.
- (c) The Railway will not be bound by any power of attorney granted by the Bidder or by changes in the composition of the firm made subsequent to the execution of the contract. It may, however, recognize such power of attorney and changes after obtaining proper legal advice, the cost of which will be chargeable to the Contractor.

8.1 In case of other than Company /Proprietary firm, Annexure V(A) shall also be submitted by each member of a Partnership Firm/ Joint Venture (JV) / Hindu Undivided Family (HUF) /Limited Liability Partnership (LLP) etc., as the case may be. Non submission of above certificate by the bidder shall result in **summarily** rejection of his/their bid. It shall be mandatorily incumbent upon the tenderer to identify, state and submit the supporting documents duly self-attested/digitally signed by which they/he is qualifying the Qualifying Criteria mentioned in the Tender Document.

9.0 BID SECURITY DEPOSIT: As per GCC 2022 and its latest amendments.

10.0 Security Deposit (Ref-Indian Railways Standard GCC, April-2022):

As per GCC 2022 and its latest amendments.

10.1 Refund of Security Deposit: Security Deposit mentioned in sub clause (1) above shall be returned to the Contractor after the following:

- Final Payment of the Contract as per clause 51(1) of GCC and
- Signature of Final Supplementary Agreement or Certification by Engineer that Railway has No Claim on Contractor and
- Issue of Maintenance Certificate on expiry of the maintenance period as per clause 50(1) of GCC.

10.2 Forfeiture of Security Deposit: Whenever the contract is rescinded as a whole under clause 62 (1) of GCC, the Security Deposit already with railways under the contract shall be forfeited. However, in case the contract is rescinded in part or parts under clause 62 (1) of GCC, the Security Deposit shall not be forfeited.

10.3 No interest shall be payable upon and Security Deposit or amounts payable to the Contractor under the Contract, but Government Securities deposited in terms of Sub-Clause of this clause will be payable with interest accrued thereon.

11 Performance Guarantee: Ref-Indian Railways Standard GCC, April-2022 and its latest amendments. Insurance Surety Bond (Annexure-M) added as per IR-GCC ACS-9 dt.09.01.2025. The successful bidder shall submit Guarantee (PG) amounting to the original contract value and **Additional performance Guarantee** as per clause 16 (4) (h) in any of the following forms

- i) A deposit of cash ii) Irrevocable Bank Guarantee iii) Insurance Surety Bond as per Annexure-M.

In case of extension of Date of Completion, selected bidder needs to submit extended Insurance Surety Bond/Fresh Insurance surety Bond/fresh Performance Security, in any

form as given above, before expiry of existing Insurance Surety Bond.

New Para 16(4) (h) of Part-II of GCC'22:

If a tender is accepted on the quoted rates of bidder which is below the Advertised tender value, an additional Performance security shall be submitted by the bidder as below:

Bid quoted in % of advertised cost	Additional performance Guarantee (%)
Below 0-5 % (inclusive)	Nil
Below 5 %	5 %

12 AGREEMENT:

- i. The Tenderer whose tender is accepted shall be required to appear in person at the office of General Manager/General Manager (Construction), Chief Administrative Officer (Construction), Divisional Railway Manager or concerned Engineer, as the case may be, or if tenderer is a firm or corporation, a duly authorized representative shall appear (there would be no need for appear in person if agreement is signed digitally) and execute the contract agreement within seven days of notice from Railways that the Contract Agreement is ready. Failure to do so shall constitute a breach of the agreement affected by the acceptance of the tender. The Contract Agreement shall be entered into by Railway only after submission of valid Performance Guarantee by the Contractor. In such cases the Railway may determine that such tenderer has abandoned the contract and there upon his tender and acceptance thereof shall be treated as cancelled and the Railway shall be entitled to forfeit the full amount of the Bid Security and other dues payable to the Contractor under this contract. The failed Contractor shall be debarred from participating in the re-tender for that work.
- ii. Every contract shall be complete in respect of the document it shall so constitute. Not less than 2 copies of the contract document shall be signed by the competent authority and the Contractor, and one copy given to the Contractor (there would be no need of signing two copies if agreement is signed digitally).

13 FAILURE TO PERFORM: If the Contractor fails in the performance of the contract, South Central Railway may without prejudice to his other rights, cancel the contract or a portion thereof and Railway shall be entitled to forfeit PG, EMD & SD as per the provision of GCC.

14 Completion Period:

- i) Contractor will take up the work and complete it within **12 months** from the date of receipt of the letter of acceptance.
- ii) If, during contract, the administration feels that it is not necessary to continue the

contract due to administrative reasons, the contract stands foreclosed with immediate effect without assigning any reasons.

- iii) The Railways attached to the utmost importance to the timely completion of the work on or before the date contracted for. In this connection, the attention of the contractor is specially invited to the clause regarding "Liquidated Damages" and determination of contract owing to default of contractor provided for in general conditions of contract.

15 EMPLOYMENT OF ELECTRICAL ENGINEERING GRADUATES/ DIPLOMA - HOLDERS:

The contractor shall employ the following technical staff during the execution of this work.

- 15.1 One Qualified Graduate Engineer when cost of work to be executed is ₹.200 lakh and above.
- 15.2 One Qualified Diploma Holder Engineer when cost of work to be executed is more than ₹. 25 lakhs but less than ₹. 200 lakhs.
- 15.3 These engineers shall be available throughout the period when the work is in progress and not merely be available for taking instructions. In case the contractor fails to employ the Qualified Engineer, as aforesaid in Para 1 & 2 above, he, in terms of Clause 26 A.2 to the General Conditions of Contract, shall be liable to pay an amount ₹. 40,000/- (Rupees forty thousand only) for each month or part thereof for the default period in case of Graduate Engineer and ₹. 25,000/- (Rupees Twenty-Five thousand only) for each month or part thereof for the default period in case of Diploma holder Engineer.
- 15.4 The decision of the Railway Engineer-in-charge as to the period for which the required technical staff was not employed by the contractor and as to the reasonableness of the amount to be deducted on this account shall be final and binding on the contractor.

16 Deduction of income tax, GST at source:

- 16.1 In terms of new Section 194-C inserted by the Finance Act 1972, in the income tax Act 1961 the Railway shall at the time of arranging payments to the contractor and/or sub-contractor (in the case of sub-contractor only when the Railway is responsible for payment of consideration to him under the contract) for carrying out any work (including supply of labor for carrying out any work) under the contract be entitled to deduct income tax at source on Income comprised in the sum of such payments.

The deduction towards income tax to be made at source from the payments due to non-residents shall continue to be governed by Section 195 of the Income Tax Act 1961.

No Income Tax will be deducted by the Railway on payments made for supply of

materials where such value of supply portion is distinct and ascertainable such as supply of Timber, tiles, bricks, ballast including track/ballast etc. The deductions towards Income Tax to be made at source from the payment due to non-residents shall continue to be governed by Section 195 of the Income Tax Act 1961.

16.2 Goods and Service Tax (GST) will be applicable on this work as per the prevailing rates amended from time to time by Government of India.

16.3 The Bidder shall quote the rate by considering all the statutory duties/taxes applicable to the work up to the date of opening of tender.

16.4 Conservancy charges as applicable and as modified from time to time will be recovered from contractors running bills.

17 Payment Terms:

- i. 90% payment will be made for completed portion of itemized work/or/ complete sub work and balance 10% payment will be made after successful completion of entire work.

In respect of the above claim, the following documentation is to be invariably adhered to,

1. Work done statement shall be prepared by the contractor and submitted to the nominated Railway supervisor for completed portion of work for which the payment is claimed duly signed by the contractor as well as nominated Railway supervisor.
2. Based on the work done statement, measurements will be recorded in the Measurement Book (MB) by the Nominated Railway supervisor.
3. Certified that the 20% check conducted against the work undertaken and found satisfactory (this should be done by the concerned DEE/ADEE.)

ii. Payment Mode

- a) All payment will be made on the name of the firm of the successful bidder.
- b) The bidder shall be entitled to be paid by way of "On Account Payment" as per the General Conditions of the Contract. (Wherever applicable).
- c) No advance payment will be made to the contractor.

iii. Information to be furnished by the contractor.

The information regarding Electronic Payment System (NEFT/RTGS) shall be furnished by the contractor duly signed by him.

The payment towards contractors/ suppliers' bill will be paid through Electronic Payment System i.e., NEFT/RTGS and commission charges if any to be borne by contractor/supplier.

Bidder /s are required to submit a scanned / attested copy of following information along

with their tender- 1. Bank Account No 2. Name of Bank 3. Indian Financial System Code {IFSC} 4. PAN No 5. Bidders Contact No. Contractor should provide firms PAN, issued by Income Tax Department with his quote or within 30 {Thirty} days of award of contract. No payment will be released without submission of PAN. All taxes {including surcharge and cess shall be recovered from his payment as per tax provisions in vogue. Proforma is given as **Annexure**

17.1 CLAIMING OF ON ACCOUNT/FINAL BILLS BY THE CONTRACTORS:

The contractor shall submit bills/gate passes for the materials purchased by them to supply the same to Railways at the time of supplying the materials to nominated Railway Stores Depot.

For claiming on account bill the contractor shall make a formal written request to the concerned Official/Officer-in-charge of the works clearly mentioning the quantity executed.

Each on account bill/Final Bill shall invariably accompany the contractor's material statement (materials drawn from the stores vs. material utilized at site on the work for which materials have been drawn from Railway stores.

The excess Class-I materials drawn from Railway Stores shall be returned as Class-1 only. Damages occurred during handling/stack and transportation by the Contractor will be charged to the Contractor and the cost will be recovered from the Contractor.

At the time of drawing materials from Railway Stores, the contractor shall check and ensure the correctness of quantity, description, and condition of the materials.

The Contractor while submitting requisition for drawl of stores shall indicate the quantity of material as per the schedule and the quantity already drawn and the quantity now required with remarks.

17.2 “Letter of Credit” as Mode of Payment

- (i) For all the tenders having advertised cost of Rs. 10 lakh or above, the contractor shall have the option to take payment from Railways through a letter of credit (LC) arrangement.
- (ii) The option of taking payment through LC arrangement has to be exercised in IREPS (Indian Railway Electronic Procurement System – the e-application on which tenders are called by Railways) by the Bidder at the time of bidding itself, and the Bidder shall affirm having read over and agreed to the terms and conditions of the LC option.
- (iii) The option so exercised, shall be an integral part of the bidder's offer.
- (iv) The above option of taking payment through LC arrangement, once exercised by Bidder at the time of bidding, shall be final and no change shall be permitted, thereafter, during execution of contract.
- (v) In case Bidder opts for payment through LC, following shall be the procedure to

deal release of payment through LC:

- (a) The LC shall be a sight LC.
- (b) The contractor shall select his Advising/Negotiating bank for LC. The incidental cost towards issue of LC and its operation thereof shall be borne by the contractor.
- (c) SBI, New Delhi Main Branch will be the nodal branch for issue of LCs based on online requests received from Railway Accounts Units for tenders opened in financial year 2018-19. SBI branches where the respective Railway Accounts Office has its Account (local SBI branch) will be the issuance/reimbursing branch for LC issued under this arrangement. The Bank shall remain same for this tender till completion of contract. The incidental cost @0.15% per annum of LC value, towards issue of LC and operation thereof shall be borne by the contractor and shall be recovered from his bills.
- (d) The LC shall be opened initially for duration for 180 to 365 days in consultation with contractor. The LC shall be extended time to time as per the progress of the contract, on the request of the contractor. The value of LC to be opened initially as well as extended thereafter shall be finalized by the engineer in consultation with the contractor on the basis of expected progress of work.
- (e) The LC terms and conditions shall inter-alia indemnify and save harmless the Railway from and against all losses, claims and demands of every nature and description brought or recovered against the Railways by reason of any act or omission of the contractor, his agents, or employees, in relation to the Letter of Credit (LC). All sums payable/borne by Railways on this account shall be considered as reasonable compensation and paid by contractor.
- (f) The LC terms and conditions shall inter-alia provide that Railways will issue a Document of Authorization (format enclosed as **Annexure J**) after passing the bill for completed work, to enable contractor to claim the authorized amount from their bank.
- (g) The acceptable, agreed upon document for payments to be released under the LC shall be the Document of Authorization.
- (h) The Document of Authorization shall be issued by Railway Accounts Office against each bill passed by Railways.
- (i) On issuance of Document of Authorization, a copy of Document of Authorization shall be posted on IREPS for download by the contractor. A digitally signed copy of Document of Authorization shall also be sent by Railway Account Office to Railway's bank (Local SBI Branch).

- (j) The contractor shall take print out of the Document of Authorization available on IREPS and present his claim to his bank (advising Bank) for necessary payments as per LC terms and conditions. The claim shall comprise of copy of Document of Authorization, Bill of Exchange, and bill.
- (k) The payment against LC shall be subject to verification for Railway's Bank (Local SBI Branch).
- (l) The contractor's bank (advising bank) shall submit the documents to the Railway's Bank (Local SBI Branch).
- (m) The Railway's bank (issuing bank) shall, after verifying the claim so received w.r.t. the digitally signed Document of Authorization received from Railway Account Office, release the payment to contractor's bank (advising bank) for crediting the same to contractor's account.
- (n) Any number of bills can be dealt within one LC, provided the sum total of payments to contractor is within the amount for which LC has been opened.
- (o) The LC shall be closed after the release of final payment including PVC amount, if any, to the contractor.
- (p) The release of Performance guarantee or security deposit shall be dealt directly by railway with the contractor i.e., not through LC.
- vi. For opening of LC, executive department shall make a request letter to concerned Accounts Department on a format, placed as **Annexure – I**.
- vii. Necessary charges in IREPS and IPAS e-applications have already been carried out, for having option for payment to contractors through LC.

18 Credentials Requirement & Eligibility Criteria:

- a) Electrical License:** The tenderer shall possess a valid Electrical Contractor License, issued by any State Government or Union Territory Administration, authorizing execution of electrical works up to 650 V. The contractor shall have in his employment or shall engage a person holding a valid certificate of competency issued by any State Government or Union Territory Administration for supervision of electrical works up to 650 V.

Offers not accompanied by a valid Electrical Contractor License and requisite Supervisor competency for works up to 650 V shall be summarily rejected

Note: In case of expiry of validity of license during contract, the contractor should renew the license so that it is always valid during contract).

- b) Technical Eligibility Criteria:** (a) The tenderer must have successfully completed or substantially completed any of the following during last 07 (seven) years, ending

last day of month before the one in which tender is invited:

Three similar works costing not less than the amount equal to 30% of advertised value of the tender, or

Two similar works costing not less than the amount equal to 40% of advertised value of the tender, or

One similar work costing not less than the amount equal to 60% of advertised value of the tender.

- (i) In case of composite works (e.g., works involving more than one distinct component, such as Civil Engineering works, S&T works, Electrical works, OHE works etc. and in the case of major bridges – substructure, superstructure etc.), tenderer must have successfully completed or substantially completed any of the following during last 07 (seven) years, ending last day of month before the one in which tender is invited:

Three similar works costing not less than the amount equal to 30% of advertised value of each component of tender, or

Two similar works costing not less than the amount equal to 40% of advertised value of each component of tender, or

One similar work costing not less than the amount equal to 60% of advertised value of each component of tender.

Note: Separate completed works of minimum required values for each component can also be considered for fulfilment of technical eligibility criteria.

- (ii) In such cases, what constitutes a component in a composite work shall be clearly pre-defined with estimated tender cost of it, as part of the tender documents without any ambiguity. Any work or set of works shall be considered as a separate component, only when cost of the component is more than ₹ 2 crore each.
- (iii) To evaluate the technical eligibility of tenderer, only components of work as stipulated in tender documents for evaluation of technical eligibility, shall be considered. The scope of work covered in other remaining components shall be either executed by tenderer himself if he has work experience as mentioned in clause 7 (a) (ii) of Part-II of GCC or through subcontractor fulfilling the requirements as per clause 7 of Part-II of GCC or jointly i.e., partly himself and remaining through subcontractor, with prior approval of Chief Engineer in writing.

However, if required in tender documents by way of Special Conditions, a formal agreement duly notarized, legally enforceable in the court of law, shall be executed by the main contractor with the subcontractor for the component(s) of work proposed to be executed by the subcontractor(s), and shall be submitted along with the offer for considering subletting of that scope of work towards fulfilment of technical eligibility. Such subcontractor must fulfill technical eligibility criteria as follows:

The subcontractor shall have successfully completed at least one work similar to work proposed for subcontract, costing not less than 35% value of work to be subletted, in last 5 years, ending last day of month previous to the one in which tender is invited through a works contract.

In case after award of contract or during execution of work it becomes necessary for contractor to change subcontractor, the same shall be done with subcontractor(s) fulfilling the requirements as per clause 7 of the Standard General Conditions of Contract, with prior approval of Chief Engineer in writing.

Definition of Similar nature of work:

Works of installation, testing and commissioning of motor driven pump sets (with or without supply of motor/pump sets).

Note for Technical Eligibility:

Tenderer should submit attested copy of work experience certificate in Annexure – ‘E’ to establish the eligibility criteria. All details as required in the Annexure – ‘E’, shall be made available otherwise the information is treated as incomplete.

The work experience certificate shall be issued by an officer not below the rank of JA Grade or Bill passing Officer in Railways and Bill passing officer/Executive Incharge of work in other Govt./Govt. bodies/ PSUs. The certificate should bear the signature and seal of the issuing officer, name of the department etc.

In case of Partnership deeds, Power of Attorney etc. shall meet to Indian Railways Standards General Conditions of Contract April’2022.

Work experience certificate from private individual shall not be considered. However, in addition to work experience certificates issued by any Govt. Organization, work experience certificate issued by Public listed company having average annual turnover of Rs 500 crore and above in last 3 financial years excluding the current financial year, listed on National Stock Exchange or Bombay Stock Exchange, incorporated/registered at least 5 years prior to the date of opening of tender, shall also

be considered provided the work experience certificate has been issued by a person authorized by the Public listed company to issue such certificates.

In case tenderer submits the Experience Certificate issued by public listed company, the tenderer shall also submit along with work experience certificate, the relevant copy of work order, bill of quantities, bill wise details of payment received duly certified by Chartered Accountant, TDS certificates for all payments received and copy of final/last bill paid by company in support of above work experience certificate.

c) Financial Eligibility Criteria:

The tenderer must have minimum average annual contractual turnover of V/N or V whichever is less; where

V= Advertised value of the tender in crores of Rupees.

N= Number of years prescribed for completion of work for which bids have been invited.

The average annual contractual turnover shall be calculated as an average of “total contractual payments” in the previous three financial years, as per the audited balance sheet. However, in case balance sheet of the previous year is yet to be prepared/ audited, the audited balance sheet of the fourth previous year shall be considered for calculating average annual contractual turnover.

The tenderers shall submit requisite information as per Annexure-F, along with copies of Audited Balance Sheets duly certified by the Chartered Accountant/ Certificate from Chartered Accountant duly supported by Audited Balance Sheet.

18.2 Additional Documents to be submitted along with the tender:

- (i) List of personnel organizations available on hand and proposed to be engaged for the subject work. These two lists should be given separately and signed by Bidder and are to be submitted in the Proforma given in the **Annexure ‘A’**.
- (ii) List of Plant & Machinery available on hand (own) and proposed to be inducted (own and hired to be given separately) for the subject work and this list shall be signed by the Bidder and is to be submitted in the Proforma given in the **Annexure ‘B’**.
- (iii) List of completed works in the last three Financial Years giving description of work, organization for whom executed, approximate value of contract at the time of award, date of award and date of scheduled completion of work, date of actual start, actual completion and final value of contract should also be given in the **Annexure ‘C’**.

- (iv) List of Works on Hand indicating name of work, contract value, bill amount paid so far; due date of completion etc. to be furnished by Contractor in **Annexure ‘D’** and this Certificate is to be signed by Contractor.
- (v) The Tender Floating Authority may incorporate “any other details of specific nature relevant and mandatory for Tender finalization.
- (vi) **A checklist of documents to be submitted** at the time of tender submission is given as **top sheet** in **Annexure-G** for easy guidance and compliance from prospective Bidders. The Bidders shall submit the following documents for identification of the Bidder:

18.3 Documents to be submitted along with the tender:

- (i) The tenderer shall clearly specify whether the tender is submitted on his own (Proprietary Firm) or on behalf of a Partnership Firm / Company / Joint Venture (JV) / Registered Society / Registered Trust / Hindu Undivided Family (HUF) / Limited Liability Partnership (LLP) etc. The tenderer(s) shall enclose the attested copies of the constitution of their concern and copy of PAN Card along with their tender. Tender Documents in such cases are to be signed by such persons as may be legally competent to sign them on behalf of the firm, company, association, trust, or society.

(ii) Following documents shall be submitted by the tenderer:

(a) Sole Proprietorship Firm:

A copy of registration / Income tax/ PAN No. for filing returns self- attested.

(b) HUF: (i) A copy of notarized affidavit on Stamp Paper declaring that he who is submitting the tender on behalf of HUF is in the position of ‘Karta’ of Hindu Undivided Family (HUF) and he has the authority, power and consent given by other members to act on behalf of HUF.

A copy of registration / Income tax/ PAN No. for filing returns self- attested.

(c) Partnership Firm: (i) All documents as mentioned in para 26 of the Tender Document.

(d) Joint Venture (JV): All documents as mentioned in para 17 of the Tender Form (Second Sheet) of GCC April 2022.

(e) Company registered under Companies Act 2013:

- The copies of MOA (Memorandum of Association) / AOA (Articles of Association) of the company (ii) A copy of Certificate of Incorporation (iii) A copy of Authorization/Power of Attorney issued by the Company (backed by the resolution of Board of Directors) in favor of the individual to sign the tender on behalf of the company and create liability against the company.

(f) LLP (Limited Liability Partnership): (i) A copy of LLP Agreement (ii) A copy of Certificate of Incorporation (iii) A copy of Power of Attorney/Authorization issued by the LLP in favor of the individual to sign the tender on behalf of the LLP and create liability against the LLP. (iv) An

undertaking by all partners of the LLP that they are not blacklisted or debarred by Railways or any other Ministry / Department of the Govt. of India from participation in tenders / contracts as on the date of submission of bids, either in their individual capacity or in any firm/LLP or JV in which they were / are partners/members. Concealment / wrong information in regard to above shall make the contract liable for determination under Clause 62 of the Standard General Conditions of Contract.

- (g) Registered Society & Registered Trust: (i) A copy of Certificate of Registration (ii) A copy of Memorandum of Association of Society/Trust Deed (iii) A copy of Power of Attorney in favor of the individual to sign the tender documents and create liability against the Society/Trust. (iv) A copy of Rules & Regulations of the Society.
- (iii) If it is NOT mentioned in the submitted tender that tender is being submitted on behalf of a Sole Proprietorship firm / Partnership firm / Joint Venture / Registered Company etc., then the tender shall be treated as having been submitted by the individual who has signed the tender.
- (iv) After opening of the tender, any document pertaining to the constitution of Sole Proprietorship Firm / Partnership Firm / Registered Company/ Registered Trust / Registered Society / HUF/LLP etc. shall be neither asked nor considered, if submitted. Further, no Suo motu cognizance of any document available in public domain (i.e., on internet etc.) or in Railway's record/office files etc. will be taken for consideration of the tender, if no such mention is available in tender offer submitted.
- (v) A tender from JV shall be considered only where permissible as per the tender conditions. (vi) The Railway will not be bound by any change of power of attorney or in the composition of the firm made subsequent to the submission of tender. Railway may, however, recognize such power of attorney and changes after obtaining proper legal advice, the cost of which will be chargeable to the Contractor.

18.4 The tenderer whether sole proprietor / a company or a partnership firm / joint venture (JV) / registered society / registered trust / HUF / LLP etc. if they want to act through agent or individual partner(s), should submit along with the tender, a copy of power of attorney duly stamped and authenticated by a Notary Public or by Magistrate in favor of the specific person whether he/they be partner(s) of the firm or any other person, specifically authorizing him/them to sign the tender, submit the tender and further to deal with the Tender/ Contract up to the stage of signing the agreement except in case where such specific person is authorized for above purposes through a provision made in the partnership deed / Memorandum of Understanding / Article of Association / Board resolution, failing which tender shall be summarily rejected.

A separate power of attorney duly stamped and authenticated by a Notary Public or by Magistrate in favor of the specific person whether he/they be partner(s) of

the firm or any other person, shall be submitted after award of work, specifically authorizing him/them to deal with all other contractual activities subsequent to signing of agreement, if required.

Note: A Power of Attorney executed and issued overseas, the document will also have to be legalized by the Indian Embassy and notarized in the jurisdiction where the Power of Attorney is being issued. However, the Power of Attorney provided by Bidders from countries that have signed the Hague Legislation Convention 1961 are not required to be legalized by the Indian Embassy if it carries a conforming Apostille certificate.

18.5 Multiple L-1:

In case of more than one L-1 bidders, tender may be awarded to Bidder having higher Bid Capacity. In case of Bid Capacity is also the same, Bidder having done more value of similar work in last three previous financial years and the current financial year up to the date of opening of the tender, may be selected for the award. Instructions with respect to Bid Capacity will follow. (Ref: Railway Board's letter No.2017/Trans/01/Policy dt. 08-02-2018 communicated by PCE/SC letter No.W.496/P/ Transformation dt 14-02-2018).

18.6 Post Tender submission of Documents/information of Mandatory Nature linked to Eligibility Criteria called for, at Tender stage:

- (i) **Clarification of Bids:** To assist in the examination, evaluation & comparison and prequalification of the Tender, the Railway may, at its discretion, ask any Bidder for a clarification of its Bid. Any clarification submitted by a Bidder that is not in response to a request by the Railway shall not be entertained or considered. The Railway request for clarification and the response of the bidder in this regard shall be in writing.

However, if a Bidder does not provide clarification of its bid by the date and time communicated in the Railway request for clarification, the bid shall be evaluated as per the documents submitted along with the bid.

- (ii) The Railway reserves the right to verify all statements, information and documents submitted by the bidder in his tender offer, and the bidder shall, when so required by the Railway, make available all such information, evidence and documents as may be necessary for such verification. Any such verification or lack of such verification by the railway shall not relieve the bidder of its obligations or liabilities hereunder nor will it affect any rights of the railway thereunder.
- (iii) In case of any wrong information submitted by Bidder, the contract shall be terminated, Performance Guarantee (PG) and Security Deposit (SD) of contract forfeited and agency barred for doing business on entire Indian Railways for 2 (five) years.

19 TAXES & DUTIES:

No reimbursement or claim of Taxes & duties whatsoever will be allowed. Form “D” will not be issued by Railways.

20 Right of the Railway to deal with tender:

- a) While opening tender or after opening of tenders, no opportunity shall be given to any bidder to repudiate, amend or explain the rate and or any condition in the tender, as applicable.
- b) It shall not be obligatory on the competent authority to accept lowest tender and no bidder shall demand any explanation for the cause of rejection of his/their tender. Further it shall not be obligatory on the said authority to award contract to a single bidder for the entire work.
- c) No free pass will be issued by the administration to the contractor.
- d) If the bidder expires after the submission of his tender or after the acceptance of his tender, the Railway shall deem such tender as cancelled. If a partner of a firm expires after the submission of their tender or after the acceptance of their tender, the Railway shall deem such tender as cancelled, unless the firm retains its character.
- e) The authority for acceptance of the tender will rest with the Senior Divisional Electrical Engineer, South Central Railway, Nanded who does not bind himself to accept the lowest or any other tender nor does he undertake to assign reasons for declining to consider any particulars tenders or tenders.

21 The contractor should submit list of infrastructure facilities and establishment available with him.

22 The contractor **shall submit proof of purchase with manufacturer’s guarantee** if any for the item supplied by them.

23 Price Variation: No Price variation clause shall be made applicable to this contract.

24 VARIATIONS IN CONTRACT QUANTITIES (As per IRS GCC-2022): The procedure as detailed below shall be adopted for dealing with variations in quantities during execution of works contracts:

- (1) **Modification to Contract to be in Writing:** In the event of any of the provisions of the contract required to be modified after the contract documents have been signed, the modifications shall be made in writing and signed by the Railway and the Contractor, and no work shall proceed under such modifications until this has been done. Any verbal or written arrangement abandoning, modifying, extending, reducing or supplementing the contract or any of the terms thereof shall be deemed conditional and shall not be binding on the Railway unless and until the same is

incorporated in a formal instrument and signed by the Railway and the Contractor, and till then the Railway shall have the right to repudiate such arrangements.

- (2) **Powers of Modification to Contract:** The Engineer on behalf of the Railway shall be entitled by order in writing to enlarge or extend, diminish or reduce the works or make any alterations in their design, character position, site, quantities, dimensions or in the method of their execution or in the combination and use of materials for the execution thereof or to order any additional work to be done or any works not to be done and the Contractor will not be entitled, to any compensation for any increase/reduction in the quantities of work but will be paid only for the actual amount of work done and for approved materials supplied against a specific order.
- (i) Unless otherwise specified in the special conditions of the contract, the accepted variation in quantity of each individual item of the contract would be up to 25% of the quantity originally contracted, except in case of foundation work.
 - (ii) The Contractor shall be bound to carry out the work at the agreed rates and shall not be entitled to any claim or any compensation whatsoever up to the limit of 25% variation in quantity of individual item of works.
 - (iii) In case an increase in quantity of an individual item by more than 25% of the agreement quantity is considered unavoidable, then same shall be executed at following rates.
 - (a) Quantities operated more than 125% but up to 140% of the agreement quantity of the concerned item, shall be paid at 98% of the rate awarded for that item in that tender.
 - (b) Quantities operated more than 140% but up to 150% of the agreement quantity of the concerned item shall be paid at 96% of the rate awarded for that item in that tender.
 - (c) Variation in quantities of individual items beyond 150% will be avoided and would be permitted only in exceptional unavoidable circumstances and shall be paid at 96% of the rate awarded for that item in that tender.
 - (d) Variation to quantities of Minor Value Item:
The limit for varying quantities for minor value items shall be 100% (as against 25% prescribed for other items). A minor value item for this purpose is defined as an item whose original agreement value is less than 1 % of the total original agreement value.
 - d.(i) Quantities operated up to and including 100% of the agreement quantity of the concerned minor value item, shall be paid at the rate awarded for that item in that tender.

- d.(ii) Quantities operated more than 100% but up to 200% of the agreement quantity of the concerned minor value item, shall be paid at 98% of the rate awarded for that item in that tender.
 - d.(iii) Variation in quantities of individual minor value item beyond 200% will be avoided and would be permitted only in exceptional unavoidable circumstances and shall be paid at 96% of the rate awarded for that item in that tender.
 - (iv) In case of earthwork, the variation limit of 25% shall apply to the gross quantity of earthwork and variation in the quantities of individual classifications of soil shall not be subject to this limit.
 - (v) In case of foundation work, no variation limit shall apply, and the work shall be carried out by the Contractor on agreed rates irrespective of any variation.
 - (vi) As far as SOR items are concerned, the limit of 25% would apply to the value of SOR schedule as a whole and not on individual SOR items. However, in case of NS items, the limit of 25% would apply on the individual items irrespective of the manner of quoting the rate (single percentage rate or individual item rate).
- (3) **Valuation of Variations:** The enlargements, extensions, diminution, reduction, alterations or additions referred to in Sub-Clause (2) of this Clause shall in no degree affect the validity of the contract; but shall be performed by the Contractor as provided therein and be subject to the same conditions, stipulations and obligations as if they had been originally and expressively included and provided for in the Specifications and Drawings and the amounts to be paid there for shall be calculated in accordance with the accepted Schedule of Rates. Any extra items/quantities of work falling outside the purview of the provisions of Sub- Clause (2) above shall be paid for at the rates determined under Clause-39 of these Conditions.
- (4) The aspect of vitiation of tender with respect to variation in quantities should be checked and avoided. In case of vitiation of tender (both for increase as well as decrease of value of contract agreement) sanction of competent authority as per single tender should be obtained. In addition to the above, the partial modification is as furnished below (RB Lr No: 2017/Trans/01/Policy/New Delhi dated 08/02/2018), it has been decided that as a result of variations, a contract shall be considered “vitiating” only when, the following percentage variation in contract value between Bidders are noticed to have been exceeded.

<i>S. No.</i>	<i>Value of Contract</i>	<i>Percentage difference between present contractor and new L-1 as a result of variation. (Percentage shall be calculated with base as the revised contract quantities multiplied by the rates of the present contractor)</i>
<i>1</i>	<i>Small value contracts (Tender value less than Rs.50 Lakh)</i>	<i>10%</i>
<i>2</i>	<i>Other than small value contracts (Tender value equal to or more than Rs.50 lakh)</i>	<i>5%</i>

- (5) When the percentage difference between present contractor and new L-1 is noticed as becoming beyond the values above, the following action shall be taken. Vitiating should always be computed with respect for the items rates quantities and conditions as available at the time of tender opening and subsequent changes/additions by way of new items will not be counted for computing vitiating.
- (6) Overall agreement value arrived at by adding the positive variation and subtracting the negative variation from the accepted value of the contract shall be taken for deciding the competency of sanction.

25 Partnership Firm:

- i. Partnership deed is eligible if entered and registered prior to Tender Notice. Bidder should attach scanned experience certificate in the same name and style as the Bidder and their credentials shall be considered fully to the extent of work executed by the partnership firm. (EXPERIENCE OF INDIVIDUAL PARTNERS WILL NOT BE CONSIDERED).
- ii. Any change or modification in the constitution of tendering firms for whatever purpose or intimation of any disputes by any of the partners in the firm making tendering firm ineligible, during consideration of Tender after opening of the Tender, shall be deemed to be backing out of the offer by the Bidder.

25.1 Participation of Partnership Firms in works tenders:

- (i) The Partnership Firms participating in the tender should be legally valid under the provisions of the Indian Partnership Act.
- (ii) The partnership firm should have been in existence or should have been formed prior to submission of tender. Partnership firm should have either been registered with the Registrar or the partnership deed should have been notarized prior to date of tender opening as per the Indian Partnership Act.

- (iii) Separate identity / name should be given to the partnership firm. The partnership firm should have PAN / TAN number in its own name and PAN / TAN number in the name of any of the constituent partners shall not be considered. The valid constituents of the firm shall be called partners.
- (iv) Once the tender has been submitted, the constitution of the firm shall not be allowed to be modified / altered / terminated during the validity of the tender as well as the currency of the contract except when modification becomes inevitable due to succession laws etc., in which case prior permission should be taken from Railway and in any case the minimum eligibility criteria should not get vitiated. The re-constitution of firm in such cases should be followed by a notary certified Supplementary Deed. The approval for change of constitution of the firm, in any case, shall be at the sole discretion of the Railways and the Bidder shall have no claims what-so-ever. Any change in the constitution of Partnership firm after opening of tender shall be with the consent of all partners and with the signatures of all partners as that in the Partnership Deed. Failure to observe this requirement shall render the offer invalid and full EMD shall be forfeited.
- (v) If any Partner/s withdraws from the firm after opening of the tender and before the award of the contract, the offer shall be rejected. If any new partner joins the firm after opening of tender but prior to award of contract, his / her credentials shall not qualify for consideration towards eligibility criteria either individually or in proportion to his share in the previous firm. In case the Bidder fails to inform Railway beforehand about any such changes / modification in the constitution which is inevitable due to succession laws etc. and the contract is awarded to such firm, then it will be considered a breach of the contract conditions liable for determination of the contract under Clause 62 of General Conditions of Contract.
- (vi) A partner of the firm shall not be permitted to participate either in his individual capacity or as a partner of any other firm in the same tender.
- (vii) The tender form shall be submitted only in the name of partnership firm. The EMD shall be deposited by partnership firm through e-payment gateway or as mentioned in tender document. The EMD submitted in the name of any individual partner or in the name of authorized partner (s) shall not be considered.
- (viii) One or more of the partners of the firm or any other person (s) shall be designated as the authorized person (s) on behalf of the firm, who will be authorized by all the partners to act on behalf of the firm through a “Power of Attorney”, specially authorizing him / them to submit & sign the tender, sign the agreement, receive payment, fitness measurements, sign measurement books, make correspondences, compromise / settle / relinquish any claim (s) preferred by the firm, sign “No Claim Certificate”, refer all or any dispute to arbitration and to take

similar such action in respect of the said tender / contract. Such “Power of Attorney” shall be notarized / registered and submitted along with the tender.

(ix) On issue of Letter of Acceptance (LOA) to the partnership firm, all the guarantees like Performance Guarantee, guarantee for various Advances to the Contractor shall be submitted only in the name of the partnership firm and no splitting of guarantees among the partners shall be acceptable.

(x) On issue of Letter of Acceptance (LOA), contract agreement with partnership firm shall be executed in the name of the firm only and not in the name of any individual partner.

(xi) In case the Letter of Acceptance (LOA) is issued to a partnership firm, the following undertakings shall be furnished by all the partners through a notarized affidavit, before signing of contract agreement.

i. Joint and several liabilities:

The partners of the firm to which the Letter of Acceptance (LOA) is issued, shall be jointly and severally liable to the Railway for execution of the contract in accordance with General and Special Conditions of the Contract. The partners shall also be liable jointly and severally for the loss, damages caused to the Railway during execution of the contract or due to non-execution of the contract or part thereof.

ii. Duration of the partnership deed and partnership firm agreement: The partnership deed/partnership firm agreement shall normally not be modified/altered/terminated during the currency of contract and the maintenance period after the work is completed as contemplated in the conditions of the contract. Any change carried out by partners in the constitution of the firm without permission of Railway, shall constitute a breach of the contract, liable for determination of the contract under Clause 62 of the General Conditions of Contract.

iii. Governing laws: The partnership firm agreement shall in all respect be governed by and interpreted in accordance with the Indian laws.

iv. No partner of the firm shall have the right to assign or transfer the interest right or liability in the contract without the written consent of the other partner/s and that of the Railway.

(xii) The Bidder shall clearly specify that the tender is submitted on behalf of a partnership firm. The following documents shall be submitted by the partnership firm, with the tender:

(1) A copy of partnership deed.

- (2) A copy of Power of Attorney (duly registered as per prevailing law) in favor of the individual to tender for the work, sign the agreement etc. and create liability against the firm.
- (3) An undertaking by all partners of the partnership firm that they are not blacklisted or debarred by Railways or any other Ministry / Department of the Govt. of India / any State Govt. from participation in tenders / contracts as on the date of opening of bids, either in their individual capacity or in any firm in which they were / are partners. Concealment / wrong information in regard to above shall make the contract liable for determination under Clause 62 of the General Conditions of Contract.

26 Employment/Partnership etc., of Retired Railway Employees

As per GCC-2022 and latest amendments to GCC-2022.

27 ARBITRATION:

27.1 Reconciliation of disputes: All disputes and differences of any kind whatsoever arising out of or in connection with the contract, whether during the progress of the work or after its completion and whether before or after the determination of the contract, shall be referred by the Contractor to the "Chief Engineer" or "Divisional Railway Manager" through "Notice of Dispute" provided that no such notice shall be served later than 30 days after the date of issue of Completion Certificate by the Engineer. Chief Engineer or Divisional Railway Manager shall, within 30 days after receipt of the Contractor's "Notice of Dispute", notify the name of conciliator(s) to the Contractor.

The Conciliator(s) shall assist the parties to reach an amicable settlement in an independent and impartial manner within the terms of contract.

If the parties reach agreement on a settlement of the dispute, they shall draw up and sign a written settlement agreement duly signed by Engineer In-charge, Contractor and conciliator(s). When the parties sign the settlement agreement, it shall be final and binding on the parties.

The parties shall not initiate, during the conciliation proceedings, any arbitral or judicial proceedings in respect of a dispute that is the subject matter of the conciliation proceedings.

The conciliation proceedings shall be terminated:

By the signing of the settlement agreement by the parties on the date of agreement; or

- By written declaration of the conciliator, after consultation with the parties, to the effect that further efforts at conciliation are no longer justified, on the date of

declaration; or

- By a written declaration of any party to the conciliator to the effect that the conciliation proceedings are terminated, on the date of declaration; or

27.2 Matters Finally Determined by the Railway: All disputes and differences of any kind whatsoever arising out of or in connection with the contract, whether during the progress of the work or after its completion and whether before or after the determination of the contract, shall be referred by the Contractor to the GM and the GM shall, within 120 days after receipt of the Contractor's representation, make and notify decisions on all matters referred to by the Contractor in writing provided that matters for which provision has been made in Clauses 8, 18, 22(5), 39, 43(2), 45(a), 55, 55-A (5), 57, 57A, 61(1), 61(2) and 62(1) of Standard General Conditions of Contract or in any Clause of the Special Conditions of the Contract shall be deemed as 'excepted matters' (matters not arbitrable) and decisions of the Railway authority, thereon shall be final and binding on the Contractor; provided further that 'excepted matters' shall stand specifically excluded from the purview of the Arbitration Clause.

27.3 (1) Demand for Arbitration:

(1)(i): In the event of any dispute or difference between the parties hereto as to the construction or operation of this contract, or the respective rights and liabilities of the parties on any matter in question, dispute or difference on any account or as to the withholding by the Railway of any certificate to which the Contractor may claim to be entitled to, or if the Railway fails to make a decision within 120 days, then and in any such case, but except in any of the "excepted matters" referred to in Clause 63.1 of these Conditions, the Contractor, after 120 days but within 180 days of his presenting his final claim on disputed matters shall demand in writing that the dispute or difference be referred to arbitration.

(1)(ii)(a): The demand for arbitration shall specify the matters which are in question, or subject of the dispute or difference as also the amount of claim item-wise. Only such dispute or difference, in respect of which the demand has been made, together with counter claims or set off, given by the Railway, shall be referred to arbitration and other matters shall not be included in the reference.

(1)(ii)(b): The parties may waive off the applicability of Sub-Section 12(5) of Arbitration and Conciliation (Amendment) Act 2015, if they agree for such waiver in writing, after dispute having arisen between them, in the format given under Annexure XV of these conditions.

(1)(iii)(a): The Arbitration proceedings shall be assumed to have commenced from the day, a written and valid demand for arbitration is received by the Railway.

(1)(iii)(b): The claimant shall submit his claims stating the facts supporting the claims along with all the relevant documents and the relief or remedy sought against each claim within a period of 30 days from the date of appointment of the Arbitral Tribunal.

(1)(iii)(c): The Railway shall submit its defense statement and counter claim(s), if any, within a period of 60 days of receipt of copy of claims from Tribunal, unless otherwise extension has been granted by Tribunal.

(1)(iii)(d): Place of Arbitration: The place of arbitration would be within the geographical limits of the Division of the Railway where the cause of action arose or the Headquarters of the concerned Railway or any other place with the written consent of both the parties.

(1)(iv): No new claim shall be added during proceedings by either party. However, a party may amend or supplement the original claim or defense thereof during the course of arbitration proceedings subject to acceptance by Tribunal having due regard to the delay in making it.

(1)(v): If the Contractor(s) does/do not prefer his/their specific and final claims in writing, within a period of 90 days of receiving the intimation from the Railways that the final bill is ready for payment, he/they will be deemed to have waived his/their claim(s) and the Railway shall be discharged and released of all liabilities under the contract in respect of these claims.

(2): Obligation During Pendency of Arbitration: Work under the contract shall, unless otherwise directed by the Engineer, continue during the arbitration proceedings, and no payment due or payable by the Railway shall be withheld on account of such proceedings, provided, however, it shall be open for Arbitral Tribunal to consider and decide whether or not such work should continue during arbitration proceedings.

(3): Appointment of Arbitrator:

(3)(a): Appointment of Arbitrator where applicability of section 12 (5) of Arbitration and Conciliation Act has been waived off:

(3)(a)(i): In cases where the total value of all claims in question added together does not exceed ₹ 1,00,00,000/- (Rupees One Crore), the Arbitral Tribunal shall consist of a Sole Arbitrator who shall be a Gazetted Officer of Railway not below Junior Administrative Grade, nominated by the General Manager. The sole arbitrator shall be appointed within 60 days from the day when a written and valid demand for arbitration is received by General Manager.

(3)(a)(ii): In cases not covered by the Clause 64(3)(a)(i), the Arbitral Tribunal shall consist of a panel of three Gazetted Railway Officers not below Junior Administrative Grade or 2 Railway Gazetted Officers not below Junior Administrative Grade and a retired Railway Officer, retired not below the rank of Senior Administrative Grade Officer, as the arbitrators. For this purpose, the Railway will send a panel of at least four (4) names of Gazetted Railway Officers of one or more departments of the Railway which may also include the name(s) of retired Railway Officer(s) empaneled

to work as Railway Arbitrator to the Contractor within 60 days from the day when a written and valid demand for arbitration is received by the General Manager.

Contractor will be asked to suggest to General Manager at least 2 names out of the panel for appointment as Contractor's nominee within 30 days from the date of dispatch of the request by Railway. The General Manager shall appoint at least one out of them as the Contractor's nominee and will, also simultaneously appoint the balance number of arbitrators either from the panel or from outside the panel, duly indicating the 'presiding arbitrator' from amongst the 3 arbitrators so appointed. General Manager shall complete this exercise of appointing the Arbitral Tribunal within 30 days from the receipt of the names of Contractor's nominees. While nominating the arbitrators, it will be necessary to ensure that one of them is from the Accounts Department. An officer of Selection Grade of the Accounts Department shall be considered of equal status to the officers in Senior Administrative Grade of other departments of the Railway for the purpose of appointment of arbitrator.

3.(a). iii: The serving railway officer working in arbitral tribunal in the ongoing arbitration cases as per clause 64.(3)(a)(i) and clause 64.(3)(a)(ii) above, can continue as arbitrator in the tribunal even after his retirement.

(3)(b): Appointment of Arbitrator where applicability of Section 12 (5) of Arbitration and Conciliation Act has not been waived off:

(i) In cases where the total value of all claims in question added together does not exceed ₹ 50,00,000/- (Rupees Fifty Lakh), the Arbitral Tribunal shall consist of a Retired Railway Officer, retired not below the rank of Senior Administrative Grade Officer, as the arbitrator. For this purpose, the Railway will send a panel of at least four (4) names of retired Railway Officer(s) empaneled to work as Railway Arbitrator duly indicating their retirement dates to the Contractor within 60 days from the day when a written and valid demand for arbitration is received by the General Manager.

Contractor will be asked to suggest to General Manager at least 2 names out of the panel for appointment as arbitrator within 30 days from the date of dispatch of the request by Railway. The General Manager shall appoint at least one out of them as the arbitrator.

(ii) In cases where the total value of all claims in question added together exceed ₹ 50,00,000/- (Rupees Fifty Lakh), the Arbitral Tribunal shall consist of a Panel of three (3) retired Railway Officer, retired not below the rank of Senior Administrative Grade Officer, as the arbitrators. For this purpose, the Railway will send a panel of at least four (4) names of retired Railway Officer(s) empaneled to work as Railway Arbitrator duly indicating their retirement date to the Contractor within 60 days from the day when a written and valid demand for arbitration is received by the General Manager.

Contractor will be asked to suggest to General Manager at least 2 names out of the panel for appointment as Contractor's nominee within 30 days from the date of

dispatch of the request by Railway. The General Manager shall appoint at least one out of them as the Contractor's nominee and will, also simultaneously appoint the balance number of arbitrators either from the panel or from outside the panel, duly indicating the 'Presiding Arbitrator' from amongst the 3 arbitrators so appointed. General Manager shall complete this exercise of appointing the Arbitral Tribunal within 30 days from the receipt of the names of Contractor's nominees. While nominating the arbitrators, it will be necessary to ensure that one of them has served in the Accounts Department.

(3)(c)(i): If one or more of the arbitrators appointed as above refuses to act as arbitrator, withdraws from his office as arbitrator, or vacates his/their office/offices or is/are unable or unwilling to perform his functions as arbitrator for any reason whatsoever or dies or in the opinion of the General Manager fails to act without undue delay, the General Manager shall appoint new arbitrator/arbitrators to act in his/their place in the same manner in which the earlier arbitrator/arbitrators had been appointed. Such re-constituted Tribunal may, at its discretion, proceed with the reference from the stage at which it was left by the previous arbitrator (s).

(3)(c)(ii): (a) The Arbitral Tribunal shall have power to call for such evidence by way of affidavits or otherwise as the Arbitral Tribunal shall think proper, and it shall be the duty of the parties hereto to do or cause to be done all such things as may be necessary to enable the Arbitral Tribunal to make the award without any delay. The proceedings shall normally be conducted based on documents and written statements.

(b) Before proceeding into the merits of any dispute, the Arbitral Tribunal shall first decide and pass its orders over any plea submitted/objections raised by any party, if any, regarding appointment of Arbitral Tribunal, validity of arbitration agreement, jurisdiction and scope of the Tribunal to deal with the dispute (s) submitted to arbitration, applicability of time 'limitation' to any dispute, any violation of agreed procedure regarding conduct of the arbitral proceedings or plea for interim measures of protection and record its orders in day to day proceedings. A copy of the proceedings duly signed by all the members of tribunal should be provided to both the parties.

3(c)(iii): (i) Qualification of Arbitrator (s):

(a) Serving Gazetted Railway Officers of not below JA Grade level.

(b) Retired Railway Officers not below SA Grade level, one year after his date of retirement.

(c) (i) Age of arbitrator at the time of appointment shall be below 70 years.

(ii) An arbitrator may be appointed notwithstanding the total number of arbitration cases in which he has been appointed in the past.

(iii) While appointing arbitrator(s) under Sub-Clause 64.(3)(a)(i), 64.(3)(a)(ii), 64.(3)(b)(i) & 64.(3)(b)(ii) above, due care shall be taken that he/they is/are not

the one/those who had an opportunity to deal with the matters to which the contract relates or who in the course of his/their duties as Railway servant(s) expressed views on all or any of the matters under dispute or differences. A certification to this effect as per annexure- XVI shall be taken from Arbitrators also. The proceedings of the Arbitral tribunal or the award made by such Tribunal will, however, not be invalid merely for the reason that one or more arbitrators had, in the course of his service, opportunity to deal with the matters to which the contract relates or who in the course of his/their duties expressed views on all or any of the matters under dispute.

(3)(d)(i): The arbitral award shall state item wise, the sum and reasons upon which it is based. The analysis and reasons shall be detailed enough so that the award could be inferred there from.

(3)(d)(ii): A party may apply for corrections of any computational errors, any typographical or clerical errors or any other error of similar nature occurring in the award of a Tribunal and interpretation of a specific point of award to Tribunal within 60 days of receipt of the award.

(3)(d)(iii): A party may apply to Tribunal within 60 days of receipt of award to make an additional award as to claims presented in the arbitral proceedings but omitted from the arbitral award.

(4): In case of the Tribunal, comprising of three members, any ruling on award shall be made by a majority of members of Tribunal. In the absence of such a majority, the views of the Presiding Arbitrator shall prevail.

(5): Where the arbitral award is for the payment of money, no interest shall be payable on whole or any part of the money for any period till the date on which the award is made.

(6): The cost of arbitration shall be borne by the respective parties. The cost shall inter-alia include fee of the arbitrator(s), as per the rates fixed by Railway Board from time to time and the fee shall be borne equally by both the parties, provided parties sign an agreement in the format given at Annexure XV to these condition after/ while referring these disputes to Arbitration. Further, the fee payable to the arbitrator(s) would be governed by the instructions issued on the subject by Railway Board from time to time irrespective of the fact whether the arbitrator(s) is/are appointed by the Railway Administration or by the court of law unless specifically directed by Hon'ble court otherwise on the matter.

(7) Subject to the provisions of the aforesaid Arbitration and Conciliation Act 1996 and the rules there under and relevant para of General Conditions of Contract (GCC) and any statutory modifications thereof shall apply to the appointment of arbitrators and arbitration proceedings under this Clause.

29. PROVISIONS OF CONTRACT LABOUR REGULATION AND ABOLITION ACT:

- i. The Contractor shall comply with the provisions of the Contract Labor Regulation and Abolition act 1970 and the Contract Labor Regulation and Abolition Central Rules, 1971, as modified from time to time, wherever applicable, and shall also indemnify the Purchaser from and against any claims under the aforesaid Act and the rules.
- ii. The Contractor shall pay to labor employed by him, directly or through Sub-contractors, the wages as per provisions of the aforesaid Act and the rules, wherever applicable. The Contractor shall, notwithstanding the provisions of the contract, cause to be paid the wages to labor indirectly engaged on the work including any engaged by his sub-contractors in connection with the said work, as if the labor has been immediately employed by him.
- iii. In respect of all labor directly or indirectly employed in the work for performance of the Contractor's part of the contract, the Contractor shall comply with or cause to be complied with the provisions of the aforesaid Act and the rules wherever applicable.

30. Minimum Wages Act, Labor Laws:

- a) The contractor shall comply with all the legal provisions pertaining to industrial labor and hours of employment regulations in force. The wages to be paid to the contractor's staff shall necessarily be in accordance with the provisions of the MINIMUM WAGES ACT, 1948 as amended from time to time. The risk to the life and limb of the contractor's staff shall be covered by the contractor by way of an insurance policy. Compensation to the contractor's staff in case of accidents or otherwise shall be made by the contractor only. **Further it is the responsibility of the contractor to ensure that the provisions of the Contract Labor (Regulation and abolition) Act/Rule are not violated.**
- b) The contractor should submit a proof of having paid Minimum wages to the labor engaged by him as per the Minimum Wages Act during the contract period.

31. Jurisdiction of the Courts: The courts of the place where the contract has been entered by South Central Railway i.e., courts of Nanded shall alone have the Jurisdiction to decide any dispute arising out of or in the respect of the contract.

32. Subletting and Assignment: Subletting of work or part of the work in any manner is not permitted without specific permission in writing of Railway. Any breach of this condition shall make the contractor liable for terminating the contract and forfeiting Security deposit and en-cashing the performance guarantee.

Clause 7 of Standard General Conditions of Contract (Part-II) clearly specify that the Contractor shall not assign or sublet the contract or any part thereof or allow any person to become interested therein in any manner whatsoever without the special permission

in writing of the Railway. Any breach of this condition shall entitle the Railway to rescind the contract under Clause 62 of GCC and also render the contractor liable for payment to the Railway in respect of any loss or damage arising or ensuing from such cancellation provided always that execution of the details of the work by petty contractor under the direct and personal supervision of the Contractor or his agent shall not be deemed to be sub-letting under this clause. The permitted subletting of work by the Contractor shall not establish any contractual relationship between the sub-contractor and the Railway and shall not relieve the Contractor of any responsibility under the Contract.

- 33. Accidents:** The Bidder shall indemnify and keep the Purchaser/Consignee Indemnified and harmless against all actions, suits, claims, demands, costs, charges or expenses arising in connection with any death or injury sustained by any person or persons within the Railway premises and any loss or damage to Railway property sustained due to the acts or omission of the Bidder's his agents or his staff during the execution of this contract irrespective of whether such liability arises under the Workman's Compensation act, or Fatal Accident Act or Factory Act or Payment of Wages Act or any other statute in force for the time being. Railway will not be responsible for any accident (fatal or non-fatal) or injury to any personnel of the contractor or any financial implications, arising there upon.

In case of Injury or accidents/deaths of contractor staff, the full responsibility, and all consequences thereof, shall lie with the contractor only. The Railways shall pay no compensation whatsoever in this regard. Any litigation or any law-and-order problems arising due to accidents or deaths shall be the total responsibility of the contractor. The Railway shall not bear any responsibility and the Railway will not pay any compensations.

34. Additional conditions / precautions:

- a. When the work required to be carrying out on the track itself or as close to the track as may pose a hazard to rail traffic. The work shall be carried out under the supervision of an authorized Railway representative only.
- b. During the execution of the works, the contractor or his representative shall not leave the site where the works are being carried out. At the site of work the contractor shall always make available one representative who shall be approved by Railway administration who shall be invested with adequate powers by the contractor so that orders or instructions given to the said representative by the Railway Administration in writing could be considered as duly given or conveyed to the contractor himself. Representative of the Railway will check up the work from time to time.
- c. Whenever the cable route is extremely near or over the embankment due to non-availability of space, the route marking shall be given in consultation with Railway Civil Engineering Officials. In these stretches the contractor shall complete the work in minimum possible time.

- d. The progress of trenching, availability of cable, bricks, pipes etc. shall be closely coordinated to ensure that the trenches remain open for minimum possible time.
- e. Whenever the track crossing is to be done, the same shall be done in least possible time in the presence of Railway Civil Engineering representative.
- f. The contractor shall not allow any road vehicle belonging to him or his suppliers etc. to ply in Railway land next to the running line. If permitted by Railway Administration for execution of certain works such as supply of ballast, sand etc. the following precautions must be taken by the contractor in the presence of Rly. representative.
 - i) The road vehicles will ply only between sunrise and sunset.
 - ii) Nominated vehicle and drivers will be utilized for work in the presence of at least one flagman and one supervisor certified for such work.
 - iii) The vehicles shall ply 6.0 Mtrs. Clear track. Any movement/work at less than 6 Mtrs. And up to minimum 3 Mtrs. Clear of track centre shall be done only in the presence of Rly. Employee authorized by Engineer-in-charge. No part of the road vehicle allowed at less than 3.5 Mtrs. from the track center.
 - iv) The contractor shall remain fully responsible for ensuring safety and in case of any accident, shall bear cost of all damages to his equipment and men and also damages to Railway and its passengers.
- g. Vehicles and equipment of contractors can be drafted by Railway Administration in case of accidents / natural calamities involving human lives.
- h. It shall be the responsibility of the contractor to keep in safe custody, any railway materials, plant or equipment issued for the work.
- i. Within the station premises and especially on passenger platforms the contractor shall ensure sufficient free space for movement of passenger traffic. He must cover and protect the excavations carried out in such areas with a view to avoid any accidents.
- j. The works must be carried out most carefully in such a way that they do not hinder the Railway operation except as agreed to by the Railway.
- k. The contractor shall abide by the Indian Electricity Act and the Indian Electricity Rules as amended from time to time. When not in use, no electrical apparatus which is liable to be a source of danger shall remain electrically charged.

35. IMPORTANT NOTE: During execution of work, the Bidder should assess the variation in quantity of items if any and should obtain prior approval of Senior Divisional Electrical Engineer through the Railway engineer at site.

Bidder(s) shall go through the above particulars, instructions fully and understand and accept. He/She/They is/are bound by all the conditions referred in above.

**** ** ***

SCHEDULE OF RATES

Tender No. NED-E-07-2026-27

Schedule A- Improvement to availability of Water in Nanded Division by providing Borewells, pipeline connection, tanks etc. in Sr. DEN/W/NED Section - Electrical Arrangements.

S. No	Description of Work	Qty	Unit	Rate	Total
1	Supply of 10HP Energy efficient Horizontal open well submersible pump set, 3 phase 415 volts, AC supply, 50Hz in operating in a wide voltage dynamically balanced rotor and impeller ensure vibration free performance and enhanced life, pump size: 65x50mm, Head: 48 mtrs, LPS:714, RPM: 2880.	2	Nos	63225	126450
2	Erection of 10HP Energy efficient Horizontal open well submersible pump set, 3 phase 415 volts, AC supply, 50Hz in operating in a wide voltage dynamically balanced rotor and impeller ensure vibration free performance and enhanced life, pump size: 65x50mm, Head: 48 trs, LPS:714, RPM: 2880.	2	Nos	12923	25846
3	Supply of Horizontal open well submersible pump of 5.0 HP with a total head of 30 Mtrs, with a discharge of 570 LPM suitable to work on 440V Three phase RPM:2880, Delivery Size 50 mm	3	Nos	34605	103815
4	Erection of Horizontal open well submersible pump of 5.0HP with a total head of 30 Mtrs, with a discharge of 570 LPM suitable to work on 440V Three phase RPM:2880, Delivery Size 50mm	3	Nos	11929	35787
5	Supply of 5.0 HP 43 stage Energy efficient Vertical submersible pump set, Three Phase ,415 Vol, suitable for 100mm dia bore well pump set Delivery size : 32mm, Head 284 Mtr, LPM @58"44@ RPM :2880	12	Nos	52290	627480
6	Erection, connecting, testing and commissioning of 5.0 HP 43 stage Energy efficient Vertical submersible pump set , Three Phase ,415 Vol, suitable for 100mm dia bore well pump set Delivery size : 32mm, Head 284Mtr ,LPM @58"44@ RPM :2880	12	Nos	12426	149112
7	Supply of 3.0 HP 30 stage Energy efficient Vertical submersible pump set, Three Phase ,415 Vol, suitable for 100mm dia bore well pump set Delivery size : 32mm, Head 146 Mtr, LPM :36, RPM :2880.	11	Nos	32646	359106

8	Erection, connecting, testing and commissioning of 3.0 HP 30 stage Energy efficient Vertical submersible pump set , Three Phase ,415 Vol, suitable for 100mm dia bore well pump set Delivery size : 32mm, Head146 Mtr, LPM :36, RPM :2880.	11	Nos	11929	131219
9	Supply of 2.0 HP 30 stage Energy efficient Vertical submersible pump set, Single Phase ,415 Vol, suitable for100mm dia bore well pump set Delivery size : 32mm, Head 135 Mtr, LPM :36, RPM :2880.	8	Nos	28034	224272
10	Erection, connecting, testing and commissioning of 2.0 HP 30 stage Energy efficient Vertical submersible pump set , Single Phase ,415 Vol, suitable for 100mm dia bore well pumpset Delivery size : 32mm, Head 135Mtr ,LPM :36, RPM :2880.	8	Nos	9941	79528
11	Supply of 1.0 HP 16 stage Energy efficient Vertical submersible pump set, Single Phase, suitable for100mm dia bore well pump set Delivery size :32 Head 104 Mtr ,LPM:14, RPM :2880.	14	Nos	18421	257894
12	Erection, connecting, testing and commissioning of 1.0 HP 16 stage Energy efficient Vertical submersible pump set , Single Phase, suitable for 100mm dia bore well pumps et Delivery size :32 Head 104 Mtr, LPM :14, RPM :2880.	14	Nos	9941	139174
13	Supply of pump panel suitable for1.0HP Single phase Submersible pump comprising of 2 pole contactor, relay, ammeter, voltmeter relay range from 6 to 10 Amps, run capacitor 36+20 mfd, start capacitor 120/150 mfd, complete with all other connected accessories	14	Nos	5786	81004
14	Fabrication, fixing, testing and commissioning of pump panel suitable for 1.0HP Single phase Submersible pump comprising of 2 pole contactor, relay, ammeter, voltmeter relay range from 6 to 10 Amps, run capacitor36+20 mfd, start capacitor 120/150mfd, complete with all other connected accessories	14	Nos	994	13916

15	Supply of pump panel suitable for 2.0HP Single phase Submersible pump comprising of 2 pole contactor, relay, ammeter, voltmeter relay range from 6 to 10 Amps, run capacitor 36+20 mfd, start capacitor 120/150 mfd, complete with all other connected accessories	8	Nos	6158	49264
16	Fabrication, fixing, testing and commissioning of pump panel suitable for 2.0HP Single phase Submersible pump comprising of 2 pole contactor, relay, ammeter, voltmeter relay range from 6 to 10 Amps, run capacitor 36+20 mfd, start capacitor 120/150mfd, complete with all other connected accessories	8	Nos	1491	11928
17	Supply of pump panel suitable for 3.0HP centrifugal/Submersible pump comprising of motor protection circuit breaker, DOL starter, electronic overcurrent relay, 2KVAR capacitor, ammeter, voltmeter, LED pilot lamps, timer switch complete with all other connected accessories	11	Nos	18490	203390
18	Fabrication, Fixing, testing and commissioning of pump panel suitable for 3.0HP centrifugal/Submersible pump comprising of motor protection circuit breaker, DOL starter, electronic over current relay, 2KVAR capacitor, ammeter, voltmeter, LED pilot lamps, timer switch complete with all other connected accessories	11	Nos	1988	21868
19	Supply of pump panel suitable for 5.0HP centrifugal/Submersible pump comprising of motor protection circuit breaker, DOL starter, electronic overcurrent relay, 2KVAR capacitor, ammeter, voltmeter, LED pilot lamps, timer switch complete with all other connected accessories	15	Nos	19385	290775
20	Fabrication, Fixing, testing and commissioning of pump panel suitable for 5.0HP centrifugal/Submersible pump comprising of motor protection circuit breaker, DOL starter, electronic over current relay, 2KVAR capacitor, ammeter, voltmeter, LED pilot lamps, timer switch complete with all other connected accessories	15	Nos	1988	29820

21	Supply of Fully automatic Star Delta Starter with wideband coil Single Phasing preventer all connected accessories suitable for operation on 415V, 3Ph 50Hz AC supply Relay range 30-50, coil voltage: 380V test and Guarantee certificate should be provided at the time of supply, similar to Make: M/s. BCH/L&T/ C&S as per the direction of Engineer at site (for up to 10.0HP)	2	Nos	34555	69110
22	Testing & commissioning of Fully automatic Star Delta Starter with wide band coil Single Phasing preventer all connected accessories suitable for operation on 415V, 3Ph 50Hz AC supply Relay range 30-50, coil voltage: 380V test and Guarantee certificate should be provided at the time of supply, similar to Make: M/s. BCH/L&T/ C&S as per the direction of Engineer at site (for up to 10.0HP)	2	Nos	2982	5964
23	Supply of 3 core 6 Sq.mm copper flat cable as per the direction of site Engineer.	260	Mtrs	266	69160
24	Laying, connecting and commissioning of 3 core 6 Sq.mm copper flat cable as per the direction of site Engineer.	260	Mtrs	26	6760
25	Supply of 3 core 4 Sq.mm copper flat cable as per the direction of site Engineer	2100	Mtrs	184	386400
26	Laying, connecting and commissioning of 3 core 4 Sq.mm copper flat cable as per the direction of site Engineer.	2100	Mtrs	16	33600
27	Supply of 3 core 2.5 Sq.mm copper flat cable as per the direction of site Engineer	3300	Mtrs	117	386100
28	Laying, connecting and commissioning of 3 core 2.5 Sq.mm copper flat cable as per the direction of site Engineer.	3300	Mtrs	12	39600
29	Supply and fixing of Rope for lifting and lowering of pumps inside the bore.	600	Kgs	161	96600

30	Providing and fixing sheet metal work in CRCA sheet with fabrication of boxes panel boards etc. including cutting, bending, drilling, welding, riveting etc. treated with anti-rust treatment and duly power coated as per the above specification.	2000	Kgs	249	498000
31	Supplying and erecting of 50 mm x 5 mm size electrolyte copper patti or bar in bus bar chamber / in panel or any other purpose, 500 V with required capacity with 99.9% copper purity with fixing arrangement (like lug or bottle type lug) to both the end with high grade polyolefin insulation sleeve complete	300	Kgs	1130	339000
32	Supplying and erecting LT current transformer with bar primary 50/5 to 1000/5 ratio with 15 VA burden erected in provided CRCA box duly secured with insulating materials connected to the meter with test certificates.	33	Nos	878	28974
33	Supplying and erecting panel mounting type digital ammeter having three and half digit LED display, external CT operated, calibrated for 0 to 1000 A AC supply with necessary PVC wire leads and lugs and mounting hardware on provided panel complete with calibration certificate from manufacturer suitable to operate on 500V.	11	Nos	1361	14971
34	Supplying and erecting panel mounting type digital voltmeter having Three and half digit LED display, calibrated for 0-750V AC suitable to operate on 500V AC supply with necessary PVC wire leads and lugs and mounting hardware on provided panel complete with calibration certificate from manufacturer suitable to operate on 500V.	11	Nos	1305	14355
35	Supplying and erecting selector switch suitable for voltmeter/ammeter for 3 phase AC supply 500/1000V, 50Hz, on provided box / panel and duly connecting with necessary PVC wire leads and lugs.	22	Nos	320	7040
36	Supply & provision of 3 Nos RYB indication lamps of LED type including with all connected accessories complete.	14	Set	438	6132
37	Supply, erection, testing and commissioning of all material, excavation, and casting of cement concrete foundation/concreting in ratio 1:3:6	40	Cum	6007	240280

38	Supply, fixing and connecting of Cable Junction Boxes IP 55/IP 65 with metric knockouts for cable entry Cable junction boxes of model no. K 9504 of Hensel make conforming to IS:13573/92,IEC 60947-3 with its latest amendments, with necessary terminals suitable for cables up to 50 Sq mm and all necessary accessories complete.	2	Set	7311	14622
39	Supply, Laying, Testing and Termination of LTUG 4 core 25 sqmm XLPE insulated PVC sheathed Aluminium armoured cable as per IS 7098 (Part 1) 1988 with latest amendments and with necessary lugs and terminations complete.	2400	Mtrs	203	487200
40	Supply, Laying, Testing and Termination of 1.1 KV Grade 4 core 50 sqmm XLPE insulated PVC sheathed Aluminium armoured cable as per IS 7098(Part 1)1988 with latest amendments and with necessary lugs and terminations complete.	7000	Mtrs	341	2387000
41	Supply, Laying, Testing and Termination of 1.1 KV Grade 4 core 16 sq.mm XLPE insulated PVC sheathed Aluminium armoured cable as per IS 7098(Part 1)1988 with latest amendments and with necessary lugs and terminations complete.	3800	Mtrs	141	535800
42	Supply, erecting and laying of HDPE pipe of PE-80 grade in PN-4 outer dia of HDPE pipe 63 mm (nearest 2" dia) and wall thickness minimum 2.5 mm maximum 2.8mm with "T" joints, bends, elbows etc. including all other connected accessories. Make: M/s. Sudhakar/ Nagarjuna polymer/Nandi/Plasto	13200	Mtrs	124	1636800
43	Cutting of esphated road/ concrete/ cement/under the track etc., and excavation of cable trench 30cm widex90cm deep road etc., for laying of HT/LTUG cable. After laying of cable the trench should be brought to its original position by providing tar/ concrete/ cement as per the site conditions and as per directions of Rly.Engineer.	800	Mtrs	203.00	162400
44	Excavation of cable trench 30 cm wide x 90cm deep in all types of soils for HT/LTUG cable as per specification	6400	Mtrs	122.00	780800
45	Supply and running of 8 SWG GI wire is to be laid for earth continuity.	14200	Mtrs	12.00	170400

46	Supply and erection of earth electrode as per the enclosed specification (including digging earth pit, electrode earth box with reinforced concrete complete with all connected materials and works including connecting the earth electrode and aerial earthing according to IS 3043 and RDSO drawing ETI/OHE/P/7021 in other than substations.	46	No	3798.00	174708
47	Supply of 100 mm dia 'B' class ERW GI pipe conforming to IS: 1239 Part 1(2004)and fixing with suitable clamps on wall/building including laying of cable through GI pipe.	200	Mtrs	1074	214800
48	Supply and fixing of C curve DP MCBs of 16/20/32 A with all connected accessories.	22	Nos	862	18964
49	Supply and fixing of C curve FP MCBs of 32 A with all connected accessories.	36	Nos	2156	77616
50	Supply and installation of DPX3 160 thermal magnetic based release ; Icu = 36K A; 100A 4 Pole MCCB conformto IEC 60947-2 of model no. 4200 95 of Legrand make or equivalent make with extended ROM , spreader links (2sets).	6	Nos	9139	54834
51	Supply and fixing of 32 A 4P MCB B Curve IS/IEC 60898-1 (2002) 10 kA breaking capacity IP20protected terminals of model no.402463 of Legrand make or it's equivalent.	12	Nos	2221	26652
52	Supply, fixing, testing and commissioning of Microprocessor Release 200-250 A; 4Pole, MCCB suitable for operation on 415V,50 Hz 3 Phase AC supply in LT Panel with supply of all connected accessories and allied materials as per specification attached. Make: L&T/Legrand/Havells Or Similar	1	Nos	22546	22546
	Grand Total				11968836

Note: above Schedule Rates are inclusive of GST.

NOTE ON PRICE SCHEDULE


1. The rates shall also be inclusive of accessories, fittings, clamps, supportive pipes, bolts, and nuts etc.
2. The rates quoted shall be NET and firm inclusive of all taxes, duties, transport charges etc. both in figures and words.
3. The tenderers are requested to inspect the site before quoting.
4. The contractors are requested to visit the site before procurement of cables to assess the exact requirement of cables.
5. Tenderers must specifically mention the brands offered and relevant technical details specifications, catalogues etc.
6. The exact locations of the work will be shown by the engineer at site.
7. The contractor at his own cost shall make good any damages during the execution of work.
8. The successful tenderer should submit the sample to Sr. DEE/M/NED and obtain the approval for each item before procuring in lot.
9. All the fittings/equipment/materials shall be provided of preferred makes as mentioned in Schedule. If preferred, make is not mentioned or if contractor wants to supply products of other than preferred make, then a sample with relevant test certificates to be approved by Sr. DEE/M/NED for quality purpose.
10. The contractor shall provide all approved makes/models. However, the samples of all items/technical details etc. covered in the contract are necessarily to be got approved by Sr. Divnl. Elect. Engineer/Asst. Divnl. Elec. Engineer/NED before supplying/execution of work.
11. The work shall be executed as per the directions of the site Engineers of Railways.
12. Earthing arrangements shall be as per Railway specifications/standards.
13. Any doubts on purview of scope of work shall be got clarified personally from Division Executive i.e., Sr. Divl. Elect. Engr./Nanded to get better understanding on scope/essence of the contract.

Tenderer shall agree to abide by the extant rules and regulations of Railways, stipulated general conditions of the contract and the rules laid down in special conditions of the contract.

GENERAL CONDITIONS OF CONTRACT

1. “The General Conditions of Contract” governing the performance of the works covered by this tender “Standard General Conditions of Contract in use in General in the South- Central Railway ”as amended from time to time is applicable. The copy of the booklet incorporating above general conditions of the contract may be verified from the office of the Senior Divisional Elec. Engineer/Maintenance/Nanded Division, South central Railway at DRM Complex, Sanghvi Naka, Nanded, Maharashtra.
2. By submission of this letter, it would be deemed that the Bidder has kept himself fully informed of the provisions of the General Conditions of Contract including all corrections and amendments issued up to the date of tender notice.
3. Railway Board vide their letter No. 2022/CE-I/CT/GCC-2022/Policy dated 27-04-2022 has issued Amendment to General Conditions of Contract (works contracts) is applicable to this contract.

Bidder shall go through the general conditions of contract governing the performance of works covered in this tender, and He/she/They shall keep himself/herself/Themselves fully informed of and shall agree to the provisions of these general conditions.

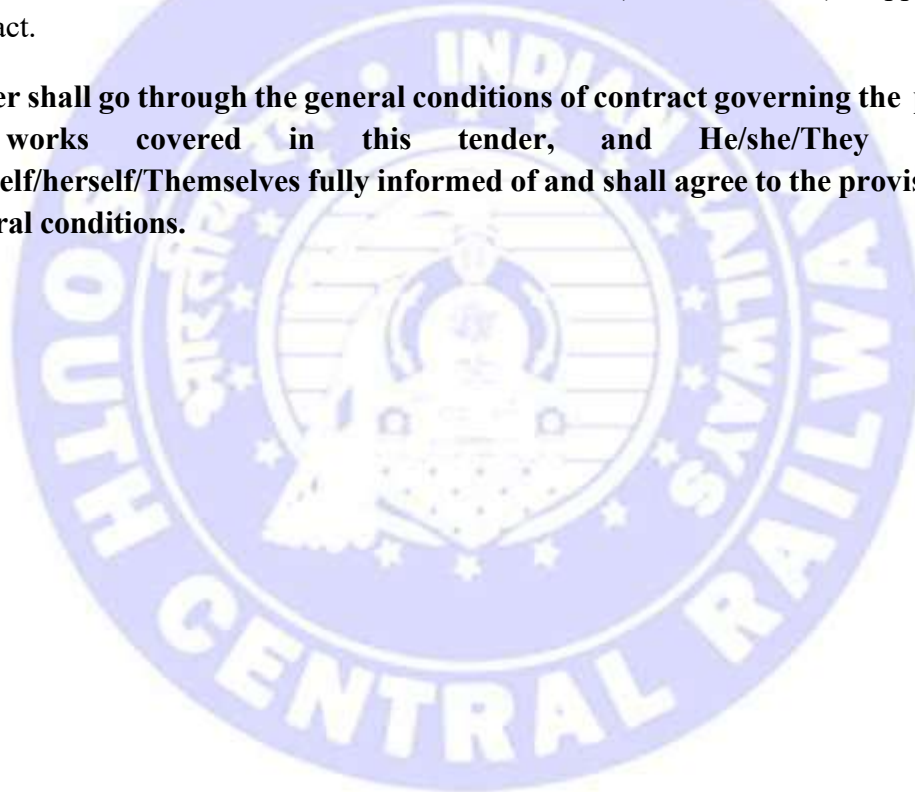

INSPECTION OF ITEMS

I) List of items identified for inspection of RITES irrespective of Value

S. No.	Item
1.	D. G. Sets above 10 KVA capacity
2.	Transformers for substations
3.	Outdoor 11 kV/ 33 kV Circuit Breakers
4.	Solar PV panel above 1 KWp
5.	Package Substation
6.	Hybrid Solar PV & wind system
7.	Escalators and Elevators
8.	Modular chilled water coolers
9.	Portals for lighting purpose
10.	CLS panels
11.	High Mast towers

II) List of items identified for more than ₹.5 Lakhs for inspection of RITES

S. No.	Item
1	Distribution Boards / Panel boards
2	Sockets/Switches/Concealed or surface GI Boxes/Regulators/Angle holders / ceiling rose
3	LT cables under Rate Contract
4	LT Switch gears/Fuse units/Change over switches
5	RCC spun pipes
6	Cross arms
7	Polycarbonate boxes
8	PVC/metallic conduit pipes, PVC Casing & Capping channels and their accessories
9	Maintenance free earthing materials/GI Pipe earthings/GI Flat earthing
10	Sheet Mould Compound (SMC)/GI/Track lead Junction Boxes
11	Cable trays and associated accessories
12	LV transformers used for distribution purpose
13	Signage Boards
14	Occupancy sensors
15	BD siren
16	Air coolers
17	Hot water geysers
18	Stabilizers / voltage regulators
19	GI ducting/Grills/Dampers/Valves/Pumps/M S pipes etc. related to Chillers/Package units
20	CLS panel Accessories
21	Evaporative air-cooling system
22	Solar water heating systems under Rate contract
23	GI/HDPE/Composite/CPVC pipes
24	T5/MH/CFL/HPSV/Induction/Luminaries and lamps/Electronic ballast
25	PVC Copper/aluminium wires/Flat cables
26	Invertors / Convertors / Solar Charge controllers

27	UPS
28	LED based Luminaries/ Power supply units
29	Water coolers
30	Soft starters
31	Centrifugal /Submersible / Jet / Booster Pumps
32	VVF, VF, VVVF drives
33	HT equipment AB switches / Dropout fuses / LA sets
34	Air conditioners / Curtains
35	Pre-cooling sockets
36	HT cables & LT UG Cables
37	Chillers Plants / Package Units / AHUs
38	Battery Chargers
39	Conical / Swaged poles along with brackets
40	GSM/ GPRS related automation equipment
41	Ceiling / Exhaust / Axial flow fans/ Air circulators
42	Electric Motors
43	Metering equipment
44	Cable termination Kits
45	ACSR Conductor / Insulators
46	Capacitor banks / APFC Panels
47	Power savers / Energy saving equipment
48	AVRs
49	Fire alarm system
50	Lead Acid / Ni-cd/VRLA/SMF type Batteries

NOTE: 1. All other items which are not covered in the list I & II having value above Rs.5 lakhs required RITES inspection.

2. Items costs below 5 lakhs mentioned in in the list -II will be inspected by consignee. For consignee inspection, the firm should submit Guarantee/Warranty certificate, Test certificate from OEM.

** ** *

SCOPE OF WORK & SPECIFICATIONS

Name of work: Improvement to availability of Water in Nanded Division by providing Borewells, pipeline connection, tanks etc. in Sr. DEN/W/NED Section - Electrical Arrangements.

Schedule A:

Item 1

Supply of 10HP Energy efficient Horizontal open well submersible pump set, 3 phase 415 volts, AC supply, 50Hz in operating in a wide voltage dynamically balanced rotor and impeller ensure vibration free performance and enhanced life, pump size: 65x50mm, Head: 48 trs, LPS:714, RPM: 2880 as per site requirement decided by Rly. Engineer. Make: Taro/ Texmo/ Lubi/ Waterman/ Crompton/ Kirloskar/ CRI (OR) Similar.

Item 2

Erection of 10HP Energy efficient Horizontal open well submersible pump set, 3 phase 415 volts, AC supply, 50Hz in operating in a wide voltage dynamically balanced rotor and impeller ensure vibration free performance and enhanced life, pump size: 65x50mm, Head: 48 trs, LPS:714, RPM: 2880

Item 3

Supply of Horizontal open well submersible pump of 5.0HP with a total head of 30 Mtrs, with a discharge of 570 LPM suitable to work on 440V Three phase RPM:2880 as per site requirement decided by Rly. Engineer. Make: Taro/ Texmo/ Lubi/ Waterman/ Crompton/ Kirloskar/ CRI (OR) Similar.

Item 4

Erection of Horizontal open well submersible pump of 5.0HP with a total head of 30 Mtrs, with a discharge of 570 LPM suitable to work on 440V Three phase RPM:2880

Item 5

Supply of 5.0 HP 43 stage Energy efficient Vertical submersible pump set, Three Phase ,415 Vol, suitable for 100mm dia bore well pump set Delivery size: 32mm, Head 284 Mtr, LPM @58"44@ RPM :2880 as per site requirement decided by Rly. Engineer. Make: Taro/ Texmo/ Lubi/ Waterman/ Crompton/ Kirloskar/ CRI (OR) Similar.

Item 6

Erection, connecting, testing and commissioning of 5.0 HP 43 stage Energy efficient Vertical submersible pump set, Three Phase ,415 Vol, suitable for 100mm dia bore well pump set Delivery size: 32mm, Head 284Mtr, LPM @58"44@ RPM :2880.

Item 7

Supply of 3.0 HP 30 stage Energy efficient Vertical submersible pump set, Three Phase ,415 Vol, suitable for 100mm dia bore well pump set Delivery size: 32mm, Head 146 Mtr, LPM :36, RPM :2880. as per site requirement decided by Rly. Engineer. Make: Taro/ Texmo/ Lubi/ Waterman/ Crompton/ Kirloskar/ CRI (OR) Similar.

Item 8

Erection, connecting, testing and commissioning of 3.0 HP 30 stage Energy efficient Vertical submersible pump set , Three Phase ,415 Vol, suitable for 100mm dia bore well pump set Delivery size: 32mm, Head146 Mtr, LPM :36, RPM :2880.

Item 9

Supply of 2.0 HP 30 stage Energy efficient Vertical submersible pump set, Single Phase ,415 Vol, suitable for100mm dia bore well pump set Delivery size: 32mm, Head 135 Mtr, LPM :36, RPM :2880. as per site requirement decided by Rly. Engineer. Make: Taro/ Texmo/ Lubi/ Waterman/ Crompton/ Kirloskar/ CRI (OR) Similar.

Item 10

Erection, connecting, testing and commissioning of 2.0 HP 30 stage Energy efficient Vertical submersible pump set , Single Phase ,415 Vol, suitable for 100mm dia bore well pump set Delivery size : 32mm, Head 135Mtr, LPM :36, RPM :2880.

Item 11

Supply of 1.0 HP 16 stage Energy efficient Vertical submersible pump set, Single Phase, suitable for100mm dia bore well pump setDelivery size :32 Head 104 Mtr ,LPM:14, RPM :2880. as per site requirement decided by Rly. Engineer. Make: Taro/ Texmo/ Lubi/ Waterman/ Crompton/ Kirloskar/ CRI (OR) Similar.

Item 12

Erection, connecting, testing and commissioning of 1.0 HP 16 stage Energy efficient Vertical submersible pump set, Single Phase, suitable for 100mm dia bore well pump set Delivery size :32 Head 104 Mtr, LPM :14, RPM :2880.

Item 13

Supply of pump panel suitable for1.0HP Single phase Submersible pump comprising of 2 pole contactor, relay, ammeter, voltmeter relay range from 6 to 10 Amps, run capacitor 36+20 mfd, start capacitor 120/150 mfd, complete with all other connected accessories. Make: BCH/ C&S/ L&T/ Schnieder (OR) Similar

Item 14

Fabrication, fixing, testing and commissioning of pump panel suitable for 1.0HP Single phase Submersible pump comprising of 2 pole contactor, relay, ammeter, voltmeter relay range from 6 to 10 Amps, run capacitor36+20 mfd, start capacitor 120/150mfd, complete with all other connected accessories.

Item 15

Supply of pump panel suitable for2.0HP Single phase Submersible pump comprising of 2 pole contactor, relay, ammeter, voltmeter relay range from 6to 10 Amps, run capacitor 36+20 mfd, start capacitor 120/150 mfd, complete with all other connected accessories. Make: BCH/ C&S/ L&T/ Schnieder (OR) Similar.

Item 16

Fabrication, fixing, testing and commissioning of pump panel suitable for 2.0HP Single phase Submersible pump comprising of 2 pole contactor, relay, ammeter, voltmeter relay range from 6 to 10 Amps, run capacitor 36+20 mfd, start capacitor 120/150mfd, complete with all other connected accessories.

Item 17

Supply of pump panel suitable for 3.0HP centrifugal/Submersible pump comprising of motor protection circuit breaker, DOL starter, electronic overcurrent relay, 2KVAR capacitor, ammeter, voltmeter, LED pilot lamps, timer switch complete with all other connected accessories. Make: BCH/ C&S/ L&T/ Schnieder (OR) Similar

Item 18

Fabrication, Fixing, testing and commissioning of pump panel suitable for 3.0HP centrifugal/Submersible pump comprising of motor protection circuit breaker, DOL starter, electronic over current relay, 2KVAR capacitor, ammeter, voltmeter, LED pilot lamps, timer switch complete with all other connected accessories.

Item 19

Supply of pump panel suitable for 5.0HP centrifugal/Submersible pump comprising of motor protection circuit breaker, DOL starter, electronic overcurrent relay, 2KVAR capacitor, ammeter, voltmeter, LED pilot lamps, timer switch complete with all other connected accessories.

Item 20

Fabrication, Fixing, testing and commissioning of pump panel suitable for 5.0HP centrifugal/Submersible pump comprising of motor protection circuit breaker, DOL starter, electronic over current relay, 2KVAR capacitor, ammeter, voltmeter, LED pilot lamps, timer switch complete with all other connected accessories.

Item 21

Supply of Fully automatic Star Delta Starter with wideband coil Single Phasing preventer all connected accessories suitable for operation on 415V, 3Ph 50Hz AC supply Relay range 30-50, coil voltage: 380V test and Guarantee certificate should be provided at the time of supply, similar to Make: M/s. BCH/L&T/ C&S as per the direction of Engineer at site (for up to 10.0HP). Make: BCH/ C&S/ L&T/ Schnieder (OR) Similar

Item 22

Testing & commissioning of Fully automatic Star Delta Starter with wideband coil Single Phasing preventer all connected accessories suitable for operation on 415V, 3Ph 50Hz AC supply Relay range 30-50, coil voltage: 380V test and Guarantee certificate should be provided at the time of supply, similar to Make: M/s. BCH/L&T/ C&S as per the direction of Engineer at site (for up to 10.0HP)

Item 23

Supply of 3 core 6 Sq.mm copper flat cable as per the direction of site Engineer. Make: Finolex, Polycab, Havells, KEI, Finecab or similar.

Item 24

Laying, connecting and commissioning of 3 core 6 Sq.mm copper flat cable as per the direction of site Engineer. Make: Finolex, Polycab, Havells, KEI, Finecab or similar.

Item 25

Supply of 3 core 4Sq.mm copper flat cable as per the direction of site Engineer. Make: Finolex, Polycab, Havells, KEI, Finecab or similar.

Item 26

Laying, connecting and commissioning of 3 core 4Sq.mm copper flat cable as per the direction of site Engineer. Make: Finolex, Polycab, Havells, KEI, Finecab or similar.

Item 27

Supply of 3 core 2.5 Sq.mm copper flat cable as per the direction of site Engineer. Make: Finolex, Polycab, Havells, KEI, Finecab or similar.

Item 28

Laying, connecting and commissioning of 3 core 2.5 Sq.mm copper flat cable as per the direction of site Engineer. Make: Finolex, Polycab, Havells, KEI, Finecab or similar.

Item 29

Supply and fixing of Rope for lifting and lowering of pumps inside the bore.

Item 30

Providing and fixing sheet metal work in CRCA sheet with fabrication of boxes panel boards etc. including cutting, bending, drilling, welding, riveting etc. treated with anti-rust treatment and duly power coated as per the above specification.

Item 31

Supplying and erecting of 50 mm x 5 mm size electrolyte copper patti or bar in bus bar chamber / in panel or any other purpose, 500 V with required capacity with 99.9% copper purity with fixing arrangement (like lug or bottle type lug) to both the end with high grade polyolefin insulation sleeve complete

Item 32

Supplying and erecting LT current transformer with bar primary 50/5 to 1000/5 ratio with 15 VA burden erected in provided CRCA box duly secured with insulating materials connected to the meter with test certificates.

Item 32

Supplying and erecting panel mounting type digital ammeter having three and half digit LED display, external CT operated, calibrated for 0 to 1000 AAC supply with necessary PVC wire leads and lugs and mounting hardware on provided panel complete with calibration certificate from manufacturer suitable to operate on 500V.

Item 33

Supplying and erecting panel mounting type digital ammeter having three and half digit LED display, external CT operated, calibrated for 0 to 1000AAC supply with necessary PVC wire leads and lugs and mounting hardware on provided panel complete with calibration certificate from manufacturer suitable to operate on 500V.

Item 34

Supplying and erecting panel mounting type digital voltmeter having Three and half digit LED display, calibrated for 0-750V AC suitable to operate on 500VAC supply with necessary PVC wire leads and lugs and mounting hardware on provided panel complete with calibration certificate from manufacturer suitable to operate on 500V.

Item 35

Supplying and erecting selector switch suitable for voltmeter/ammeter for 3phase AC supply 500/1000V, 50Hz, on provided box / panel and duly connecting with necessary PVC wire leads and lugs.

Item 36

Supply & provision of 3 Nos RYB indication lamps of LED type including with all connected accessories complete.

Item 37

Supply, erection, testing and commissioning of all material, excavation, and casting of cement concrete foundation/concreting in ratio 1:3:6

Item 38

Supply, fixing and connecting of Cable Junction Boxes IP 55/IP 65 with metric knockouts for cable entry Cable junction boxes of model no. K 9504 of Hensel make conforming to IS:13573/92, IEC 60947-3 with its latest amendments, with necessary terminals suitable for cables up to 50 Sq mm and all necessary accessories complete.

Item 39-45

Supply, Laying, Testing and Termination of LTUG 4 core 25 sqmm XLPE insulated PVC sheathed Aluminium armoured cable as per IS 7098 (Part 1) 1988 with latest amendments and with necessary lugs and terminations complete. Make: Finolex, Polycab, Havells, KEI, Finecab or similar.

Supply, Laying, Testing and Termination of 1.1 KV Grade 4 core 50 sqmm XLPE insulated PVC sheathed Aluminium armoured cable as per IS 7098(Part 1)1988 with latest amendments and with necessary lugs and terminations complete. Make: Finolex, Polycab, Havells, KEI, Finecab or similar.

Supply, Laying, Testing and Termination of 1.1 KV Grade 4 core 16 sq.mm XLPE insulated PVC sheathed Aluminium armoured cable as per IS 7098(Part 1)1988 with latest amendments and with necessary lugs and terminations complete. Make: Finolex, Polycab, Havells, KEI, Finecab or similar.

Supply, erecting and laying of HDPE pipe of PE-80 grade in PN-4 outer dia of HDPE pipe 63 mm (nearest 2" dia) and wall thickness minimum 2.5 mm maximum 2.8mm with "T" joints, bends, elbows etc. including all other connected accessories. Make: M/s. Sudhakar/ Nagarjunapolymer/Nandi/Plasto. Or similar

Cutting of esphated road/ concrete/ cement/under the track etc., and excavation of cable trench 30cm widex90cm deep oad etc., for laying of HT/LTUG cable. After laying of cable the trench should be brought to its original position by providing tar/ concrete/ cement as per the site conditions and as per directions of Rly.Engineer.

Excavation of cable trench 30 cm wide x 90cm deep in all types of soils for HT/LTUG cable as per specification

Supply and running of 8 SWG GI wire is to be laid for earth continuity.

Item 46

Supply and erection of earth electrode as per the enclosed specification (including digging earth pit, electrode earth box with reinforced concrete complete with all connected materials and works including connecting the earth electrode and aerial earthing according to IS 3043 and RDSO drawing ETI/OHE/P/7021 in other than substations.

Supply and erection of earth electrode as per the enclosed specification (including digging of earth pit, supply and erection of earth electrode, charcoal, salt and earth pit hollow box size (300mmx300mmx300x50mm thickness) with reinforced concrete complete with all connected materials and works including connecting the earth electrode and aerial earthing according to IS 3043 and RDSO drawing ETI/OHE/P/7021 in other than substations. The earth pit shall be constructed as per Drg. No ETI/OHE/P/7021 and RDSO specification No. RDSOTI0LKO(PSI)38/2020 dt.25.08.2021. Earth electrodes to be procured only from CORE approved sources (List enclosed). (Rites Inspection to be done for earth electrode). Earth box stencilling shall be done as under:

GE or EGS	
E.P. No. :	
EP FOR :	
EP LOC :	
IER :	
CER :	
DATE :	

The background is black and letters in yellow. Stenciling to be on side wall. However, wherever boxes are concealed at PF/ground levels, stenciling to be done on cover. Earth pit to be executed shall be of 30 cm dia and charcoal, (Salt+sand) mixture shall be added as alternate layers. Salt to be mixed with river sand on the ground itself. First layer will be charcoal of 30 cm dept followed by (salt+sand) mixture of 30 cm depth and

same shall be repeated till top of earth. Earth pipe shall be embedded inside the ground at bottom of pit by 30 cm. The earth electrodes shall be erected in the presence of Railway representative only

CORE APPROVED SOURCES FOR EARTH ELECTRODES:

S.No.	Firm Name	Address
	M/s Aumni Transmission industry PVT Ltd Vadodara (ID 35315)	AUMINI E- 76, GIDC Manjisar, Taluka Savli Vadodara, Gujarat - 391770, India
	M/s Chaterjee Engineering Co-Kolkatta (ID 17708)	CEC 3/1 Chandtolla Branch Road Kolkata WestBengal -700053 India Regd Address- 216 A JC Bose Road Flat 2AKolkata west Bengal 700017, India
	M/s Chatterjee & (Construction) Pvt Ltd (ID-1051029)	CCC 142/143/2 Madhusudhan paul Chowdhury Lane Howrah West Bengal 711101 India Regd Address: 216 A JC Bose Road Flat 2A Kolkata west Bengal 700017, India
	M/s Dynamic Steel Forge Rajkot (ID-91949)	DSF Plot No G-2521, Near Bhumi cement. Almighty Gate GIDC Metoda Taluka – Lodhika, Rakjot Gujarat – 360021 India.
	M/s Jainco Transmission Limited – Kolkata (ID-1028544)	JAINCO Jalan complex Gate No 1 Lane 7, Jangalpur, Bombay Road (NH-6) Howrah, West Bengal - 711411, India Regd Address: Dhanshree Tower, 70, Diamond Harbour Road, Room No 3B & 3C,3rd Floor Kolkata West Bengal – 700023, India
	JHR Overseas(ID-1051914)	JHR/II Village-Chhandra, chd Road Ludhiana, Punjab -141113, India Regd Address: Back side New Era machines,New Model Town, Sahnewal Ludhiana, Punjab -141120, India
	M/s Khatri castings private limited – Mumbai (ID-3601)	KHATRI At valvada, Near Karmbele Railway Station,NH-8 Taluka – Umargoan Opp. Maruthi Depot Valsad Gujarat – 396001 India Regd Address: 144 Narman Plaza shoppersstop Bldg S.V Road Kandivali (West), Mumbai Maharastra 400067, India
	M/s KSE Electrical Pvt ltd Kolkata(ID-6285)	KSE Jalan Industrial Complex 3rd Main Road, 4thleft Lane, NH-6, PO Begri Howrah West Bengal 711411 India Regd Address: Chaterjee International Centre, 33A, Chowringhee Road 7th floor Kolkata West Bengal – 700071 India
	M/ Kumar Fasteners Mathura (ID -3905)	KF Mathura 5-15, Building Material Complex Site – AIndustrial Area Mathura, Uttar Pradesh - 281004, India
	M/s Mosdorfer india Pvt Ltd	MIPL

	Mumbai (ID-125222)	Plot No.196/1 and Village- Gonde Dhumla MIDC Gonde, Taluka –Igat puri, Nashik Maharashtra 422403, India Regd Address: 403C Wing B1, Marathon Innova Opp peninsula Corporate Park, lowerparel, Mumbai Maharashtra, 400013 India
	M/s Nike Energy Manufacturing Pvt Ltd – Varanasi (ID-23941)	NIKE Plot No 279/2 Ganeshpur Tarna Varanasi Uttarpradesh – 221003, India
	M/s NSS stores supply agency. private limited Howrah (ID-35966)	NSSA P – 208, Banaras Road, Belgachia, P.O. Netajigarh Howrah, West Bengal – 711108, India
	M/S Royal Balaji Engineering Pvt ltd –Kolkata (ID-23501)	Royal NH-6, Bombay Road, Dhulagari, Sankrail Howrah, West Bengal – 711302 India Regd Address: 153/2B, Sumukh Apartment, APC Road Kolkata, West Bengal-700006, India
	M/s Shri Ashutosh Engineering Industries Unit-II Raipur (ID-97354)	SAEI/II (Unit-II), Plot No. 156/1, 157/1, 160 & 161, New Patharidih, Urla Raipur, Chhattisgarh-492001, India
	M/s Tag corporation – Chennai (ID-1033964)	TAG Shed No. 4 & 5, SIDCO Industrial Estate, Thirumudivakkam Chennai Tamil Nadu- 60004, India Regd Address: No91, Thiruneermalai Raod Chrompet undefined Chennai, Tamil nadu -600044, India
	M/s Transmission Line products –Kolkata (ID 5692)	TLP-H NH-6 Sankrail Industrial Park P.O Dhulagarh PS Sankrail, Howrah, west Bengal – 711302, India Regd Address: 102 central plaza 2/6 Sarat Bose Road Kolkata, West Bengal -70020 India

Item 47

Supply of 100 mm dia 'B' class ERW GI pipe conforming to IS: 1239 Part 1(2004) and fixing with suitable clamps on wall/building including laying of cable through GI pipe.

Item 48

Supply and fixing of C curve DP MCBs of 16/20/32 A with all connected accessories. Make: Havells, Legrand, C & S, Indoasian, or similar.

Item 49

Supply and fixing of C curve FP MCBs of 32 A with all connected accessories. Make: Havells, Legrand, C & S, Indoasian, or similar.

Item 50

Supply and installation of DPX3 160 thermal magnetic based release; Icu = 36K A; 100A 4 Pole MCCB conform to IEC 60947-2 of model no. 4200 95 of Legrand make or equivalent make with extended ROM, spreader links (2sets). Make: Havells, Legrand, C & S, Indoasian, or similar.

Item 51

Supply and fixing of 32 A 4P MCB B Curve IS/IEC 60898-1 (2002) 10 kA breaking capacity IP20protected terminals of model no.402463 of Legrand make or it's equivalent. Make: Havells, Legrand, C & S, Indoasian, or similar.

Item 52

Supply, fixing, testing and commissioning of Microprocessor Release200-250 A ; 4Pole, MCCB suitable for operation on415V,50 Hz 3 Phase AC supply in LT Panel with supply of all connected accessories and allied materials as per specification attached. Make: L&T/Legrand/Havells Or Similar. Make: Havells, Legrand, C & S, Indoasian, or similar.

WIRING SPECIFICATION (Wherever applicable)

1. All light points, fan points with 2 Nos. of PVC insulated 1.5 Sq.mm copper conductors and 5 pin 6A plug sockets should be wired with 2 Nos. of PVC insulated 2.5 Sq.mm copper conductor.
2. All power circuits should be wired with 2 Nos. of PVC insulated 4 Sq.mm copper conductors. The individual circuit should be taken from nearest MDB/SDB as per the directions of Engineer at site.
3. The PVC insulation should confirm to IS: 694/77 or latest and copper conductor should confirm to IS: 8130/84 or latest.
4. All cables/conductors make should be of Polycab/Havells/Finolex or other makes ISI certified and approved by Sr. DEE/M/NED.
5. Wiring should be done in PVC conduit pipe.
6. All the lights, fans, 6A plug sockets should be controlled by a Piano type of Legrand/Havells/Schneider make.
7. The Piano type bell push should be of Legrand/Havells/Schneider make.
8. All the lights and Fans shall be connected with 2 Nos of PVC insulated copper flexible wire.
9. All the fittings should be earthed properly with tinned copper wire. The size of earthling wire should be half of the conductor.
10. The 6/16A power plug should be of Legrand/Havells/Schneider make.
11. The 5 pin 6 Amp. The power plug should be of Legrand/Havells/Schneider make.
12. All the switches should be fixed on modular switchboards.

13. The LED fitting shall be fixed on 2 No. of TW round box and connected with PVC insulated flexible copper conductor.
14. The entire sub-Mains should be with 2 Nos. 6 sq. mm. PVC insulated confirming to IS 694/77, copper conductor confirming to IS 8130/84 or latest. (Circuit mains should be with 2 Nos. of 10 sq. mm. Cu cables.)
15. Conformity with Indian Electricity Rules:

The insulation shall be generally carried out in conformity with the requirement of Indian Electricity Rules 1956 as amended from time to time.

Materials: All the materials fittings, equipment and other accessories used in the Electrical installation shall conform to relevant Indian Standard specification whenever they exist and should or approved make. In case of an Indian standard does not exist the materials and other items shall be those approved by the competent Authority.

Workmanship: good workmanship is an essential requirement for compliance of the wiring of installations. The work of electrical installation shall be carried out under the supervision of a person holding a certificate of competency issued by a recognized authority.

16. PVC casing and capping with surface type (Wherever applicable):

16.1 The casing and capping shall be of the same material as PVC.

16.2 The casing shall have a square or rectangular body. The capping shall be sliding type with double glazing in the case of PVC wire ways. All surfaces have a smooth finish inside and outside. The top of side walls of the casing bodies shall be suitable for the above types of fixing arrangements of capping thereof.

16.3 PVC casing & capping shall be of good quality PVC free from defects like deformation, unevenness, blisters, cavities etc,

16.4 The sizes of casing and capping for the various sizes of cables and the maximum number of 650/1100V grade PVC insulated copper conductor cables should be got approved by Sr. DEE/M/NED before executing the work.

16.5 The thickness of the casing and capping shall be $1.2\text{mm} \pm 0.1\text{mm}$.

Note:

1. All the wiring work should be carried out in the presence of Rly's Engineer at site and in accordance with IE rules 1956. During wiring color code of cables/conductors as per IE Rules 1956 shall be strictly followed.
2. The sample of the fitting /switches and any schedule item should be taken approval of Sr. DEE/M/NED before procurement in lot.
3. The contractor, as given in the annexure, shall submit the completion certificate before any payment is made.

SPECIFICATION FOR LT DISTRIBUTION CUBICLE CONTROL PANELS

This covers supply/erection/testing and commissioning of the equipment suitable for 415 Volt,

3phase, 50HZ 4 wire system.

- i) For each equipment required IP rating and short circuit rating capacity as specified in Governing BIS.
- ii) All the equipment will be factory fabricated having modern fabrication and testing process. It shall have seven tank pre-treatment process comprising of degreasing, rinsing, de-rusting, rinsing, phosphatising, rinsing and passivation followed by powder coat painting having a paint thickness of 60 microns or as specified. The powder paint will be subject to oven-heated process. All panels will be provided with suitable gasket to make it dust/vermin proof.
- iii) Cubicle panel shall be totally enclosed and extensible type. The general construction shall conform to IS: 8623/93. The design shall include all provisions for safety of operating and maintenance personnel. Degree of IP protection shall be IP-42 for indoor application and IP-54 for outdoors, unless otherwise specified. The panel will have to be supplied with suitable pedestal (M.S Angle iron frame of MS channel base for grouting in the RCC and proper gland at the bottom).
- iv) The panel shall be compartmentalized type having space and arrangement for incoming cable/bus ducting, incoming switchgear/switchgears, bus coupler, insulated and properly supported compartmentalized bus bars, outgoing compartmentalized switchgear, bus bar supports, joint shrouds, cable alleys of suitable size for cabling routing, support and terminations, inter-connection between bus bars and switchgear with auxiliary bus bars/insulated conductors/strips etc., Also the panel will be provided with necessary instrumentation like CTs, PTs, Ammeters, Voltmeters, phase indicating lamps, other required instruments, wiring fuses etc.
- v) It shall be fabricated out of CRCA not less than 2.0mm thick for load bearing members and 1.6mm for doors of LT panels. The framework may be Angle Iron/Bolted type construction. General constructions shall employ the principle of compartmentalization and segregation of each circuit. Unless otherwise approved, incomer and bus section panel shall be separate and independent and shall not be mixed with sections required for feeders. Each section of the rear accessible type of board shall have hinged access door at the rear. Operating handle of the highest unit shall be at a height not more than 1.7mt. Overall height of the board shall not exceed 2.3 meter.
- vi) Cable entries shall be provided either from the rear or from the front through cable alleys of suitable size. Removable gland plate is to be provided for each cable entry. Cable support arrangement is to be provided inside cable alley so that cables are neatly arranged and fixed. From each outgoing switch, insulated strip/conductor of suitable size is to be provided up to suitable terminal block, which will receive incoming/outgoing cable termination. It is desirable that cables are not terminated directly to switchgear but terminated through proper terminal blocks.
- vii) Terminal block of reputed make shall be used. The housing material shall be polyamide having unbreakable and fire-retardant characteristic. All the metal parts shall be made up of copper alloy including the screws. Mounting shall be 'Din' or 'G-rail' type. Screws shall be self-captive type. No protection cover is required, and the block should be touching proof.
- viii) The bus bar system may comprise of a system of main/auxiliary bus bars run in bus bar alleys. The bus bar shall be made of tinned copper bus bar conforming to relevant Indian standard. The bus bar shall be of sufficient cross section so that current density of 160A/sq.cm. is not exceeded at normal current rating. The cross section of the neutral bus bar shall be the same as that of the phase bus bar. Each bus bar shall be suitably insulated with PVC sleeves/taps. The insulation of the rising mains shall be capable of withstanding the voltage of 660V of A.C. The bus bar support insulators shall be class F insulators made of non-hygroscopic, non-combustible, track resistant and high strength FRP/SMC/DMC material, and shall be of suitable size and spacing to withstand the dynamic stresses due to

short circuit currents. The spacing between two insulators should not exceed 250mm. The minimum clearance to be maintained for enclosed indoor air insulated bus bars for medium voltage applications shall be Phase to earth 26mm (Minimum), Phase to phase 32mm (Min). (For strip connection from bus bars to switch gear, the clearances don't apply). The bus bar joints shall be thoroughly cleaned, and suitable oxidizing grease shall be applied before making the joint. High tensile bolts, plain and spring washers shall be provided to ensure good contact at the joints. The overlap of the bus bars at the joints shall be not less than the area of the cross section of the bus bars. Bus bars and main connections shall be marked by colour or letter as per standards.

- ix) 2 Nos. of 20x3mm copper strip for LT panel up to 400Amp., capacity or 2nos. 20x5 mm copper strip for LT panel of higher capacity shall be fixed all around the panel connected to 2nos. earth bus copper strips connected to incoming earth conductors.
- x) After erection, the LT panel will be commissioned after a) Tightening of all nuts-and-bolts b) Closing any left-out holes to ensure the entire panel is insect proof. c) Megger testing. d) Earth testing.
- xi) Incoming cable will be connected to the rising main through an end feed unit, consisting of switch fuse unit with HRC fuse/MCCB/ACB of required capacity and cable end box. Tap off boxes at specified intervals and height shall be provided on rising main to tap power. The box shall consist of set of HRC fuses or MCCB/Switch fuse unit, so that power from rising main can be switched ON/OFF and provided with suitable overload/short circuit protection.
- xii) 0 - 500V voltmeter, 0 – 500A, Ammeter (digital type of approved make) with suitable CT and Selector switches / multifunctional LCD type energy meters. The Meters shall be of flush mounting type and industrial grade accuracy. The meters should be provided for incoming supply feeders. The qty. requirement for load panels is indicated in the schedule.
- xiii) Phase indication lamps of LED type with colour code, individual fuse control with toggle switches, for all the three incoming feeders.
- xiv) Rubber gasket to be provided for all the doors.
- xv) Sticker to be done for caution, incoming and outgoing control switches with Nomenclature of the feeder etc.
- xvi) Adequate size of cable chambers according to the no. of incoming & out going cables to be provided.
- xvii) Suitable rubber bushes to be provided for cable entry.
- xviii) The cubicle panel should have provision for future extension on either side. Two distinct earths by using GI flat of size 40 mm x 6 mm connecting to the nearest earth.
- xix) The size of the panel and arrangements are suggestive. Exact size and arrangement will be decided by approving authority.

ACB/Bus-coupler Specification – ABB/L&T, /Schneider make Breaking capacity 50 kA. The ACB shall be fully Microprocessor based like L&T make U-Power Omega series having following features.

- High short time withstand capacity, $I_{cu}=I_{cs}=I_{cw}$ for 1 sec for total selectivity
- High mechanical and electrical operating life
- Advanced microprocessor-based protection release
- 50% and 200% neutral protection solution
- RoHS Compliant
- Inbuilt Electrical and Mechanical Anti-Pumping prevent multiple breaker closures due to persistent closing command
- CE marking
- Password protection for Protection Releases
- Arc-chute interlocking prevents the closure of breaker if arc-chute is missing or not properly

installed

- Smart-racking shutter interlock ensures breaker is switched off before racking out the breaker
- Conforms to Glow Wire Testing
- Protection against under or over voltage & Current, under or over frequency, short circuit, reverse power, single phase earth fault, instantaneous protection.

Conformance to Standards IS/IEC 60947-2 & IEC 60947-2.

Supply & Erection of 4 pole MCCB with 36/50 kA breaking capacity suitable for 415 V AC with LSIG Microprocessor release, extended ROM, and spreader links (4 nos-02 sets), phase barriers as per IS/IEC 60947-2, IEC 60947-2 & EN 60947-2.

SPECIFICATION No. NED/E-CABLE LAYING/10/06

Specification for High Tension & Low-Tension underground cables, cable trenches and cable laying etc.

1. **Scope:** This specification covers supply of low tension and high-tension underground cables and laying of cables in the cable trenches, running of cables along with structures, walls, steel framework, trusses etc., with connected materials, indicators etc.

2. **H.T. 11kV UG Cable:**

Power cables shall be suitable for 11kV, 3 phase earthed system and for Heavy duty.

The cable shall be 11kV grade, three core, aluminum conductor screened, cross-linked polyethylene (XLPE) insulated inner sheath common covering of proofed or plastic taped, galvanized steel double strip armored and outer PVC sheathed.

The conductors shall be of stranded aluminum of “3/4” “H” of 'H' temper, compacted and shaped.

The XLPE insulated PVC sheathed cables shall be conform to IS-7098, Part-II/1973 or its latest edition.

3. **LT UG Cables:**

Power cables shall be suitable for 440/433V, 3 phase, with neutral earthed system and for heavy duty use.

The LT UG cables shall conform to the IS specification as mentioned in the tender schedule/ Specification/ Scope of work.

Cable trenches (ordinary): Excavation of cable trenches of different sizes in all types of soils. The bottom of trench is leveled freed from stones and sharp edges of rock. A layer of 10 cms thick sand is laid at the bottom of trench after laying the cable, it is covered once again with 10cms. thick sand and covered with well burnt country bricks at the rate of 9 to 10 bricks per meter depending upon with of brick for each cable without leaving any gap in between so as to prevent damages to the cables due to crow bars etc. during any excavation at a later date and one brick to be placed in between the cables at every one meter of regular interval and duly filling the trench with earth after positioning the cable markers and remming well in stages to bring the surface in level with original surface. If two separate feeders are to be laid in the same trench a horizontal interval spacing is advisable to reduce the effect of mutual heating and to ensure that a fault accruing on are cable will not damage the adjacent one.

If single core cables are used for forming a three-phase circuit, the three cables are laid in triangular formation (trefoil).

The sizes and cable trench details may be verified in the drawing No. A3/E/STD/6.

4. Road Crossing: Cutting of roads, excavation of the cable trench of different sizes and laying of RCC Hume pipes and jointed with collars in an approved manner. The pipes are required to be laid to keep the cable at one meter below the ground level. The pipes shall be extended upon 2metres below on either side of the road, measured from the edge of the road. The pipes shall be positioned to maintain a slope of about 1 in 30 to allow drainage of seepage water. No bricks or sand are required to be placed at such places. As many numbers of pipes are to be laid for as many numbers of cables, if required. The cable trench can be closed with the excavated earth and ramming well in stages to bring the surface in level with the original and making the road as earlier.

The cables can be drawn through pipes without disturbing the traffic, when once the above arrangement is made. The cable markers can be placed on either side of the road to identify the cable route.

The sizes and road crossing details may be verified in drawing No. A3/E/STD/6.

5. Track Crossing: Removing of existing ballast, excavation of the cable trench of different sizes under the track and laying of RCC Hume pipes and jointed with collars in an approved manner. The pipes are required to be laid to keep the cable at minimum one meter below the track or formation level. The pipes shall be laid up to the Railway boundary at both ends up to the point as prescribed by the Railways. The pipes used shall be of long length and the pipes shall be positioned to maintain a slope of short 1 in 30 to allow drainage of seepage water. No bricks or sand are required to be placed at such places. As many numbers of pipes are to be laid for as many numbers of cables, if required. The cable trench can be closed with the excavated earth and ramming wall in stages to bring the formation/cutting as per the original and replacing the removed ballast as earlier. The cables can be drawn through pipes without disturbing the traffic, once the above arrangement is made. The cable markers can be placed on either side of the track at a convenient place to identify the cable route.

The sizes and track crossing details may be verified in the Drg. No. A3/E/STD/6.

- 7. Laying of cables on Racks and Cleats:** Inside buildings, workshops, sheds, sub-stations, it is sometimes necessary to lay the cables on racks or brackets, spaced at regular intervals or sometimes they are required to be cleated directly on the walls/ trusses/ beams or MS structures fixed on walls.

The cables are laid direct upon trays with or without spacers sometimes instead of using metal trays, the cables are required to be supported and clamped on brackets spaced at such regular intervals to prevent under sag.

For horizontal runs, brackets or supports made from angle iron are grouted in the walls and they are arranged in a single plane when only a few cables are involved, when large number of cables must be laid over the same route the brackets are fixed as per formation.

For horizontal run of one or two cables the cables can be clamped/cleated directly on walls/beams preferably with the non-magnetic materials like Aluminium - wood etc. For vertical runs, the cables are clamped/cleated on walls/columns or on MS flats or on Angle Irons fixed on walls and they are required to be spaced at such intervals to prevent buckling of cables and creepage of load.

All steel work shall be painted with one coat of red oxide and finished with suitable color anti-corrosive paints.

- 8. Cables along the structures:** The G.I. pipes shall be fastened to the structures upto 2.5metres from ground level by suitable MS clamps at an interval of not more than one meter with suitable bolts, nuts, washers etc., the cables shall be drawn through the G.I. pipe. Both the

ends of G.I. pipe shall have PVC/wooden bushes to avoid abrasion to the cable. In addition, the top shall be sealed with cable compound to arrest ingress of rainwater.

8 .The cable shall be run above pipe level up to cable termination end through suitable teak wood cleats duly clamped to the structure by suitable clamps, bolts, nuts, washers etc.

9. Inside the sub-stations, repair sheds, workshops etc., suitable sizes of masonry trenches will be constructed by the Railways. The cable shall be laid in the trenches and covered with RCC slabs/MS sheets/Aluminum chequered plates as per the schedule and instructions of Engineer at site.

10. Boards: The cable trench shall be straight as far as possible without bends and at places where obstacles are encountered there shall be no abrupt bends or if unavoidable, the cable shall be following specifications.

11. Bending radius for PVC cables: While installing/laying PVC cables, the following minimum handling radial should be observed in order that the cables, especially insulation may not undergo damage.

Voltage grades of cable - Recommended minimum bending radius

a) Up to 11kv - $15 \times D$

b) Above 11kV - $15 \times D$ for multicore cables.

$20 D$ for single core cables where D is over all diameter of cable.

12. SLOPE: The slope of the cable trench according to the formation of the land shall be made to keep the bend of the cable minimum as stated in item 10 above.

13. Looping of cable: The cable at the foot of the structures shall be looped to the lengths of 5 meters to allow for the future requirement to coil diameter shall be not less than minimum bending radius as stated in item 10 above. The excavation at structures shall be done suitable and covered with sand, bricks and earth as detailed under item 4 above. At each end termination near the panel board a 5 Mtr. loop shall be kept as an allowance and loop ring shall be formed circular and as recommended by the cable manufacturers.

14. Accessories/Materials:

Cable route indicators: Cast Iron cable route indicators markers manufactured as per the drawing No. A3/E/STD/6 and cemented. The cable markers shall be positioned, fixed firm and in a manner acceptable to the Engineer at site. The M.S. steams shall be dipped in hot and dried before they are fixed. The cable marker shall be painted with 3 coats of red oxide. One coat before providing at site and another after positioning and cementing. The spacing of the markers shall be not more than 6 meters in a straight run.

Contrary bricks:

General: Country bricks must be free from cracks, large, chipped surfaces and broken corner stones and lumps inclusions of burnt kenkar if of small extent may be permitted. The brick surface should be so hard as not to get scratched by the fingernail. From charged surface should not have cavities to any appreciable.

Quality and sizes: Country bricks may be slightly over burnt but not under burnt in any case. The color may be dull red or even reddish yellow, provided it is not due to under burnt material and is only a feature of type of molding clay used. The normal size of country brick should be 225mm x 115mm x 75mm. The size of the frog in the upper face should be same as per first or second-class bricks.

Sand: The sand shall be preferably river sand or as per the quality required by the Engineer at site. The sand shall be from lumps of earth, clay etc. and screened.

RCC Hume Pipes: RCC Hume pipes supplied shall be the size of internal dia. of 200mm external dia. to the standard lengths. Necessary collars for joining the above pipes shall also be supplied. The pipes and collars should conform to relevant latest IS specification and same should be approved by the Engineer at site before laying in the trenches.

Clamps, bolts etc.: Clamps shall be made from aluminum of HS plate. The bolts used shall be of suitable dia and of sufficient length, One MS hose nut and a check nut with one spring washer between two nos of flat washers shall be used for tightening the bolts. The MS clamps shall be painted with one coat of red oxide and two coats of aluminum paint.

GI Pipes: The G.I. Pipes shall be of 'B' class of 50mm dia., 100mm dia., 3.4dia thickness to the stranded standard lengths. Necessary collars, bends etc., for jointing the above pipes shall also be supplied. The pipes and accessories shall be approved by the Engineer at site before using the same.

Outdoor end termination: The kit should essentially contain the following contents:

1. Required quantity of cable jointing compound.
2. Required quantity of hardener.
3. Plastic mould.
4. Mould adhesive cum solvent.
5. Earth continuity connection.
6. Stress grading paste.
7. Self-banding insulating tape.
8. Insulators.
9. Copper binding wire.
10. Aluminum oxide tape.
11. Nylon string for cutting XLPE insulation.
12. Polyester tape.
13. Semi conducting self-bonding tape.
14. 'M' Seal (Fast setting) epoxy putty.
15. Instruction Sheet.

i. **Door end terminations:** The kit should essentially contain the following contents.

1. Required quantity of cable jointing compound.
2. Required quantity of hardener.
3. Plastic mould.
4. Mould adhesive cum solvent.
5. 'M' Seal (fast setting) epoxy putty.
6. Earth continuity connection.
7. Stress grading paste.

8. Self-bonding insulating tape.
 9. Copper binding wire.
 10. Aluminum Oxide tape.
 11. Nylon string for cutting XLPE insulation.
 12. Semi conducting self-bending.
 13. Instruction Sheet.
- b. LT Cable end boxes/kits to use with 11kV PVC cables for indoor & outdoor end terminations: The kit should essentially contain the following contents.
1. Required quantity of cable jointing compound.
 2. Required quantity of hardener.
 3. Plastic mould.
 4. Mould adhesive cum solvent.
 5. M-Seal (fast setting) epoxy putty.
 6. Earth continuity connection.
 7. Spacer.
 8. Instruction Sheet.

Weatherproof Junction Boxes: These shall be made from MS sheet Iron with weatherproof x-type with suitable terminals looking arrangements knock out arrangement suitable entry holes etc. The box shall be painted with one coat of red oxide and two coats of grey colour paint. These shall be made and provided as per the instructions of the Engineer at site.

Cable Gland: The cable gland shall be of brass with fixing check nuts etc. The correct size of gland shall be used for the size of cable. The glands to be used should be approved by the Engineer at site.

Cable Jointing Lugs: These shall be made of aluminum crimping type (E.E., solder less) and bolted type and shall have adequate current carrying capacity. The lugs to be used are to be approved by the Engineer at site.

Cable Markers of track crossings: These shall be made of cast iron. The design shall be approved by Railways. The following information shall be clearly marked on the marker.

- a. Electric - Volts.
- b. Number - Cables.
- c. Danger - English, Hindi and the vernacular of the district.
- d. Depth of cable - Below ground level between the toe of bank and Rail facing.

Cable markers used where No. of feeders involved: These shall be made of cast iron. The design shall be approved by Railway. The following information shall be clearly marked off the marker.

- a) Electric Cable - Volts.
- b) No sizes of cables.
- c) Length of cable
- d) Origin & destination of cable.

15. General:

Test certificates shall be produced for the cables supplied.

All materials/accessories supplied should have the approval of the site Engineer before using the same.

1. The method of laying the cables shall be generally as indicated in Drg. No. A3/E/STD/6. The cable routes shall be measured at site and the requirements assessed before the supplies are affected. No joints in straight runs will be permitted. Measurements for cables will be taken as straight runs and from gland to gland. Covering of trenches shall be carried out only after measurements are taken and recorded. Insulation resistance tests shall be repeated after laying the cable and before the terminations are made in the presence of the Engineer-in-charge at site.
2. While connecting the cables to OH Mains/Switch panels, the cable end boxes shall be used as per the directions of the Engineer at site.
3. Cables required to be laid in existing trenches within the unit/sub-stations/shop bays, the contractor shall ensure that this is done by removing the existing slabs and replacing the same after laying, duly cleaning the trench wherever warranted.
4. Wherever the cables enter or leave the buildings, they shall be passed through walls in 150mm dia. RCC/GI pipes with collar as directed by the Engineer-in-charge at site including civil works.
5. The cables shall be treated through RCC pipes at all road and rail line crossings and at all other service line crossings like drainpipes, sewage, and water mains as per the instructions of the Engineer-in-charge at site.
6. Where track crossings are involved in the two cable markers shall be fixed at both ends of the underground crossing as directed by the Engineer at site.
7. Where we must deal with a number of feeders like workshops, repair shops, sub-stations etc. Approved type CI cable route indicators shall be grouted in concrete along with the route of the cable at intervals of 20 meters in straight runs and at every diversion point and at every entry and exist-points of buildings, sheds etc., these shall be used along with the types of cable markers as directed by the site in-charge to check at site.
8. All cable ends shall be provided with cable glands and each lead provided with crimped Aluminium shoes of suitable sizes.
9. Any foundation/drainage/walls/masonry structure will be re-made with a good shape after passing the cable by the contractor, pipes will be provided by the contractor.

16. CABLE TERMINATIONS:

- a) All the exposed cable runs in shops floors particularly being terminated on SDBs, fuse boxes, shall be encased in a suitable size of GI pipe and secured to the pillars/ columns by means of clamps.
- b) Termination of cable shall be carried out using approved crimping type "Dowells" aluminum lugs and approved type of crimping tools.
- c) The method of termination shall be as per the procedure laid down in the relevant manufacturer's literature.
- d) The prices quoted shall include all the necessary supply materials such as glands, lugs, consumables etc.
- e) Every piece of cable shall be tested before taking up the termination work and after completion of the same and the results of such tests shall be recorded.
- f) All testing shall be carried out in the presence of the Engineer-in-charge at site.

IMPORTANT NOTE:

- a) The electrical equipment shall properly be earthed.
- b) The wiring undertaken shall comply with IE rules and acts.
- c) The execution of work shall be carried out in conformity with latest instructions and maintenance manuals of Railways with the approval of Railways nominated engineer/supervisor.
- d) After excavation and laying of the cable in every type of soil, ground surface leveling must be done and it should be concreted if it is a road crossing and wherever required.
- e) The cable route markers/indicators shall be strictly laid as per the specification/ drawing and instructions of the Railway site Engineer.
- f) Materials to be supplied as per latest RDSO Specification wherever applicable.
Manufacturer's test certificate should be submitted duly proving the RDSO's Specification.
- g) In case any contradiction with RDSO Specification, the RDSO specifications will prevail.
- h) Materials to be supplied as per the corresponding specification/standards (latest at the time of opening of tender) of each item (wherever applicable).

In this regard a test certificate issued by Govt. Recognized institute shall be submitted along with the material before execution of the work stating that the material is in line with the corresponding specification/standards (latest at the time of opening of tender). (Wherever applicable).

- i) Necessary charges for RITES inspection shall be at contractor's cost only.
- j) The tenderer / contractor must make his own arrangements for loading, handling, transportation and unloading of the materials to the work spot.
- k) The latest updated specifications are available at RDSO website www.rdsso.gov.in.
- l) The tenderers may verify the RDSO Specification/Draft specification available at Sr.DEE/NED's office.
- m) **If any deviation arises in specification/ scope of work, Sr.DEE/M/NED's decision will be the final.**

Tenderer shall go through the detailed specification/scope of work as mentioned above and ensure that the work will be executed, supply and install the above material as per the specification laid down for the concerned item.

PROFORMA***ENGINEERING ORGANISATION AVAILABLE ON HAND.***

Sl. No.	Name & Designation of Employee	Qualification	Previous Experience	Working From To
01	02	03	04	05
A				
B				
C				
Z				

ENGINEERING ORGANISATION PROPOSED TO BE ENGAGED FOR THIS WORK FROM ABOVE.

Sl. No.	Name & Designation of Employee	Qualification	Previous Experience	Remarks
01	02	03	04	05
A				
B				
C				
Z				

ENGINEERING ORGANISATION PROPOSED TO BE ENGAGED FOR THIS WORK FROM OUTSIDE.

(A SUITABLY WORDED CONSENT LETTER FROM SUCH A PERSON SHOULD BE OBTAINED AND ENCLOSED).

Sl. No.	Name & Designation of Employee	Qualification	Previous Experience	Remarks
01	02	03	04	05
A				
B				
C				
Z				

SIGNATURE OF THE BIDDER (S):

NAME OF THE BIDDER:

1. PLANT & MACHINERY AVAILABLE ON HAND.

Sl. No.	Particulars of machinery, Plant & equipment	No. of Units	Kind and make	Capacity	Age and Condition	Approx. cost in Rs. in lakhs	Purchase Bill No. & Date and Registration particulars
01	02	03	04	05	06	07	08
A							
B							
C							
Z							

2. PLANT & MACHINERY PROPOSED TO BE INDUCTED FROM ABOVE.

Sl. No.	Particulars of machinery, Plant & equipment	No. of Units	Kind and make	Capacity	Age and Condition	Approx. cost in Rs. in lakhs	Purchase Bill No. & Date and Registration particulars
01	02	03	04	05	06	07	08
A							
B							
C							
Z							

3. PLANT & MACHINERY PROPOSED TO BE INDUCTED FROM OUTSIDE.

Sl. No.	Particulars of machinery, Plant & equipment	No. of Units	Kind and make	Capacity	Age and Condition	Approx. cost in Rs. in lakhs	If to be purchased give likely date of receipt and supplier's Name.
01	02	03	04	05	06	07	08
A							
B							
C							
Z							

SIGNATURE OF THE BIDDER (S):
NAME OF THE BIDDER:

LIST OF COMPLETED WORKS BY THE BIDDER

Sl. No.	Name of work	Agreement No. and date	Designation and address of agreement signing authority	Agreement value in lakhs	Completed value of work (in lakhs)	Date of completion	Remarks
Railway works							
A							
B							
C							
D							
E							
Z							
State Govt. Works							
A							
B							
C							
D							
E							
Z							
Public Sector Undertaking Works							
A							
B							
C							
D							
E							
Z							

SIGNATURE OF THE BIDDER (S):

NAME OF THE BIDDER

LIST OF WORKS ON HAND WITH THE BIDDER

Sl. N	Name of work	Agreement No. and date	Designation and address of agreement signing authority	Agreement value in lakhs	Bill amount paid so far in lakhs	Due date of completion	Number of extensions taken
Railway works							
A							
B							
C							
D							
E							
Z							
State Govt. Works							
A							
B							
C							
D							
E							
Z							
Public Sector Undertaking Works							
A							
B							
C							
D							
E							
Z							

SIGNATURE OF THE BIDDER (S):

NAME OF THE BIDDER

EXPERIENCE CERTIFICATE

S. No.	Work Details	Details
1	Name of Work	
2	Agreement Number, date, and Name of the Agency.	
3	Agreement Value in Rupees (in words and figures)	
4	Due date of completion	
5	Number of Extensions granted	
6	Actual date of completion of work	
7	Value of Final Bill if passed (in words)	
8	Work completed but Final measurements not recorded a) Amount paid so far as in CC Bill No.	
9	Work completed; Final measurements recorded with negative variation. a) Amount so far paid as in CC Bill No.	
10	Work completed if Final measurements recorded with positive variation which is not sanctioned yet original agreement value or last sanctioned agreement value whichever is lower	

Note:

- 1) This certificate in this proforma is to be issued only for physically **Completed work.**
- 2) This certificate to be issued by an officer not below the rank of JA Grade or bill passing officer in Railways and Bill passing Officer/Executive In- charge of work in other government department/Govt. bodies /Public sector undertaking. The certificate should bear the signature and seal of the issuing officer, name of the department etc.

Signature :
 Name of Officer :
 Designation :
 Address :
 Office Seal :
 Phone/Fax No. :
 Date :

CERTIFICATE FROM CHARTERED ACCOUNTANT IN THEIR LETTER HEAD**TO WHOM SO EVER CONCERNED**

Each Bidder or each member of a JV must fill in this form separately:

NAME OF BIDDER/JV PARTNER:

Annual Contractual Turnover Data for the Previous 3/4 Years (Contractual Payment only)				
S.N.	Year	Amount Currency	Exchange Rate	Indian National Rupees Equivalent
Average Annual Contractual Turnover for last 3 years				

1. The average annual contractual turnover shall be calculated as an average of “total contractual payments” in the previous three financial years. However, in case balance sheet of the previous year is yet to be prepared/ audited, the audited balance sheet of the fourth previous year shall be considered for calculating average annual contractual turnover.
2. The information supplied shall be substantiated by data in the audited balance sheets and profit and loss accounts for the relevant years in respect of the bidder or all members constituting the bidder.
3. Contents of this form should be certified by a Chartered Accountant duly supported by Audited Balance Sheet duly certified by the Chartered Accountant.

SEAL AND SIGNATURE OF THE BIDDER

Certified that all figures and facts submitted in this form have been furnished after full consideration of all observations/notes in Auditor’s reports. _____

Signature :

Name of CA :

Registration No :

CHECK LIST OF DOUCEMENTS TO BE SUBMITTED ALONG WITH TENDERS.

1	Bidder details:	
1.1	Name of the Bidder	
1.2	Identification of Bidder i. In case of Partnership Firm: The Bidder shall submit (i) a copy of partnership deed (ii) a copy of power of attorney (duly registered as per prevailing law) in favor of an individual to sign the tender document and create liability against the firm. ii. In case of JV: The Bidder shall submit documents as mentioned in clause No.17 of the tender form (second sheet) of IRSGCC, April-2022 iii. In case of Company: The Bidder shall submit (i) the copies of MOA (Memorandum of association) AOA (Articles of association) of the company and (ii) a copy of authorization/power of attorney issued by the company (backed by the resolution of board of directors) in favor of the individual to sign the tender on behalf of the company and create liability against the company. iv. In case of proprietary Firm: A copy of registration/ Income tax/PAN No for filling returns self-attested.	
2	Particulars of on-line payment/RTGS submitted towards cost of tender form	
3	Particulars of on-line payment/RTGS submitted towards EMD	
4	Engineering Organization in Annexure “A”	
5	List of plants and machinery in Annexure “B”	
6	List of works completed during the last 3 Financial Years Annexure ‘C’	
7	List of works on hand with tenders in Annexure “D”	
8	Attested copy of Experience Certificate in Annexure ‘E’	
9	Attested copy of certificate showing contractual amount received during the last three financial years and current financial year Annexure ‘F’.	
10	NEFT Mandate form	
11	Registration number of GST/ VAT	
12	Any other information / Certificates required as per Tender document.	
13	Total number of annexures submitted (Number of pages)	

Address

Phone No:

NEFT FORM

To,
The Sr. DFM/Nanded Division,
SOUTH CENTRAL RAILWAY,
NANDED.

Sir,

We prefer to the National Electronic Fund Transfer (NEFT) being followed by South Central Railway, NED Division, for remittance of our payments using RBI's NEFT scheme. In confirmation to this, I/We agree to receive our payments being made through the above scheme to our under-noted Account.

S.No.	Details to provide by Bidder	Details to be filled up by the Bidder
1	Name of Bidder	
2	Full postal Address with PIN Code	
3	Email Address of Bidder	
4	PAN number of Bidder	
5	Bank's Name & Branch	
6	Full Address of Bank	
7	Name of City	
8	Bank Code No.	
9	Bank Telephone/Fax No. & Email	
10	Bank's IFSC Code for NEFT	
11	Bank's IFSC Code for RTGS	
12	Bank's MICR Code	
13	Bidder Bank Account Number	
14	Type of Bank Account	
15	Bidder Name as per Bank Account	
16	Telephone Nos. of Bidder BSNL/Landline: Mobile/Cell Phone: Fax Number:	

(Bidder should note that the above particulars are necessarily to be provided for return of EMD, SD & Other payments due to the Bidder during execution and on completion of work).

Certified that the above indicated particulars are true.

Request letter from Executive branch to Account's office for opening of LC

Office of....
Railway
 Dtd:-

No.....

The PFA/Sr.DFM/Dy.FA
 HQ/Division/Workshop/Cost

Sub:- Opening of LC
 Ref:- Supply order/Contract Agreement No.

It is requested to open a sight LC against the above referred Order/Agreement in favor of The details of beneficiary are as under.

- (i) Name of the Contractor/Supplier
- (ii) Vendor code
- (iii) Address
- (iv) Tender No.
- (v) Contract agreement No.
- (vi) Description of Goods/Service
- (vii) Value of Contract
- (viii) Stages of payment
- (ix) Expected payment within 6 months (LC Amount)
- (x) Beneficiary bank details
 - (a) Bank name
 - (b) Address
 - (c) Account No.
 - (d) IFSC Code

It is certified that the supplier /contractor has exercised the option of taking payment due against the tender, through LC arrangement in IREPS portal at the time of bidding itself and the option has been flagged in the IREPS. This has the approval of.....

- (xi) Validity / Period for which LC is to be opened.

(Signature)

Name:

Designation:

Official Seal

**LCDA No. (18 DIGIT IPAS GENERATED
NO.)**

Dated:

DOCUMENT OF AUTHORIZATION

Reference : (i) Works Contract/Supply Contract No..... Dated.....

**(ii) Inland Letter of Credit No.....
dated.....**

**The document is issued against contract No..... (FROM IREPS).....
dated..... For supply/work of (DESCRIPTION OF
GOODS/WORK FROM IREPS).....**

**The beneficiary of the aforementioned Letter of Credit M/s (Name and Vendor
Code)... (Vendor code..... as per IREPS.....) is entitled to receive payment aggregating
INR.....\$\$\$.....(FROM ABSTRACT OF BILL PASSED).. out of a total LC amount of
INR.....(FROM MASTER TABLE OF LC OPENED)..... against
the first/second” commercial Invoice No. (FROM IPAS) dated
.....FROM IPAS..... For INR (FROM IPAS)..... raised against the
above contract from State Bank of India..... (branch..FROM LC MASTER
TABLE)..... on the strength of this certificate.**

**The details of payments already made to the beneficiary under this Letter of Credit are as
follows:**

S. No.	Invoice No.	Invoice date	Invoice Amount (INR)	LCDA No.	LCDA date	Amount paid (INR)
Total Paid						

THIS PAYMENT:-.....\$\$\$.....

LC BALANCE AFTER THIS PAYMENT:.....

(Signature of authorized Railway authority)

Name:

Designation:

Official Seal:

MODEL FORM OF PERFORMANCE GUARANTEE

To,

Senior Divisional Finance Manager,
Nanded division,
South Central Railway.

In consideration of the President of India acting through Senior Divisional Electrical Engineer/Nanded division, South Central Railway (herein after called “the Government”) having awarded to (M/s.....) {herein after called the said contractor(s)} the contract No..... dated valued at Rs..... for the work of “.....” (herein after called as the “Agreement” and the contractor having agreed to provide a Performance Guarantee for the faithful performance of the contract equivalent to 5% of the value of the contract i.e., for Rs..... (Rupeesonly) to the Government.

2) We.....(indicate the name of the bank) hereafter referred to as “the bank” at the request of (Contractor(s)) do hereby under take to pay the Government an amount not exceeding Rs.....(in words Rs.....) against any loss of damage caused to suffered or would be caused suffered by the Government reason of any breach by the said contractors of any of the terms or conditions contained in the said agreement.

3) We undertake to keep the performance guarantee in force till the satisfactory completion of the work and maintenance period is over i.e., (mention date...) adding contract period + maintenance period).

We,.....(name of the bank) do hereby, undertake to pay the amount due and payable under this guarantee without any demur, merely on a demand from the government stating that the amount claimed is due by way of loss or damage caused to or would be caused to or suffered by the Government by reason of breach by the said contractor(s) of any of the terms and conditions contained in the said agreement or by reason of the contractor(s) failure to perform the said contract. Any such demand made on the Bank shall be conclusive as regards the amount due and payable by the Bank under this guarantee. However, our liability under this guarantee is restricted to an amount not exceeding `.....

4) We undertake to pay to the Government any money so demanded notwithstanding any dispute or disputes raised by the contractor(s)/supplier(s) in any suit or proceeding pending before any Court or Tribunal relating thereto our liability under this present being absolute and unequivocal.

5) We,.....(name of the bank) further agree that the guarantee herein contained shall remain in full force and effect during the period that would be taken for the performance of contract and that it shall continue to be enforceable till all the dues of the Government under or

by virtue of the said agreement have been fully paid and it claims satisfied or discharged or till Senior Divisional signal & Telecom Engineer Nanded Division. South Central Railway, Nanded. Ministry of Railways certifies that the terms and conditions of the said contract have been fully and properly carried out by the said contractor(s) and accordingly discharges this guarantee. Unless a demand or claim under this guarantee is made on us in writing on or before the ... (date), we shall be discharged from our liability under this guarantee thereafter.

6) We.....(name of the bank) further agree with the Government that the Government shall have the fullest liberty without our consent and without affecting in any manner our obligations hereunder to vary any of the terms and conditions of the said agreement or to extend time of performance by the said contractor(s) and to forbear or enforce any of the terms and conditions relating to the said agreement and we shall not be relieved from our liability by reason of any such variation or extension being granted to the said contractor(s) or for any forbearance act or omission on the part of the Government or any indulgence by the Government to the said contractor(s) or any such matter or thing whatsoever which under the law relating to sureties would, but for this provision, have effect of so relieving us.

This guarantee will not be discharged due to the change in the constitution of the bank or the contractor(s) supplier(s)

7) We,....(name of the bank), lastly undertake not to revoke this guarantee during its currency except with the previous consent of the Government in writing.

Notwithstanding anything contained herein above:

Our liability under this Bank Guarantee shall not exceed Rs _____
(Rupees _____)

This Bank Guarantee shall be valid up to _____.

8. We are liable to pay the guaranteed amount or any part thereof under this Bank Guarantee only and if only you serve upon us a written claim or demand on or before _____.

For _____ (Bank)
(With seal and address signed by
authorized signatory of the Bank)

Witness:

.....
.....

Note: Each page should be signed by the banker if the bond is in several pages.

INDEMNITY BOND

1. This deed of Indemnity is executed on the day of _____ by M/s: _____, which expression includes his successors and assignees, in favor of the President of India acting through Sr. Divisional Electrical Engineer/Maintenance the Purchaser, South Central Railway, Secunderabad (herein after called the 'Railway').
2. Whereas the parties hereto have entered into an agreement vide acceptance letter/Agreement No. _____ dt _____ for the purpose of executing the said contract until such time the materials herein after mentioned are fully erected or otherwise and handed over to the Railway.
3. Whereas we, M/s: _____ are required to hold in custody for and on behalf of the Railway in trust give here the list of items for the purpose of executing the said contract until such time the materials are duly erect and or handed over to Railway.
4. Whereas we, M/s: _____ are required to furnish an Indemnity Bond.
5. Now by this Indemnity Bond we hereby undertake that we hold in my custody for and on behalf of the President of India and his property in trust of the said materials handed over to us for the purpose of execution of the said contract until such time the materials are duly erected or otherwise handed over to the Railway.
6. We shall be entirely responsible for the safe custody and protection of the said materials against all risks till they are duly erected and or otherwise delivered to the concerned depots or to any other Officer as he may direct otherwise, and shall Indemnify the Railway against any loss, damage, or deterioration in respect of the said materials which are in my possession.
7. The said materials shall always to open for inspection by any authorized officer of the Railway.
8. Should any loss or damage or deterioration occur or refund becomes due, the President of India shall be entitled to recover from us compensation for such loss or damage or deterioration the amount is to be refunded without prejudice to any other remedies available to Railway and also by deduction from any sum due or any sum which at any time hereafter may become due to us for this work or under any other contract with any other department of the Railway.
9. The value of the above materials for the purpose of indemnity Bond that can be claimed under this Indemnity Bond shall not exceed Rs. _____/-(Rupees only).
10. In the event of any loss or damage or deterioration as aforesaid the assessment of such loss or damage or deterioration, the assessment of compensation therefore would be made by the President of India or by his authorized Nominee and the said assessment shall be final and binding upon us.
11. In witness whereof we, M/s: _____ have executed this Indemnity Bond on the date, month and year final written at _____ dated this _____.

Signature of Tenderer

ANNEXURE-V(A)

(This certificate is to be given by attorney/authorized signatory/each member of Partnership firm/Joint Venture (JV)/Hindu Undivided Family (HUF)/Limited Liability Partnership (LLP)etc.)

I/We (Name), attorney/authorized signatory of the (constituent firm/constituent partner) and member/partner of the (tendering firm) hereby solemnly affirm and state as under:

1. I/we certify that (constituent firm/constituent partner) is/are not blacklisted or debarred by Railways or any other Ministry /Department of Govt. of India from participation in tender on the date of submission of bids, either in individual capacity or as a HUF/ member of the partnership firm/LLP/JV/Society/Trust.
2. I/We have read the clause regarding restriction on procurement from a bidder of a country which shares a land border with India and certify that I am/We are not from such a country or, if from such a country, have been registered with the competent Authority. I/We hereby certify that I/we fulfil all the requirements in this regard and am/are eligible to be considered (evidence of valid registration by the competent authority is enclosed),

Seal and Signature
of the constituent firm/constituent partner

Place:

Dated:

* * * *

Insurance Surety Bond for Performance Security

Name of the issuer of surety bond:

President of India,
Acting
through.....,

Railway.

Date:.....

Surety Bond No:

Amount of Bond:
.....

Issue Date:.....

Expiry Date:.....

WHEREAS, In consideration of the President of India acting through
.....(*Designation & address of contract*
signing authority),.....Railway,....., (hereinafter
called “The Railway”) having accepted the bid of M/S _____ hereinafter called the
contractor, for the work of _____” under invitation for bids No _____ Dated
_____, Vide Letter of Acceptance No.....

AND

WHEREAS, the contractor is required to furnish Performance Security for the sum of _____
(_____ Rupees Only), in the form of Surety Bond, being a condition precedent to the
signing of the contract agreement.

SB No:

Date :

WHEREAS, we, _____, (*Name of insurance company*) hereinafter called the Surety, acting
through {*Designation(s) of the authorized person of the Surety*}, have, at the request of the
M/s. _____ contractor, agreed to give Bond for performance security/ additional performance security as
hereinafter contained:

1. KNOW ALL MEN by these present that I/We, the undersigned *[Insert name(s) of authorized representatives of the Surety]*, being fully authorized to sign and incur obligations for and on behalf of the Surety, confirm that the Surety, hereby, unconditionally and irrevocably Bond to pay the Railway the full amount in the sum of(Rupees Only) as above stated.
2. The Surety undertakes to immediately pay on presentation of demand by the Railway any amount up to and including aforementioned full amount without any demur, reservation or recourse. Any such demand made by the Railway on the Surety shall be final, conclusive and binding, absolute and unequivocal notwithstanding any disputes raised/pending before any Court, tribunal, arbitration or any authority or any threatened litigation by the Bidder or Bank.
3. On payment of any amount less than aforementioned full amount, as per demand of the Railway, the Bond shall remain valid for the balance amount i.e. the aforementioned full amount less the payment made to the Railway.
4. The Surety shall pay the amount as demanded immediately on presentation of the demand by Railway without any reference to the contractor and without the Railway being required to show grounds or give reasons for its demand or the amount demanded.
5. The Surety Bond shall be unconditional and irrevocable.
6. The Bond hereinbefore shall not be affected by any change in the constitution of the Surety or in the constitution of the Contactor.
7. The Surety agrees that no change, addition, modifications to the terms of the Contract Agreement or to any documents, which have been or may be made between the Railway and the Contractor, will in any way release us from the liability under this Bond; and the Surety, hereby, waives any requirement for notice of any such change, addition or modification to the Surety.
8. This Bond is valid and effective from the date of its issue, which is *(date of issue)*.
The Bond and our obligations under it will expire on(*Expiry Date*). All demands for payment under the Bond must be received by us on or before that date.
9. The Surety agrees that the Railways right to demand payment of aforementioned full amount in one instance or demand payments in parts totaling up to the aforementioned full amount in several instances will be valid until either the aforementioned full amount is paid to the Railway or the Bond is released by Railway before the Expiry date.
10. The Surety agrees that its obligation to pay any amount demanded by the Railway before the expiry of this Bond will continue until the amount demanded has been paid in full.
11. The expressions Surety and Railway hereinbefore used shall include their respective successors, administrators and assigns.
12. The Surety hereby undertakes not to revoke the Bond during its currency, except with the previous consent in writing of the Railway. This Bond is subject to the Uniform Rules for Demand Bonds, ICC Publication No. 758.
13. We, the Surety Insurer, further agree that the Authority shall be the sole judge to decide as to whether the Bidder is in default of due and faithful fulfilment and compliance with the terms and conditions contained in the Bidding Documents including, inter alia, the failure of the Bidder to keep its Bid open during the Bid validity period set forth in the said Documents, and the decision of the Authority that the Bidder is in default as aforesaid shall be final and binding on us, notwithstanding any differences between the Authority and the Bidder or any dispute

pending before any Court, tribunal, arbitrator or any other authority.

14. The Bond shall be in addition to and without prejudice to any other security Bond (s) of the contractor in favour of the Railway available with the Railway. The Surety, under this Bond, shall be deemed as Principal Debtor of the Railway.

Notwithstanding anything to the contrary contained in these presents,

- a. Our liability under this Surety Bond shall not exceed _____ **(Rupees Only).**
- b. This Surety Bond shall be valid up to _____ *(being the date of expiry)*;
- c. Unless the bank is served a written claim or demand on or before _____ *(date of expiry)* all rights under this Bond shall be forfeited and the Surety shall be relieved and discharged from all liabilities under this Bond irrespective of whether or not the original Surety bond is returned to the Surety.

Dated the day of 2024

2. The Insurance Surety Bond shall be verified by sending mail to [customer.care@sbigeneral.in].

Place.....

Bank's Seal and authorized signature(s)

(Name in Block letters) _____

(Designation with Code No) _____

(P/Attorney) No.

Witness

1.

2.

(Bid Security)

Bank Guarantee Bond from any scheduled commercial bank of India
(On non-judicial stamp paper, which should be in the name of the Executing Bank).

Name of the Bank: -----

President of India,

Acting through,

..... Railway,

Beneficiary Railway

Date:.....

Bank Guarantee Bond No.:

Date:-----

In consideration of the President of India acting through----- (Designation & address of Contract Signing Authority), Railway,, (hereinafter called "The Railway") having invited the bid for _____ through Notice inviting tender (NIT) No.._____, We have been informed that [Insert name of the Bidder](hereinafter called "the Bidder") intends to submit its bid (hereinafter called "the Bid").

WHEREAS, the Bidder is required to furnish Bid Security for the sum of [Insert required Value of Bid Security], in the form of Bank Guarantee, according to conditions of Bid.

AND

WHEREAS,[Insert Name of the Bank], with its Branch [Insert Address] having its Headquarters office at..... [Insert Address], hereinafter called the Bank, acting through [Insert Name and Designation of the authorised persons of the Bank], have, at the request of the Bidder, agreed to give guarantee for Bid Security as hereinafter contained, in favour of the Railway:

1. KNOW ALL MEN that by these present that I/We the undersigned [Insert name(s) of authorized representatives of the Bank], being fully authorized to sign and incur obligations for and on behalf of the Bank, confirm that the Bank, hereby, unconditionally and irrevocably guarantee to pay to the Railway full amount in the sum of [Insert required Value of Bid Security] as above stated.
2. The Bank undertakes to immediately pay on presentation of demand by the Railway any amount up to and including aforementioned full amount without any demur, reservation or recourse. Any such demand made by the Railway on the Bank shall be final, conclusive and binding, absolute and unequivocal on the Bank notwithstanding any disputes raised/ pending before any Court, Tribunal, Arbitration or any Authority or any threatened litigation by the Bidder or Bank.
3. The Bank shall pay the amount as demanded immediately on presentation of the demand by Railway without any reference to the Bidder and without the Railway being required to show grounds or give reasons for its demand of the amount so demanded.
4. The guarantee hereinbefore shall not be affected by any change in the constitution of the Bank or in the constitution of the Bidder.
5. The Bank agrees that no change, addition, modifications to the terms of the Bid document or to any documents, which have been or may be made between the Railway and the Bidder, will in any way absolve the Bank from the liability under this guarantee; and the Bank

hereby, waives any requirement for notice of any such change, addition or modification made by Railway at any time.

6. This guarantee will remain valid and effective from.....[insert date of

issue]till

.....[insert date, which should be minimum 90 days beyond the expiry of validity of Bid]. Any demand in respect of this Guarantee should reach the Bank within the validity period of Bid Security.

7. The Bank Guarantee is unconditional and irrevocable.
8. The expressions Bank and Railway herein before used shall include their respective successors and assigns.
9. The Bank hereby undertakes not to revoke the guarantee during its currency, except with the previous consent in writing of the Railway. This guarantee is subject to the Uniform Rules for Demand Guarantees, ICC Publication No.758.
10. The Bank hereby confirms that it is on the SFMS (Structured Financial Messaging System) and shall invariably send the advice of this Bank Guarantee to the following bank details –

IFSC CODE	:	
IFSC TYPE	:	
BANK NAME	:	
BRANCH NAME	:	
CITY NAME	:	
ADDRESS	:	
DISTRICT	:	
STATE	:	
BC ENABLED	:	

11. The Guarantee shall be valid in addition to and without prejudice to any other security Guarantee(s) of Bidder in favour of the Railway. The Bank, under this Guarantee, shall be deemed as Principal Debtor of the Railway.

Date

.....

Place.....

Bank's Seal and authorized
signature(s) [Name in Block
letters]
[Designation with Code
No.].....
[P/Attorney] No.

Witness:

1 Signature, Name & Address & Seal

2 Signature, Name& address &

Seal Bank's Seal [P/Attorney]No.