



WEST CENTRAL RAILWAY

पश्चिम मध्य रेलवे

SPECIFICATION FOR ENERGY EFFICIENT LED BASED LUMINAIRE  
FOR OUTDOOR & INDOOR APPLICATION (GENERAL SERVICES)

WCR Specification No. WCR/JBP/Specification/(GS)/001 (Rev.0)/2016

(REF: Specification No. RDSO/PE/SPEC/PS/0123(Rev '0')-2009, Amdt -'1')

Sl.No.	Date of Revision /amendment	Revision/Amendment	Page No.	Remarks

APPROVED

*[Signature]*  
5/10

Chief Electrical Service Engineer  
West Central Railway

Prepared by SSE/OSM/WCR/JBP JE/OSM/WCR/JBP JE/GS/STORE/WCR/JBP	Checked By <i>[Signature]</i> Dy.CEE(G)/WCR
---	---

## Technical Specifications of Energy Efficient LED based Luminaire for Outdoor & Indoor application (West Central Railway)

WCR Specification No. WCR/JBP/Specification/(GS)/001(Rev.0)/2016

[REF: RDSO Specification No. RDSO/PE/SPEC/PS/0123(Rev '0')-2009, Amendment '1']

### [1] FOREWORD

At present conventional type luminaires are being provided for Indoor lighting, offices, street lights & platform lighting. By Introduction of white high power lights emitting diode, LED having more than 50,000 working hours, it is possible to use LED lamps in place of existing fluorescent T-8/T-5/HPSV/Metal halide. LED lights are almost maintenance free and as a result total power saving is expected to be more than 50%, keeping in view energy conservation, increased life and recurring savings on account of maintenance, use of environment friendly energy efficient LED based luminaire is being considered for indoor & outdoor lighting.

### [2] DETAILS OF EXISTING & PROPOSED FITTINGS.

Sr. No.	Type of Existing fitting	Wattage of existing fitting.	Proposed Fittings	Wattage of LED fitting	Minimum / Initial Lumen Output.	Application
For outdoor: Street light, High Mast & platform open area.						
i a.	HPSV/HPMV	70W	LED	50W	4000	Circulating area, Outdoor Lighting, Yard Lighting, High Mast
b.		150W	LED	100W	8000	
c.		250W	LED	170W	13500	
d.		400W	LED	260W	20000	
ii a.	Metal Halide	70W	LED	50W	4000	Circulating area, Outdoor Lighting, Yard Lighting, High Mast
b.		250W	LED	100W	15000	
c.		400W	LED	160W	15000	
iii a.	FTL	1x40W	LED	30W	2400	Street Lighting
b.		2x40W	LED	60W	4800	
iv	Platform Lighting					Platform Lighting
a.	FTL	1x40W	LED	30W	2400	
b.		2x40W	LED	60W	4800	
c.		1 x 28W	LED	18W	1440	
For Indoor : offices, service buildings etc.						
v	T-5/T-8 Fitting 4 ft. size,	28/36W	LED	20W	1440/1600	Office & Service building
vi	CFL Lamps	11W	LED Lamps	7W	560	Office & Service building
vii	Recess mounting fitting 2 x 2 ft. size	2 x 14W	LED	2x9W	1440	Office & Service building
viii	Down lighter	70/150W	LED	40/80W	3200/6400	Office & Service building
ix	4 ft Tube light	28W	LED	18/20W	1440/1600	Office & Service building
x	2 ft Tube light	20W	LED	10W	800	Bulk head LED down lighter

*[Handwritten signatures]*

*[Handwritten signature]*

*[Handwritten signature]*  
5710



**[3] SCOPE**

The scope includes design, development, manufacturing, testing and supply of energy efficient luminaire complete with all accessories, LED lamps with suitable current control driver circuit including mounting arrangement for street light, platform light, recessed type & ceiling mounting arrangements etc. The luminaire shall be suitable for rugged service under the operational and environmental conditions.

Each type of luminaire shall be supplied with associated driver circuit and required optics.

The applications of Energy Efficient LED based Luminaires are as under

- i) For outdoor: Street light, High Mast & platform open area.
- ii) Platform Lighting
- iii) For Indoor: offices, service buildings etc.

**[4] CONSTRUCTION**

- a. All the luminaires shall be finalized based on the performance requirement. The detailed calculation for lux level as per clause no. 7.8 with uniform distribution including the lux distribution curve /graph/spatial distribution shall be submitted in support of the dimensions selected and variation thereof. Housing shall be made of 1.6 mm thick sheet Steel conforming to IS: 513 (Grade O) or aluminum die cast having high conductivity preferably to grade 5000 or similar to high conductivity heat sink material for outdoor fittings and of suitable thickness for indoor fittings. Efforts shall be made to keep the overall outer dimensions as minimum as possible. All out door light fittings shall be provided with toughened glass of sufficient strength under the LED chamber to protect the LED and luminaries.
- b. Suitable number of LEDs shall be used in the luminaire. LEDs of NICHIA/ CREE/ OSRAM/ SAMSUNG/ LUMILEDS/ AVAGO make shall be used for the purpose. The manufacturer shall submit the proof of procurement of LEDs from above OEMs at the time of testing.
- c. Suitable reflector / lenses may also be provided to increase the illumination angle wherever necessary.
- d. Supplier will be solely responsible for testing and performance of the luminaries after installation and shall also ensure the specified and uniform illumination and comfort level on the street/platform for outdoor and work desk/floor for indoor lighting.
- e. Design of the thermal management shall be done in such a way that it shall not affect the properties of the diffuser.

**4.1 High power and high lumen efficient LEDs suitable for following features shall be used:**

- a. The efficiency of the LED lamps at 110°C junction temperature shall be more than 80%.
- b. The working life of the lamp at junction temperature of 110°C for 350mA current shall be more than 50,000 hours of accumulative operation and shall be suitable for continuous operation of 24 hours per day. These features shall be supported with datasheet.
- c. Adequate heat sink with proper thermal management shall be provided.
- d. Colour temperature of the proposed white colour LED shall be between 5700K – 6500 K.
- e. Minimum view angle of the LED shall not be less than 120°.
- f. The output of LED shall be more than 100 lumen per watt at minimal operating current and shall ensure guaranteed operation life of more than 50,000 burning hours with controlled junction temperature of 110°C.
- g. Efficiency of driver electronics shall be more than 85%.
- h. Power factor of complete fitting shall be more than 0.95.
- i. The driver card shall withstand 440V & 1.5 KV  $\pm 3\%$  surge protection and shall resume normal working when nominal voltage is applied again.
- j. Thermal management shall be in such a way that LED junction temperature shall not go beyond 80 degree centigrade.
- k. Lumen maintenance report as per LM 80 standards for the LEDs used & LM79 standards for efficacy of fixture shall be submitted along with offer or at the time of prototype test.
- l. The LED luminaire shall be free of glare.
- m. Color rendering index CRI  $\geq 75$ .

**4.2 Specification for LED driver**

- a. Input voltage range within 180Vrms to 270Vrms
- b. Operating input voltage 240Vrms
- c. No load power consumption  $\leq 500\text{mW}$
- d. Maximum output voltage 105V DC  $\pm 3\%$
- e. Output voltage ripple should be within 3%
- f. Output over voltage protection 125VDC

*m, b, b*

*OPH*

*Alimul*  
5/10/16

- g. Power factor 0.95
- h. Full Load Efficiency  $\geq 90\%$
- i. THD  $\leq 10\%$
- j. Hot swapping
- k. Load regulation  $\pm 5\%$
- l. Current waveform should meet EN 61000-3-2
- m. LED Driver shall withstand voltage of 440V for 2 hours and restore normal working when normal voltage is applied.
- n. Maximum Temperature rise  $\leq 10^\circ\text{C}$  @  $55^\circ\text{C}$   $T_{\text{amb}}$  with safety margin of  $10^\circ\text{C}$
- o. The driver should comply to CISPR 15 for limits and methods of measurement of Radio Disturbance characteristics
- p. The equipment should comply to IEC 61547 for EMC immunity requirements
- q. The control gear should be compliant to IEC 61347-2-13, IEC 62031 and IEC 62384 as per the requirements

**4.3** The equipment should be compliant to IEC 60598-1, IEC 62031 and IEC/PAS 62612 depending on the type of luminaire.

## 5.0 REFERRED STANDARDS

### 5.1 For Indoor Lighting:

IS: 513	Cold-rolled low carbon steel sheets and strips
IEC 60529	Classification of degree of protections provided by enclosures.
EN 55015, CISPR 15	Limits and methods of measurement of radio disturbance characteristic of electrical lighting and similar equipment.
IEC 62031	LED modules for general lighting-Safety requirements
EN 61547	Equipment for general lighting purposes – EMC immunity requirement.
EN 60929	Performance, AC supplied electronics ballast for tubular fluorescent lamps performance requirement.
IEC 60598-2-1	Fixed general purpose luminaires
IEC 60598-1	Luminaires - General requirement and tests
IEC 61000-3-2	Electro Magnetic compatibility (EMC) -Limits for Harmonic current emission - (equipment input current $\leq 16$ Amps. per phase.
IEC 60068-2-38	Environmental Testing :Test Z- AD: composite temperature/humidity cyclic test
IEC 61347-2-13	Lamp control gear : particular requirements for DC or AC supplied electronic control gear for LED modules.
IS 10322	Specification for the luminaires
IS 4905	Method for random sampling
LM 79	LED luminaire photometry measurement.
LM 80	Lumen Maintenance
IEC 62384	DC or AC supplied electronic control gear for LED modules performance requirements
IEC/PAS 62612	Self-ballasted LED lamps for general lighting services- Performance requirements

### 5.2 For outdoor Lighting:

IS: 513	Cold-rolled low carbon steel sheets.
IEC 60529	Classification of degree of protections provided by enclosures.
EN 55015	RFI $< 30\text{MHz}$
EN 55022	RFI $> 30\text{MHz}$
EN 61000-3-2	Harmonics
EN 61547	Immunity
EN 60929	Performance
IEC 60598-2-1	Fixed general purpose luminaires
IEC 60598-1	General requirement and tests
IEC 61000-3-2	Limits for Harmonic current emission --THD $< 10\%$
IEC 60068-2-38	Specification for Permitted Humidity Test
IS 10322	Specification for the luminaires
IS 4905	Method for random sampling

*[Handwritten signatures]*

*[Handwritten signature]*

*[Handwritten signature]*  
S/O



## 6.0 SERVICE CONDITIONS:

Street light/Indoor light on pipe/Recess mounting type light unit complete with luminaries and mounting accessories shall be suitable for street, office complex, railway platforms (covered and open) and residential colonies of Indian Railways under the following environmental conditions :-

### 6.1 Environmental conditions

Maximum ambient air temperature	: 55°C (For outdoor Application) & 45°C (For Indoor Application)
Minimum ambient air temperature	: -5° C
Max. Relative humidity	: 100%
Atmosphere	: Extremely dusty and desert weather and desert terrain in certain areas. The dust contents in air may reach as high values as 1.6 mg/m <sup>3</sup>
Coastal area	: The equipment shall be designed to work in coastal area in humid, salt laden and corrosive atmosphere.

### 6.2 The maximum value of the environmental condition in the coastal area will be as follows:

Max. pH value	: 8.5
Sulphate	: 7 mg/litre
Max. Concentration of chlorine	: 6 mg/litre
Max. Conductivity	: 130 micro sec./cm
Annual rainfall	: Ranging between 1750 to 6250 mm with thunder storm
Altitudes	: Not exceeding 1200 m above sea level

### 6.3 The supplier shall provide "In the field service support" during guarantee period.

## 7.0 TECHNICAL REQUIREMENTS

### 7.1 The luminaire casing/housing shall be made of 1.6 mm thick sheet Steel conforming to IS: 513 (Grade O) or aluminum die cast having high conductivity preferably to grade 5000 or similar to high conductivity heat sink material for outdoor fittings and of suitable thickness for indoor fittings.

### 7.2 The electronic components used shall be as follows:-

- IC (Integrated circuit) shall be of industrial grade or above.
- Metallic film / Paper/Polyester Capacitor shall be rated for a maximum temperature of 105°C.
- The resistors shall be preferably made of metal film of adequate rating. The actual loading versus rating shall be 3.
- The junction temperature of the switching devices such as transistors and MOSFETs etc. shall not exceed 125°C (allowing thermal margin of 25 °C).
- The conformal coating used on PCBs should be clear and transparent and should not affect colour code of electronic components or the product code of the company.
- The heavy components shall be properly fixed. The solder connection should be with good finish.
- The electronics components covered for this equipment shall pass all the tests called for in the specification. The tenderer shall indicate the deviation or compliance otherwise the offer may not be considered for evaluation.
- The infrastructure for Quality Assurance facilities as called for in the specification shall be available for the manufacturing of this product.

### 7.3 The connecting wires used inside the luminaries shall be low smoke halogen free, fire retardant e-beam and fuse protection shall be provided in input side.

### 7.4 Care shall be taken in the design that there is no water stagnation anywhere. The entire housing shall be dust and water proof having IP65 protection for outdoor application & IP20 protection for indoor application as per IEC 60529.

### 7.5 The control gear shall be designed in such a way so that temperature rise of heat sink shall not be more than 10°C with respect to ambient temperature.

### 7.6 For platform lighting, luminaries shall be such that the glare from individual LED is restricted and shall not cause inconvenience to the public.

### 7.7 All the material used in the luminaire shall be halogen free and fire retardant confirming to UL94

### 7.8 **Illumination Level:** The fitting shall be so designed that the illumination level shall be evenly distributed and shall be free from glare. Illumination level of different types of luminaire shall be as below:

*[Handwritten signatures and initials]*

Sr. No	Type of Luminaries	Vertical Distance of fittings from the floor level (Mtrs)	Minimum Illumination Level (Lux) at centre	Colour of illumination Street Light
Street Light:				
1	50W	5	25	daylight white
2	100W	7	25	daylight white
3	170W	7	35	daylight white
4	260W	7	35	daylight white
5	190W	7	35	daylight white
6	30W	5	25	daylight white
7	60W	7	25	daylight white
Platform Light:				
8	30W	4	50	daylight white
9	60W	4	50	daylight white

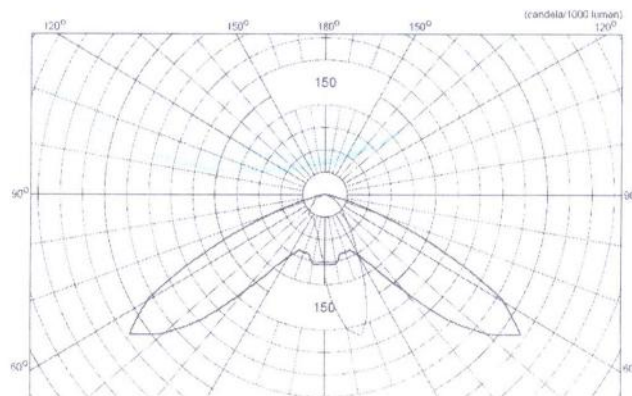
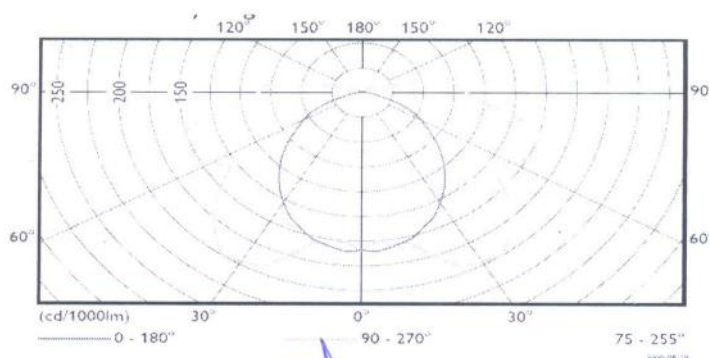
Sr. No	Place to be illuminated	Vertical Distance of fittings from the floor level (Mtrs)	Average Illumination Level (Lux)	Colour Temp in °K
Indoor Light				
1.	Work areas like cabins and work stations	2.743	250 at 1 mtr above ground level	5500 to 7000
2.	Corridors	2.743	125 on the floor	5500 to 7000

**Note:**

1. Variation in illumination level shall be  $\pm 2\%$  is allowed in input voltage range from 100VAC to 300VAC.
2. The illumination shall not have infra-red and ultra-violet emission. The test certificate from the NABL approved laboratory shall be submitted.
3. Electronic efficiency shall be more than 85%.

**7.8.1 Polar curves:-**

Typical distribution of illumination of these luminaries shall be as given below:-

**a. Street light:****b. Platform light:**

Handwritten signatures and initials in blue ink.

Handwritten signature in blue ink.

Handwritten signature "Srinivas" and date "5/10" in blue ink.



## 8.0 TESTS for Indoor and Outdoor Lighting:

Tests are classified as:-

- Prototype test (Only for Outdoor Lighting)
- Type test
- Acceptance test
- Routine test

### 8.1 Prototype Test (Only for Outdoor Lighting)

Prototype test shall be conducted on the first unit developed by the firm as per the relevant Specification. After successful proto type test the proto type sample shall be got certified for meeting LM79 specifications from UL / any NABL approved laboratories. The proto type tests undertaken at firm's premises may be witnessed by authorized railway representative. And the firm will submit test certificate for other tests conducted by at government approved labs. Only after certified by railways for the above clearance for bulk manufacturing will be given by railway.

### 8.2 Type Test

Type tests shall be carried out to prove confirmation with the requirement of specification and general quality / design features of the unit. The results of the type tests shall be valid for a maximum period of 3 years in case of any change in Bill of Material or design of unit, complete type test shall be repeated.

If any sample fails in any of the type tests, two fresh samples shall be taken and tested. If any sample again fails in that test, the whole lot shall be rejected.

### 8.3 Acceptance Tests

These tests are carried out by an inspecting authority at the supplier's premises on sample taken from a lot for the purpose of acceptance of a lot. Acceptance tests shall not be carried out from particular size from the lot on which type tests have already been conducted. Recommended sampling plan is given below.

#### 8.3.1 Sample size and criteria for conformity

The luminaries shall be selected from the lot at random. In order to ensure randomness of selection, procedures given in IS 4905-1968 (Reaffirmed 2001) may be followed.

### 8.4 Routine Tests

These tests shall be performed by the manufacturer on each complete unit of the same type and the results shall be submitted to the inspecting agency, prior to offering the lot for acceptance test. The firm shall maintain the records with traceability.

### 8.5 Test Scheme

Sr. No.	Description of test	Clause No.	Prototype Test (Only for outdoor)	Type Test		Acceptance Test	Routine Test
				Outdoor	Indoor		
1	Visual and Dimensional check	9 (i)	Y	Y	Y	Y	Y
2	Checking of documents of purchase of LED	9 (ii)	Y	Y	Y	Y	Y
3	Resistance to humidity	9 (iii)	Y	Y	Y	--	--
4	Insulation resistance test	9 (iv)	Y	Y	Y	Y	Y
5	HV test	9 (v)	Y	Y	Y	Y	Y
6	Over voltage protection	9 (vi)	Y	Y	Y	--	--
7	Surge protection	9 (vii)	Y	Y	Y	--	--
8	Reverse polarity	9 (viii)	Y	Y	Y	Y	Y
9	Temperature rise Test	9 (ix)	Y	Y	Y	--	--
10	Ra (Colour Rendering Index) measurement test	9 (x)	Y	Y	Y	--	--
11	Lux measurement	9 (xi)	Y	Y	Y	Y	--
12	Fire retardant test	9 (xii)	Y	Y	Y	--	--
13	Test for IP 20 & IP 65 protection	9 (xiii)	Y	Y	Y	--	--
14	Environmental tests	9 (xiv)	Y	Y	--	--	--
15	Reliability Test	9 (xv)	Y	Y	--	--	--
16	Life Test	9 (xvi)	Y	Y	Y	--	--
17	Endurance Test	9 (xvii)	Y	Y	--	--	--
18	Safety	9 (xviii)	--	--	Y	--	--
19	Vibration test	9 (xix)	Y	--	--	--	--

*Handwritten signatures and initials are present at the bottom of the page, including a signature that appears to read "H. Chinn" and the number "5710".*

## 9.0 Method of Testing

### i) Visual and Dimensional Check

The unit shall be checked visually for all dimensions as per approved design and drawing. General workmanship should be good; all the components properly secured and sharp edges shall be rounded off. Check the marking and quality of the workmanship visually. Check the rating and make of electronic / electrical items.

### ii) Checking of documents of purchase of LED

Check Document of purchase of LED lamps of approved sources viz. NICHIA / OSRAM / CREE / SEOUL / PHILIPS LUMILEDS / LEDNIUM / AVAGO.

### iii) Resistance to humidity test

This is carried out by suspending the painted panels in corrosion chamber maintained at 100% RH and temperature cycle of 42 to 48 deg. C for 7 days and examining it for any sign of deterioration and corrosion of metal surface.

### iv) Insulation resistance test

The insulation resistance of the unit between earth and current carrying parts shorted together shall not be less than 2 M Ohms when measured with 500V megger.

### v) HV test

Immediately after insulation resistance test, an AC voltage of 1.72 KV rms ( $1500 + 2x$  rated voltage) of sine wave form of 50 Hz shall be applied for one minute between the live parts and frame. There shall not be any kind of break down, flashover or tripping of supply.

### vi) Over voltage protection

The luminaire shall withstand at 300V AC for two minutes.

### vii) Surge protection

It shall withstand a surge of 1.5 KV  $\pm$  3% for 50 microsecond  $\pm$  20 % at the input terminals for all types. (Tests shall comply with Clause 5.4 of latest IEC 60571-1).

### viii) Reverse polarity

The luminaire shall withstand polarity reversal. It shall be operated with reverse voltage for 5 minutes at maximum value of voltage range. At the end of this period, the supply shall be made correct polarity and luminaire shall operate in a normal way.

### ix) Temperature rise test

Temperature rise test shall be conducted at 180VAC for outdoor lighting and 100VAC for indoor lighting with full load. The temperature rise shall be recorded by temperature detectors mounted at the specified reference points on the body of semiconductors, capacitors and other components as agreed between purchaser and manufacturer. The maximum-recorded temperature under worst conditions shall be corrected to 55°C and compared with maximum permissible temperature (for power devices at junction). Under loading conditions as specified above, the corrected temperature of the power devices shall have a safety margin of minimum 10°C. Temperature at junction shall not exceed 100°C when corrected to 55°C. The Luminaire shall also be subjected for short time rating after continuous loading to ensure the temperature rise is within the permissible limit. The maximum temperature rise of the electronics devices on the PCBs shall be in limit for industrial grade components suitable for 85°C environment. In case of exceeding limit, use of MIL-grade component shall be considered keeping RDSO informed.

### x) Ra (Color Rendering Index) measurement test

The lumen is the unit of luminous flux, which is equal to the flux emitted in a solid angle of one Steradian by a uniform point source of one candela.

The initial reading of the chromaticity co-ordinates x & y shall be within 5 SDCM (Standards Deviation for Color matching) from the standardized rated value as per Annex. D of IEC 60081 - 1997.

The initial reading of the general color -rendering index (Ra) shall not be less than the rated value decreased by 3.

The lumen maintenance of the lamp shall not be less than 80% of the initial lumen after 20000 burning hours and 70% of the initial lumen after 50000 hours. The initial lumen will be taken after 100 hours aging.

Photometric test shall be conducted as per annexure B of IEC 60081-97. The lumen maintenance test shall be done as per annexure C of IEC 60081-97.

### xi) Lux measurement

Lux measurement with the help of Lux meter shall be done at a distance as shown in para 5.8 above. Value obtained shall not be less than the Lux specified in the table therein. , considering 10% Lumen is absorbed by the reflector.

*[Handwritten signatures and initials]*

*Alchini*  
5710



- xii) **Fire retardant Test**  
Fire Retardant test shall be conducted as per IEC 332-1(For outdoor Lighting) and IEC 60332-1(For indoor Lighting) of the wire used in the fittings.
- xiii) **Test for IP65 protection (For outdoor Lighting) & Test for IP20 protection (For indoor Lighting):**  
This test shall be conducted as per IEC 60529.
- xiv) **Environmental tests**  
The Luminaire shall meet the following tests as prescribed in IEC – 60571.  
a) Dry heat test.  
b) Damp heat test  
c) Test in corrosive atmosphere  
d) Combined dust, humidity and heat test
- xv) **Reliability Test**  
The reliability can only be determined in actual service. However, the following tests shall be carried out on the prototype to simulate as close as possible, the service conditions. There shall be no failure during this test.  
a) The light unit shall be mounted in an oven maintained at 75°C for outdoor lighting and 45°C for indoor lighting.  
b) The light will be operated at the specified maximum voltage and at 75°C for outdoor lighting and 45°C for indoor lighting for a period of 100 hours.
- xvi) **Life Test**  
For outdoor Lighting: The lumen maintenance & life test shall be done as per annexure C of IEC 60081-97.  
For indoor Lighting: The lumen maintenance and life test shall be done as per annexure C of LM 80 report of LEDs.
- xvii) **Endurance Test**  
The luminaire shall be kept "ON" with input voltage of 250VAC for 200 hours. After this the luminaire is subjected to 20,000 cycles of "ON" and "OFF", each cycle consisting of 3 seconds "ON" and 10 seconds "OFF" period. Luminaire should survive this test. Test is to be continued for one lac cycles, followed by performance test.
- xviii) **Safety**  
The luminaire shall comply with the safety requirements as per IEC 61195.
- xix) **Vibration Test**  
The complete unit cubicles together with its mounting arrangements (including shock absorbing devices, if provided) shall be subjected to the vibration & shock testing ( for category I class A/B ) as per latest IEC 61373.

## 10.0 Marking

The following information shall be distinctly and indelibly marked on the housing:

- Year of manufacture / Batch Number / Serial Number.
- Name of Manufacturer
- Rated watt and voltage
- Input frequency

## 11.0 Manufacturer's certificates

Manufacturer should submit the certificate of having purchased LED from one of the approved source (LM-80 certificate should be submitted.)

Manufacture's test certificate to be submitted for (i) Mechanical strength, (ii) Endurance test and Thermal test, (iii) Resistance to dust and moisture. (iv) Insulation resistance and electrical strength, (v) resistance to heat, fire and tracking and (vi) photometric tests as per the IS 10322 Part – 5, Sec. -2.

## 12.0 Guarantee

The complete system of LED lights (including Driver etc.) shall be guaranteed for satisfactory performance and manufacturing defects for a period of 60 months from date of commissioning of 72 months from the date of supply whichever is earlier.

*[Handwritten signatures and initials at the bottom of the page]*